



RHF090-150

Product Specifications

SINGLE PACKAGE HEAT PUMP ROOFTOP UNITS WITH X-VANE™ FAN TECHNOLOGY WITH OPTIONAL ELECTRIC HEAT (RHF) 7.5-12.5 TONS

The new 7.5 to 12.5 ton RHF090-150 Series packaged heat pump rooftop units (RTU) with X-Vane Fan Technology provides value added benefits never seen in this type of equipment before. New major design features include:

- Environmentally balanced R-454B refrigerant, which delivers a 75% reduction in global warming potential (GWP) compared to R-410A. R-454B's GWP of 466 easily exceeds the EPA (Environmental Protection Agency) requirement of <700 GWP.
- Patented, industry's first efficient indoor fan system using Vane Axial fan with electronically commutated variable speed motor. As compared to today's typically used belt drive with forward curve fans, system provides reliable operation with:
 - 75% fewer moving parts
 - No fan belts, pulleys, shaft, and shaft bearings
 - 40% more efficient than traditional belt drive forward curve fans
 - Slow ramp up capability for better sound and comfort control
 - Internal protection from phase reversal and phase loss situations
 - High external static capability
 - Slide out blower assembly design
- Reliable 2 stage cooling with tandem scroll compressors technology and fully active evaporator coil
- New unit control board with intuitive indoor fan adjustment that uses simple dial and switch adjustments
- Reliable copper tube/aluminum fin condenser coil with 5/16 in. tubing to help reduce refrigerant charge and reduce weight versus prior designs



RHF090-150

X-Vane™ Fan

RHF units up to 12.5 tons are designed to fit on roof curbs that were installed back to 1989, which makes replacement easy and eliminates the need for curb adapters, changing utility connections or supporting curb overhang situations.

2 speed Vane Axial indoor fan speed control helps deliver IEERs up to 15.0.

All models are capable of either vertical or horizontal airflow without dedicated models or field-installed kits. The 150 size models require a field installed supply air kit.

With "no-strip" screw collars, handled access panels, and more, the unit is easy to install, easy to maintain, and easy to use. Your new 7.5 to 12.5 ton RHF rooftop unit (RTU) provides optimum comfort and control from a packaged rooftop.

Installation ease

All RHF units are field-convertible to horizontal airflow, which makes it easy to adjust to unexpected jobsite complications. Lighter units make for easy replacement and aid in the structural approval process. Units have simple, fast plug-in connections to the standard integrated unit control board (UCB). Clearly labeled connections points to reduce installation time. Also, a large control box provides room to work.

Easy to maintain

With the X-Vane vane axial fan system and a direct drive ECM motor, belts and pulleys are a thing of the past. This frees up maintenance, installation and commissioning time. Should an adjustment be necessary, it can easily be made via the UCB in the control box. For regular service activities, our easy-access handles provide a quick solution to all commonly accessed service panels, and our sloped, corrosion-resistant composite drain pan sheds water and will not rust. Service gauge connections are included on compressor suction/discharge lines before and after the filter drier to monitor system operation during maintenance.

Table of contents

	PAGE		PAGE
FEATURES/BENEFITS	2	PERFORMANCE DATA	22
MODEL NUMBER NOMENCLATURE	3	FAN DATA	35
CAPACITY RATINGS	4	ELECTRICAL DATA	52
PHYSICAL DATA	6	TYPICAL WIRING DIAGRAMS	70
OPTIONS AND ACCESSORIES	7	SEQUENCE OF OPERATION	76
BASE UNIT DIMENSIONS	11	APPLICATION DATA	78
ACCESSORY DIMENSIONS	20	GUIDE SPECIFICATIONS	79

R-454B Features

With a GWP of 466 and similar working pressure and performance to R-410A, R-454B easily exceeds the EPA's new, stringent <700 GWP refrigerant requirement while minimizing unit redesign. Like other next generation refrigerants (R-32, etc.), R-454B is classified as an "A2L" refrigerant by ASHRAE®¹ (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). This designation means that R-454B is "mildly flammable" under certain conditions. While this is a change from legacy "A1 — No Flame Propagation" refrigerants like R-410A, A2Ls are still very low on the flammability scale and quite safe for use. A2L refrigerants are difficult to ignite and have an extremely low flame speed — much less so than natural gas, propane, or even rubbing alcohol. We are committed to safety. As such, all of our R-454B rooftop units include a factory-installed dissipation control board and leak sensor designed to last the lifetime of the unit. This system is certified to UL 60335-2-40 and designed to work right away, without any field configuration or wiring. In the event of a leak, these systems automatically identify and resolve the issue by safely dissipating the refrigerant to ensure there is no risk to equipment, buildings, or occupants.

Easy to use

The newly re-designed Unit Control Board puts all connections and troubleshooting points in one convenient place. Most low voltage connections are made to the same board and make it easy to access it. Setting up the fan is simple by an intuitive switch and rotary dial arrangement. RHF rooftops have high and low pressure switches, a filter drier, and 2 in. filters standard.

Heat pump flexibility

RHF models offer onboard electromechanical heating standard. Our robust systems are rigorously tested to ensure reliable reverse cycle heating operation. The result is a clean, environmentally responsible heat source to keep occupants comfortable year-round. All RHF models can be easily controlled with a standard thermostat and remove the need to burn fossil fuels to heat your building. Should you need supplemental heat, we offer a full line of single point powered electric heaters that can easily be installed at site.

X-Vane Fan Technology

Direct drive X-Vane Fan Technology indoor fan system uses Vane Axial fan design and electrically commutated motors.

This new Vane Axial design over past belt drive systems has 75% fewer moving parts, uses up to 40% less energy and has no fan belts, blower bearings and shaft. Full fan and motor assembly also slides out for easier maintenance and service.

Features/Benefits

Value-added features include:

- Single point electrical connections
- 7.5 to 12.5 ton models use TXV refrigerant metering devices
- Scroll compressors with internal line-break overload protection
- Units come with an easy access tool-less filter door. Filter track tilts out for filter removal and replacement. All filters are the same size in each unit

Operating efficiency and flexibility

These RHF packaged rooftops meet the Department of Energy (DOE) 2023 efficiency standard, as well as the latest ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) 90.1 and IECC¹ (International Energy Conservation Code) minimum IEER efficiency requirements.

Field convertible airflow

All RHF 7.5 to 12.5 ton units are field-convertible to horizontal airflow, which makes it easy to adjust to unexpected jobsite complications. 12.5 ton models require a simple supply duct cover kit to field convert from factory vertical to horizontal.

1. Third-party trademarks and logos are the property of their respective owners.

Model number nomenclature

RHF090-150 Model Number Nomenclature

MODEL SERIES	R	H	F	0	9	0	L	0	2	A	0	A	A	A
Position Number	1	2	3	4	5	6	7	8	9	10	11	12	13	14
R = Rooftop														
H = Heat Pump		Type												
F = Standard Efficiency Packaged RTU with X-Vane™ Technology			Unit Efficiency											
090 = 90,000, 7.5 Tons 102 = 102,000, 8.5 Tons 120 = 120,000, 10.0 Tons 150 = 150,000, 12.5 Tons				Nominal Cooling Capacity										
H = 208-230/3/60 L = 460/3/60 S = 575/3/60								Voltage						
0 = No Heat									Heating Capacity					
2 = Standard/Medium Static X-Vane Fan 3 = High Static X-Vane Fan 5 = Standard/Medium Static X-Vane Fan and Filter Status Switch 6 = High Static X-Vane Fan and Filter Status Switch														
									Motor (Indoor Fan)					
A = None B = Temperature Economizer with Barometric Relief F = Enthalpy Economizer with Barometric Relief L = ULL (Ultra Low Leak) Temperature Economizer with Barometric Relief and CO ₂ Sensor M = ULL Enthalpy Economizer with Barometric Relief and CO ₂ Sensor U = ULL Temperature Economizer with Barometric Relief W = ULL Enthalpy Economizer with Barometric Relief										Outdoor Air Options / Control				
0A - None Note: See the RHF 7.5 to 12.5 Ton Specification Sheet for Factory Installed Options											Factory Installed Options ^a			
A = Al/Cu - Al/Cu B = Precoat Al/Cu - Al/Cu C = E-coat Al/Cu - Al/Cu D = E-coat Al/Cu - E-coat Al/Cu M = Al/Cu - Al/Cu — Louvered Hail Guard N = Precoat Al/Cu - Al/Cu — Louvered Hail Guard P = E-coat Al/Cu - Al/Cu — Louvered Hail Guard Q = E-coat Al/Cu - E-coat Al/Cu — Louvered Hail Guard R = Cu/Cu - Al/Cu — Louvered Hail Guard S = Cu/Cu - Cu/Cu — Louvered Hail Guard												Condenser / Evaporator Coil Configuration		
A = Standard Electromechanical Controls													Controls	

NOTE(S):

^aCombinations of factory-installed options are available, see Specifications Sheet for details.

Capacity ratings

RHF090-150 AHRI Ratings^{a,b,c}

COOLING MODE								
UNIT	Cooling Stages	Nominal Capacity (tons)	Net Cooling Capacity (Btuh)	Total Power (kW)	EER	IEER with 2-Speed Indoor Fan Motor	AHRI Rating cfm	AHRI Part Load cfm
RHF090	2	7.5	86,000	7.7	11.20	15.0	3000	1500
RHF102	2	8.5	96,000	8.7	11.00	15.0	3400	1700
RHF120	2	10.0	116,000	10.5	11.00	15.0	4000	2000
RHF150	2	12.5	145,000	13.7	10.60	15.0	5500	2750

HEATING MODE					
UNIT	Heating, Low 17°F (–8°C) Ambient		Heating, High 47°F (8°C) Ambient		AHRI Rating cfm
	Net Capacity (Btuh)	COP	Net Capacity (Btuh)	COP	
RHF090	45,000	2.25	84,000	3.40	3000
RHF102	49,000	2.25	90,000	3.40	3400
RHF120	72,000	2.25	112,000	3.40	5500
RHF150	75,000	2.05	133,000	3.30	5500

NOTE(S):

a. Rated in accordance with AHRI Standards 340/360.

b. Rating are based on:

Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temperature and 95°F (35°C) db outdoor air temperature.

IEER Standard: A measure that expresses cooling part-load EER efficiency for commercial unitary air-conditioning and heat pump equipment on the basis of weighted operation at various load capacities.

c. All RHF units comply with ASHRAE 90.1-2019 (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) and DOE-2023 (Department of Energy) Energy Standard for minimum IEER requirements.

LEGEND

AHRI — Air-Conditioning, Heating and Refrigeration Institute
COP — Coefficient of Performance
EER — Energy Efficiency Ratio
IEER — Integrated Energy Efficiency Ratio



Capacity ratings (cont)

Sound Rating Tables ^a

RHF UNIT	COOLING STAGES	OUTDOOR SOUND (dB) AT 60 Hz ^b								
		A-Weighted ^c	63	125	250	500	1000	2000	4000	8000
090	2	82	89.7	81.5	80.5	79.2	77.1	73.2	70.2	67.4
102	2	84	90.8	85.2	81.6	79.5	78.1	74.0	70.4	66.5
120	2	87	88.1	90.0	85.9	83.0	81.6	78.5	76.4	75.5
150	2	83	89.3	85.2	80.3	78.0	77.0	74.4	73.7	68.9

NOTE(S):

- a. Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
- b. Outdoor sound data is measured in accordance with AHRI.
- c. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of “average” human ear. A-weighted measurements for RHF units are taken in accordance with AHRI.

LEGEND

dB — Decibel

Minimum - Maximum Airflow Ratings (cfm) — Cooling Units and Accessory Electric Heat

UNIT	COOLING			ELECTRIC HEAT ^a	
	Minimum 2-Speed Airflow (Low Speed)	Minimum 2-Speed Airflow (High Speed)	Maximum Airflow cfm	Minimum Airflow cfm	Maximum Airflow cfm
RHF090	1350	2250	3750	2250	3750
RHF102	1275	2550	4250	2550	4250
RHF120	1800	3000	5000	3000	5000
RHF150	2250	3750	6250	3750	6250

NOTE(S):

- a. Electric heat modules and single point kits are available as field-installed accessories for RHF units.

Physical data

RHF090-150 Physical Data

RHF UNIT	RHF090	RHF102	RHF120	RHF150
NOMINAL TONS	7.5	8.5	10.0	12.5
BASE UNIT OPERATING WT (lb) ^a	805	867	955	1250
REFRIGERATION SYSTEM				
No. Circuits/No. Compressors/Type	1 / 2 / Scroll	1 / 2 / Scroll	1 / 2 / Scroll	1 / 2 / Scroll
R-454B Charge (lb-oz)	16-10	20-0	18-3	20-10
Cooling Metering Device	TXV	TXV	TXV	TXV
Heating Metering Device	TXV	TXV	TXV	TXV
High-Pressure Trip/Reset (psig)	630/505	630/505	630/505	630/505
Loss of Charge Trip/Reset (psig)	27/44	27/44	27/44	27/44
EVAPORATOR COIL				
Material (Tube/Fin)	Cu/Al	Cu/Al	Cu/Al	Cu/Al
Coil Type	3/8 in. RTPF	3/8 in. RTPF	3/8 in. RTPF	3/8 in. RTPF
Rows/FPI	3/15	4/15	4/15	3/15
Total Face Area (ft ²)	11.1	11.1	11.1	17.5
Condensate Drain Connection Size	3/4 in.	3/4 in.	3/4 in.	3/4 in.
CONDENSER COIL				
Material (Tube/Fin)	Cu/Al	Cu/Al	Cu/Al	Cu/Al
Coil Type	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF
Rows/FPI	2/18	2/18	3/18	2/18
Total Face Area (ft ²)	25.1	25.1	25.1	36.1
EVAPORATOR FAN AND MOTOR				
Standard/Medium Static 3 Phase				
Motor Qty / Drive Type	1 / Direct	1 / Direct	1 / Direct	1 / Direct
Max Cont bhp	2.4	2.4	2.4	3
Range (rpm)	250-2000	250-2000	250-2000	250-2200
Fan Qty / Type	1 / Vane Axial	1 / Vane Axial	1 / Vane Axial	1 / Vane Axial
Fan Diameter (in.)	22	22	22	22
High Static 3 Phase				
Motor Qty / Drive Type	1 / Direct	1 / Direct	1 / Direct	1 / Direct
Max Cont bhp	3	3	5	5
Range (rpm)	250-2200	250-2200	250-2200	250-2200
Fan Qty / Type	1 / Vane Axial	1 / Vane Axial	1 / Vane Axial	1 / Vane Axial
Fan Diameter (in.)	22	22	22	22
CONDENSER FAN AND MOTOR				
Qty / Motor Drive Type	2 / Direct	2 / Direct	1 / Direct	3 / Direct
Motor hp / rpm	1/4 / 1100	1/4 / 1100	1 / Multiple Speeds ^b	1/4 / 1100
Fan Diameter (in.)	22	22	30	22
FILTERS				
RA Filter Qty / Size (in.)	4 / 20 x 20 x 2	4 / 20 x 20 x 2	4 / 20 x 20 x 2	6 / 18 x 24 x 2
OA Inlet Screen Qty / Size (in.)	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	Vertical: 2 / 24 x 27 x 1 Horizontal: 1 / 30 x 39 x 1

NOTE(S):

a. Base unit operating weight does not include weight of options.

b. 1050/770/450/350/265 rpm

LEGEND

bhp — Brake Horsepower
FPI — Fins Per Inch
OA — Outdoor Air
RA — Return Air

Options and accessories

ITEM	FACTORY- INSTALLED OPTION	FIELD- INSTALLED ACCESSORY
ELECTRIC HEAT		
Electric Resistance Heaters		X
Single Point Kits		X
CABINET		
Thru-the-Base Electrical Connections		X
Hinged Access Panels	X	
4 in. Filter Rack (filters not included)		X
Louvered Hail Guard	X	X
Disconnect Switch Bracket ^a		X
Supply Duct Cover ^a		X
COIL OPTIONS		
Cu/Cu Indoor and/or Outdoor Coils	X	
Pre-Coated Outdoor Coils	X	
Premium, E-Coated Indoor and/or Outdoor Coils	X	
CONTROLS		
Thermostats, Temperature Sensors, and Subbases		X
Smoke Detector (supply and/or return air)	X	X
Horn Strobe Annunciator ^b		X
Time Guard II Compressor Delay Control Circuit		X
Phase Monitor		X
ECONOMIZERS AND OUTDOOR AIR DAMPERS		
EconomizerONE for Electromechanical Controls, complies with FDD (Low and Ultra Low Leak damper models) ^c	X	X
Wi-Fi Stick for EconomizerONE (optional)		X
Motorized Two-Position Outdoor-Air Damper		X
Manual Outdoor-Air Damper (25% and 50%)		X
Barometric Relief ^d	X	X
Power Exhaust — Prop Design		X
Condensate Overflow Switch	X	X

ITEM	FACTORY- INSTALLED OPTION	FIELD- INSTALLED ACCESSORY
ECONOMIZER SENSORS AND IAQ DEVICES		
Single Dry Bulb Temperature Sensors ^e	X	X
Differential Dry Bulb Temperature Sensors ^e		X
Single Enthalpy Sensors ^e	X	X
Differential Enthalpy Sensors ^e		X
CO ₂ Sensor (wall, duct, or unit mounted) ^e	X	X
INDOOR MOTOR AND DRIVE		
Multiple Motor and Drive Packages	X	
Fan Filter Status Switch	X	X
LOW AMBIENT CONTROLS		
Winter Start Kit ^{f,g}		X
Low Ambient Controller to 0°F (-18°C) ^f		X
POWER OPTIONS		
Convenience Outlet (powered)	X	
Convenience Outlet (unpowered)	X	
Convenience Outlet, 20 amp (unpowered)		X
Non-fused Disconnect ^h	X	
High SCCR Protection ⁱ	X	
ROOF CURBS		
Roof Curb 14 in. (356 mm)		X
Roof Curb 24 in. (610 mm)		X

NOTE(S):

- For Size 150 units only.
- Requires a field-supplied 24-v transformer for each application.
- FDD (Fault Detection and Diagnostic) capability per California Title 24 section 120.2.
- Included with economizer.
- Sensors used to optimize economizer performance.
- See application data for assistance.
- Size 120 models operate down to 0°F (-18°C) standard; Low Ambient control is not available.
- Non-fused disconnect switch cannot be used when unit FLA electrical rating exceeds:
 - Sizes 090-120: 80 amps, all voltages.
 - Size 150: 200 amps, 208/230V-3-60
 - Size 150: 100 amps, 460/575V-3-60
- High SCCR (Short Circuit Current Rating) is not available on the following: units with low ambient controls, powered convenience outlet, phase loss monitor, non-fused disconnect, or 575-v. Not available on size 120 units due to control box constraints.

Options and accessories (cont)

Factory-installed options

Economizer (dry-bulb or enthalpy)

Economizers save money. They bring in fresh, outside air for ventilation; and provide cool, outside air to cool your building. This is the preferred method of low-ambient cooling. When coupled to CO₂ sensors, economizers can provide even more savings by coupling the ventilation air to only that amount required.

Economizers are available, installed and tested by the factory, with either enthalpy or dry-bulb temperature inputs. Additional sensors are available as accessories to optimize the economizers. Economizers include a barometric relief system to help equalize building pressures.

Economizers can be factory-installed or easily field-installed.

Unit mounted CO₂ sensor

The CO₂ sensor works with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO₂ sensor detects their presence through increasing CO₂ levels, and opens the economizer appropriately. When the occupants leave, the CO₂ levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called demand controlled ventilation (DCV), reduces the overall load on the rooftop, saving money. It is also available as a field-installed accessory.

Smoke detector (supply and/or return air)

Smoke detectors make your application safer and your job easier. Our smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory, for supply air, return air, or both.

Filter maintenance indicator

When the optional factory-installed filter maintenance indicator is used, a factory-installed differential pressure switch measures pressure drop across the outside air filter and activates a field-supplied dry contact indicator when the pressure differential exceeds the adjustable switch setpoint.

Hinged access panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are filter, control box access, and indoor fan motor access.

Cu/Cu (outdoor and indoor) coils

Copper fins and copper tubes are mechanically bonded to copper tubes and copper tube sheets. A polymer strip prevents coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.

E-coated (outdoor and indoor) coils

A flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.

Pre-coated outdoor coils

A durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments. The coating minimizes galvanic action between dissimilar metals. Coating is applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.

Condenser coil hail guard

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact. This can be purchased as a factory-installed option or as a field-installed accessory.

Convenience outlet (powered or un-powered)

Reduce service and/or installation costs by including a convenience outlet in your specification. We will install this service feature at our factory. Provides a convenient, 15 amp, 115v GFCI receptacle with "Wet in Use" cover. The "powered" option allows the installer to power the outlet from the line side of the disconnect or load side as required by code. The "unpowered" option is to be powered from a separate 115/120v power source.

The unpowered convenience outlet is available as a 15 amp factory-installed option or a 20 amp field-installed accessory.

Non-fused disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop. When selecting a factory-installed non-fused disconnect, note they are sized for the unit as ordered from the factory. The sizing of these do not accommodate field-installed items such as power exhaust devices, etc. If field installing electric heat with factory-installed non-fused disconnect switch, a single point kit may or may not be required.

Condensate overflow switch

This sensor and related controller monitors the condensate level in the drain pan and shuts down compression operation when overflow conditions occur. It includes:

- Indicator light — solid red (more than 10 seconds on water contact — compressors disabled), blinking red (sensor disconnected)
- 10-second delay to break — eliminates nuisance trips from splashing or waves in pan (sensor needs 10 seconds of constant water contact before tripping)
- Disables the compressors operation when condensate plug is detected, but still allows fans to run for economizer.

High Short Circuit Current Rating (SCCR) protection

This factory-installed option provides high short circuit current protection of 10 kA against high potential fault current situations for the compressors and all indoor and outdoor fan motors. (A standard unit comes with a 5 kA rating.)

This option is not available on 575-v models or models with a factory-installed low ambient controls, powered convenience outlet, phase loss monitor, or non-fused disconnect. High SCCR is not available on size 120 units due to control box constraints.

Options and accessories (cont)

Field-installed accessories

Condenser coil hail guard

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact. This can be purchased as a factory-installed option or as a field-installed accessory.

Thru-the-base connections

Field-installed thru-the-base connections are necessary to ensure proper connection and seal when routing wire and piping through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for gas lines, main power lines, as well as control power.

Differential enthalpy sensor

The differential enthalpy sensor is comprised of an outdoor and return air enthalpy sensors to provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.

Wall or duct mounted CO₂ sensor

The IAQ sensor shall be available in duct or wall mount. The sensor provides demand ventilation indoor air quality (IAQ) control.

4 in. filter rack kit

The 4 in. filter rack accessory kit is designed to hold 4 in. MERV-8 or MERV-13 filters. Filters not included in kit.

Phase monitor protection

The Phase Monitor Control will monitor the sequence of 3 phase electrical system to provide a phase reversal protection; and monitor the 3 phase voltage inputs to provide a phase loss protection for the 3 phase device. It will work on either a Delta or Wye power connection.

Winter start kit

The winter start kit extends the low ambient limit of your rooftop to 25°F (−4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

Low ambient controller

The low ambient controller is a head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling when economizer usage is either not appropriate or desired. The low ambient controller will either cycle the outdoor fan motors or operate them at reduced speed to maintain the unit operation, depending on the model. This controller allows cooling operation down to 0°F (−18°C) ambient conditions.

NOTE: 0°F (−18°C) is standard on size 120 models.

Roof curb (14 in./356 mm or 24 in./610 mm)

Full perimeter roof curb with exhaust capability provides separate air streams.

Filter status indicator accessory

Monitors static pressure across supply and exhaust filters and provides indication when filters become clogged.

Power exhaust

Superior internal building pressure control. This field-installed accessory may eliminate the need for costly, external pressure control fans.

Manual OA damper

Manual outdoor air dampers are an economical way to bring in ventilation air. The dampers are available in 25% and 50% versions.

Motorized Two-Position damper

The two-position, motorized outdoor air damper admits outside air. Using reliable, gear-driven technology, the two-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

Electric heaters

We offer a full-line of field-installed accessory heaters. The heaters are very easy to use, install and are all pre-engineered and certified.

Time Guard II control circuit

This accessory protects your compressor by preventing short-cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping. Not required with authorized commercial thermostats.

Disconnect switch bracket

Provides a pre-engineered and sized mounting bracket for applications requiring a unit mounted fused and non-fused disconnect of greater than 100 amps. Bracket assures that no damage will occur to coils when mounting with screws and other fasteners (150 size only).

Wi-Fi Stick for EconomizerONE (optional)

The accessory Wi-Fi/WLAN stick can be connected to the EconomizerONE POL224 economizer controller via the USB host interface. The Wi-Fi stick enables a wireless connection to be made between a smartphone and the economizer controller via the Climatix™¹ mobile application for commissioning, troubleshooting, and maintenance operations. The Wi-Fi stick is required to utilize the mobile application but is not required for EconomizerONE setup and commissioning.

1. Third-party trademarks and logos are the property of their respective owners.

Options and accessories (cont)

Climatix™ mobile application

The Climatix™ mobile application offers a best-in-class user interface and a simple step-by-step commissioning workflow using a mobile device. The user interface walks users through the setup of the controller and allows users to view the operating mode and parameters. Users can adjust setpoints, initiate damper tests, and save the final configuration as a favorite to expedite setup in the future.

The application is available on Android™¹ and Apple iOS®¹ platforms. The Wi-Fi stick for the EconomizerONE is required to join the Siemens-WiFi-Stick network and setup the controller on a smartphone.

NOTE: The Climatix app is not required to commission the EconomizerONE controller. The unit can be set up using the controller's on board button system.

Options and Accessory Weights^a

OPTION / ACCESSORY NAME	RHF UNIT WEIGHT							
	090		102		120		150	
	lb	kg	lb	kg	lb	kg	lb	kg
Power Exhaust — Vertical	55	25	55	25	55	25	55	25
EconomizerONE	75	34	75	34	75	34	75	34
Two-Position Damper	58	26	58	26	58	26	65	29
Manual Damper	18	8	18	8	18	8	25	11
Hail Guard (louvered)	17	8	17	8	17	8	17	8
Cu/Cu Condenser Coil	85	39	85	39	100	46	150	68
Cu/Cu Evaporator Coil	50	23	100	46	100	46	100	46
Roof Curb (14 in. curb)	143	65	143	65	143	65	180	82
Roof Curb (24 in. curb)	245	112	245	112	245	112	255	116
CO ₂ Sensor	2	1	2	1	2	1	2	1
Optional Indoor Motor ^b	30	14	30	14	30	14	0	0
Low Ambient Controller	9	4	9	4	—	—	9	4
Winter Start Kit	5	2	5	2	5	2	5	2
Return Air Smoke Detector	7	3	7	3	7	3	7	3
Supply Air Smoke Detector	7	3	7	3	7	3	7	3
Fan Filter Switch	2	1	2	1	2	1	2	1
Non-Fused Disconnect	15	7	15	7	15	7	15	7
Powered Convenience Outlet	36	16	36	16	36	16	36	16
Unpowered Convenience Outlet	4	2	4	2	4	2	4	2
Enthalpy Sensor	2	1	2	1	2	1	2	1
Differential Enthalpy Sensor	3	1	3	1	3	1	3	1

NOTE(S):

a. Where multiple variations are available, the heaviest combination is listed.

b. Add the Optional Indoor Motor weight to the weight of the base unit.

RHF090-102 Base Unit Dimensions

NOTES:

1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW
4.  ALL VIEW DRAWN USING 3RD ANGLE

UNIT	OUTDOOR COIL TYPE	J	K	H
RHF-090	RTPF	49 3/8 [1253]	36 3/8 [925]	15 7/8 [403]
RHF-102	RTPF	49 3/8 [1253]	36 3/8 [925]	15 7/8 [403]

RTPF - ROUND TUBE, PLATE FIN (COPPER/ALUM)



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" [35] DIA FIELD POWER SUPPLY HOLE
B	2 1/2" [64] DIA POWER SUPPLY KNOCKOUT
C	1 3/4" [51] DIA GAUGE ACCESS PLUG
D	7/8" [22] DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
G	2" [51] DIA POWER SUPPLY KNOCK-OUT


THRU-THE-BASE CHART (FIELD INST)

THESE HOLES REQUIRED FOR USE WITH ACCY KITS: CRBTMPWR002A01


	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
W	1/2"	ACC.	7/8" [22.2]
X	1/2"	24V	7/8" [22.2]
Y	1 1/4" (#002)	POWER	1 3/4" [44.4]

THRU-THE-BASE CHART (FIOP)


FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR ONLY X & Y ARE PROVIDED: (1) 1/2" & (1) 1 1/4" ELECTRICAL FITTINGS.

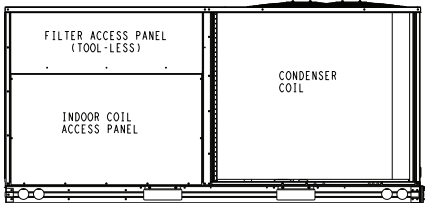


BACK

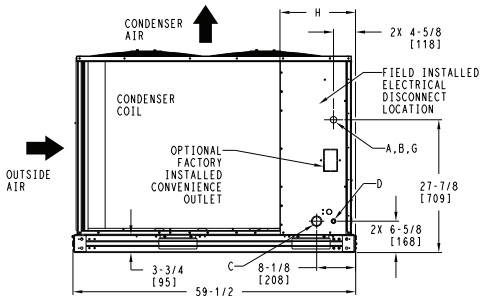


LEFT

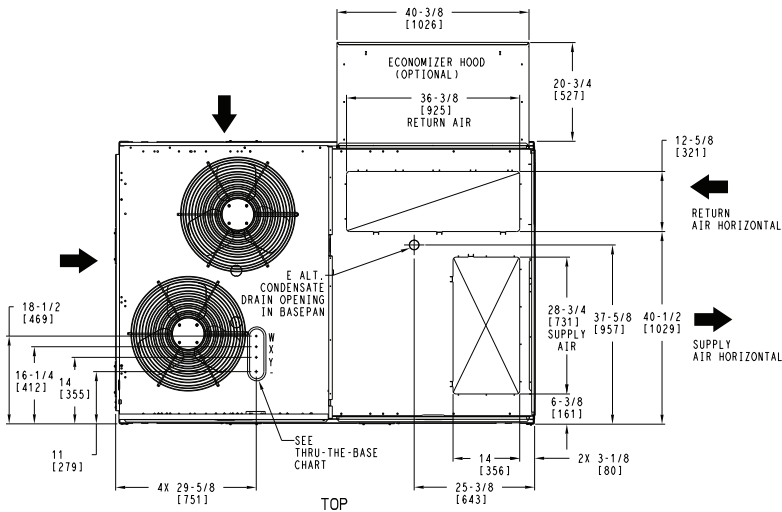

TOP

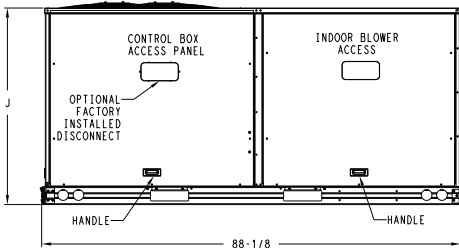

FRONT

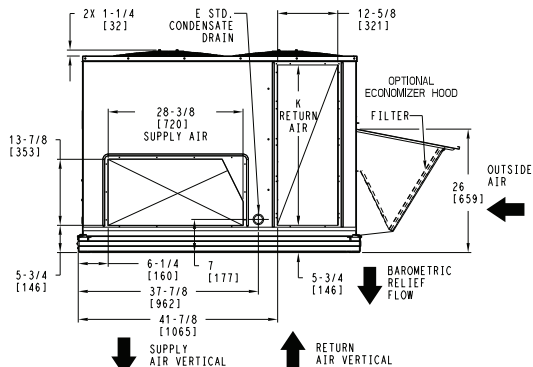



RIGHT

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHF 090,102 SINGLE ZONE ELECTRICAL HEAT PUMP	48TM009328	REV
U.S. ECCN:NSR	1 OF 3	2/21/24	8/2/23			A

RHF090-102 Base Unit Dimensions (cont)

UNIT	OUTDOOR COIL TYPE	STD. UNIT WEIGHT ***		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
		LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
RHF-090	RTPF	805	365	205	93	167	76	194	88	239	108	39 1/2 [1003]	32 [813]	19 1/8 [486]
RHF-102	RTPF	867	393	153	69	196	89	228	103	178	81	38 [965]	34 1/2 [876]	19 1/8 [486]
RTPF - ROUND TUBE, PLATE FIN (COPPER/ALUM)														

*** STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING.
FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

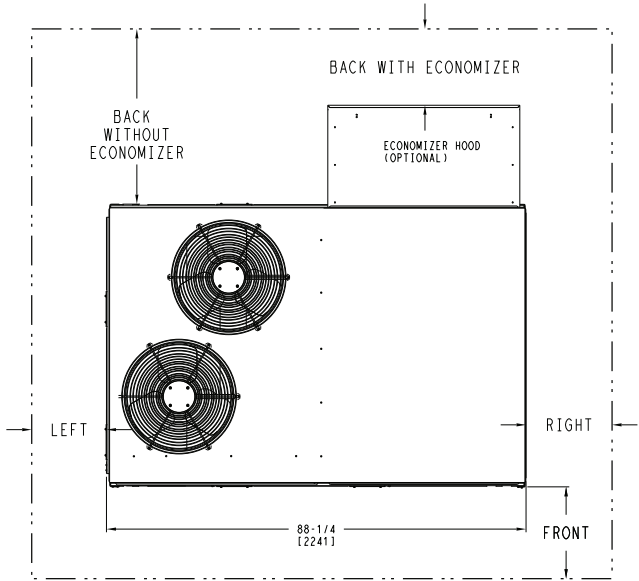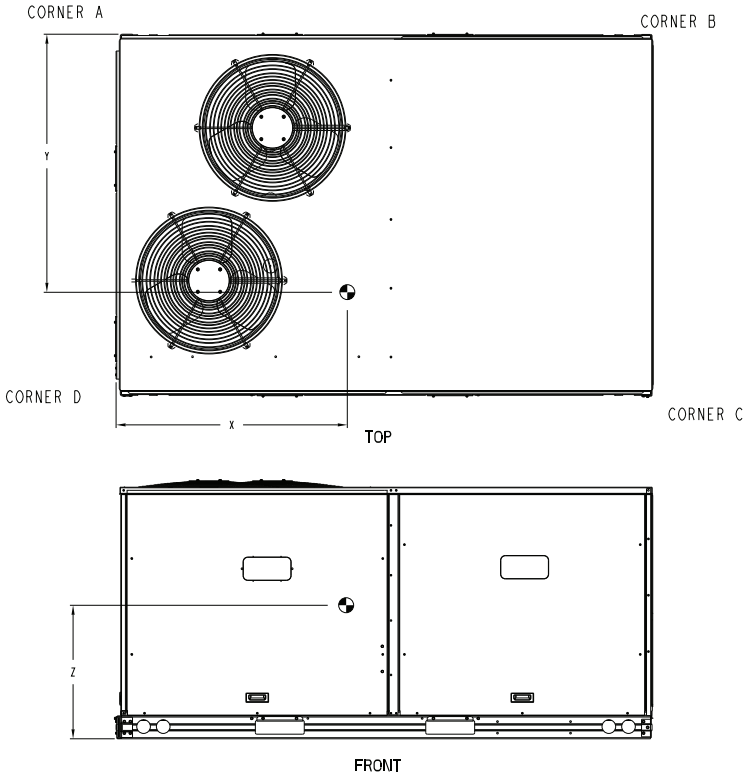


NOTE:
1. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.

SURFACE	CLEARANCE	
	SERVICE WITH: CONDUCTIVE BARRIER	SERVICE WITH: NONCONDUCTIVE BARRIER
FRONT	48 [1219mm]	36 [914mm]
LEFT	48 [1219mm]	42 [1067mm]
BACK W/O ECON	48 [1219mm]	42 [1067mm]
BACK W/ECON	36 [914mm]	36 [914mm]
RIGHT	36 [914mm]	36 [914mm]
TOP	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 2 OF 3	DATE 2/21/24	SUPERCEDES 8/2/23	RHF 090,102 SINGLE ZONE ELECTRICAL HEAT PUMP	48TM009328	REV A
-------------------------------------	-----------------	-----------------	----------------------	---	------------	----------

RHF090-102 Base Unit Dimensions (cont)

ICP THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

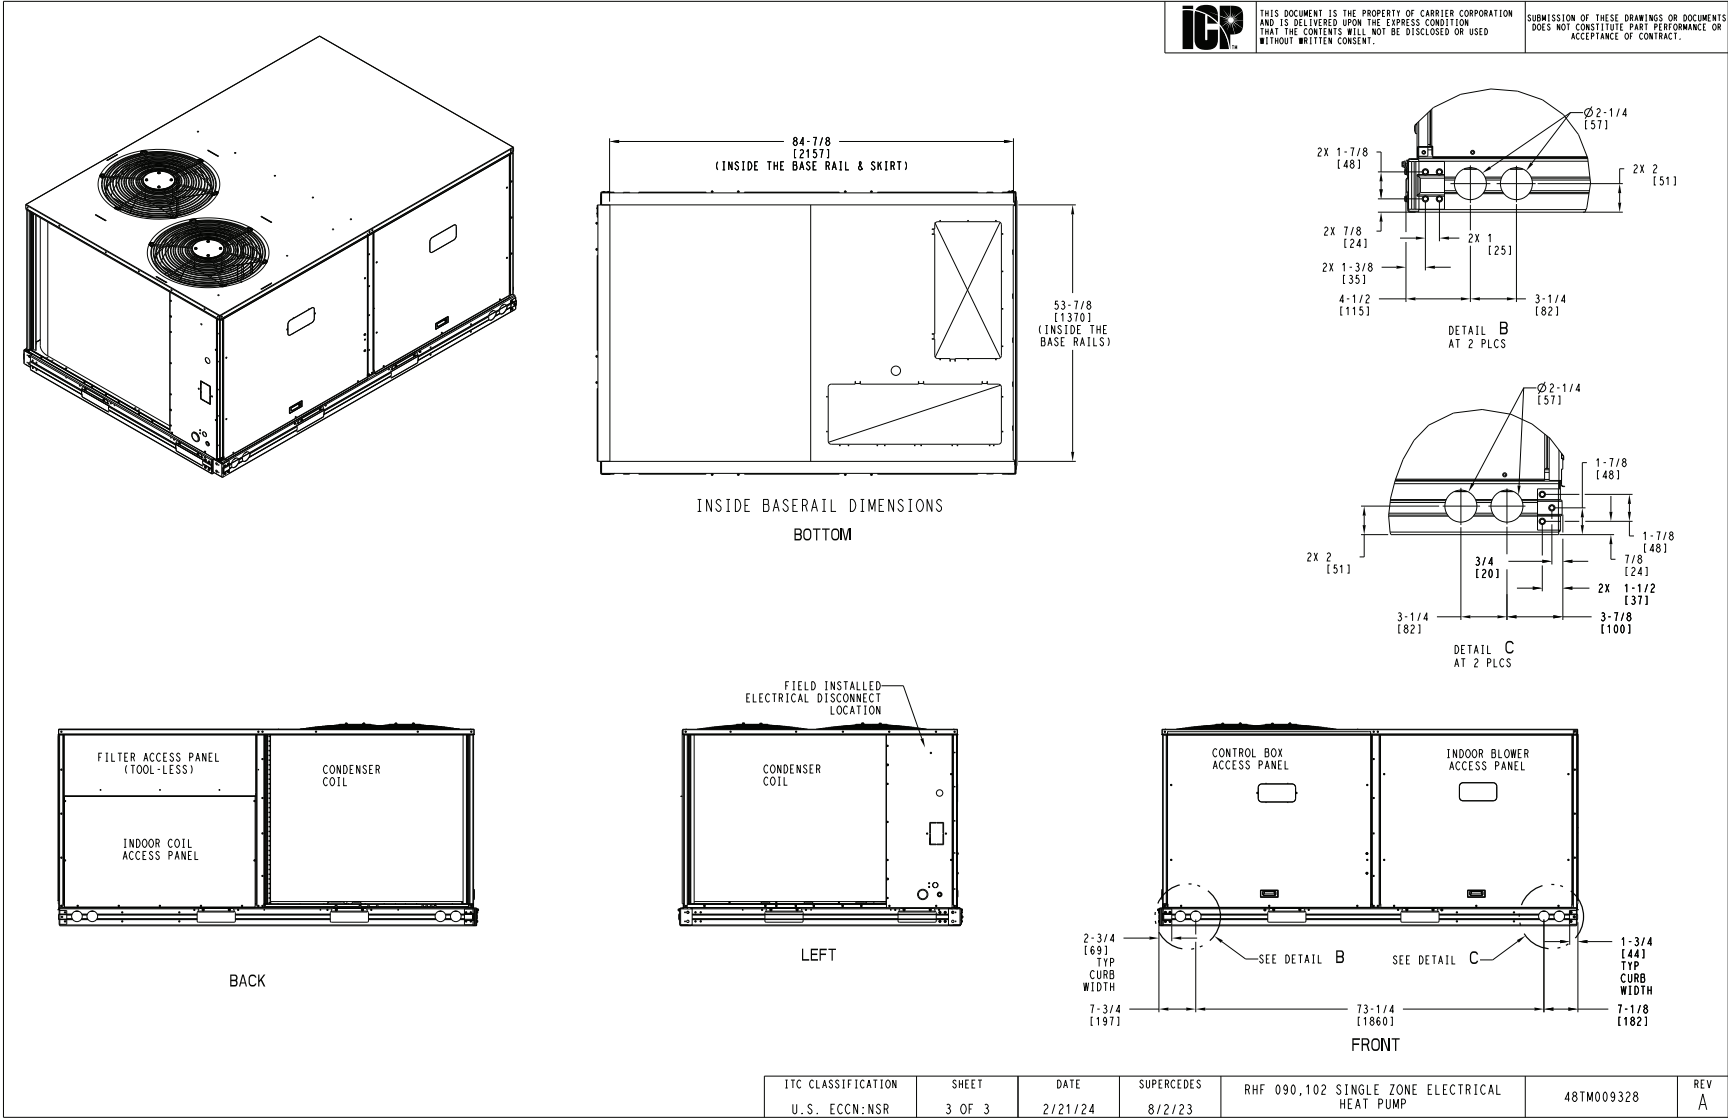


ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHF 090,102 SINGLE ZONE ELECTRICAL HEAT PUMP	48TM009328	REV
U.S. ECCN:NSR	3 OF 3	2/21/24	8/2/23			A

RHF120 Base Unit Dimensions


NOTES:

1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW
4.  ALL VIEW DRAWN USING 3RD ANGLE


UNIT	OUTDOOR COIL TYPE	H
RHF-120	RTPF	15 7/8 [403]
RTPF - ROUND TUBE, PLATE FIN (COPPER/ALUM)		

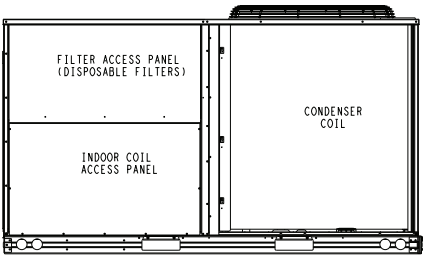


BACK

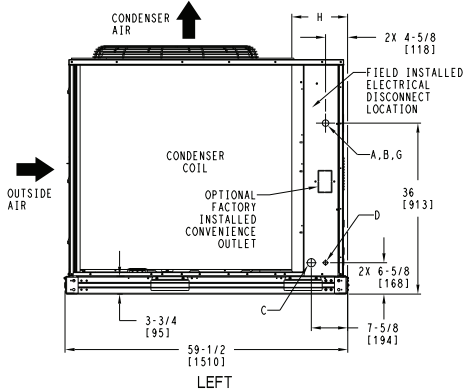

LEFT

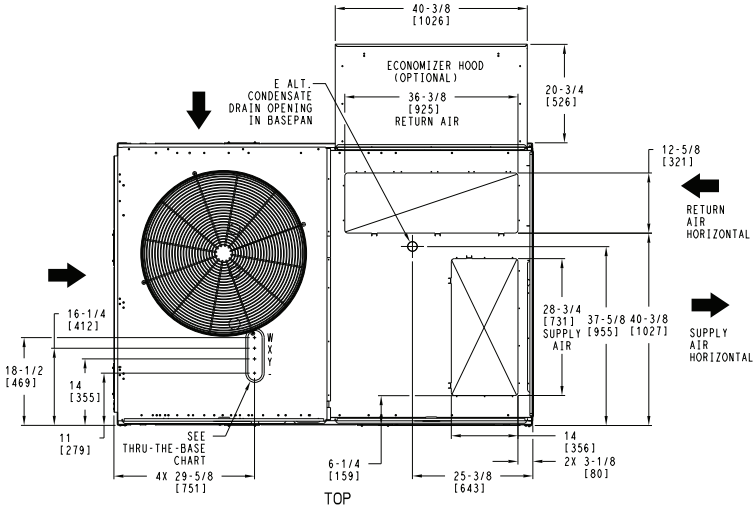

TOP

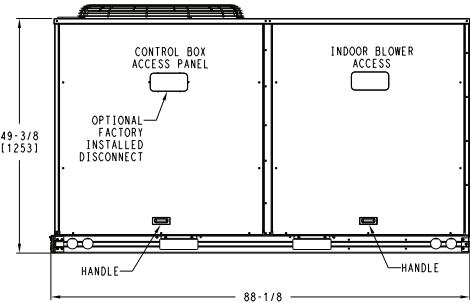

FRONT




THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" [35] DIA FIELD POWER SUPPLY HOLE
B	2 1/2" [64] DIA POWER SUPPLY KNOCKOUT
C	1 3/4" [51] DIA GAUGE ACCESS PLUG
D	7/8" [22] DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
G	2" [51] DIA POWER SUPPLY KNOCK-OUT

THRU-THE-BASE CHART THESE HOLES REQUIRED FOR USE CRBTMPWRO2A01			
	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
W	1/2"	ACC.	7/8" [22.2]
X	1/2"	24V	7/8" [22.2]
Y	1 1/4" [002]	POWER	1 3/4" [44.4]
FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR ONLY X & Y ARE PROVIDED			

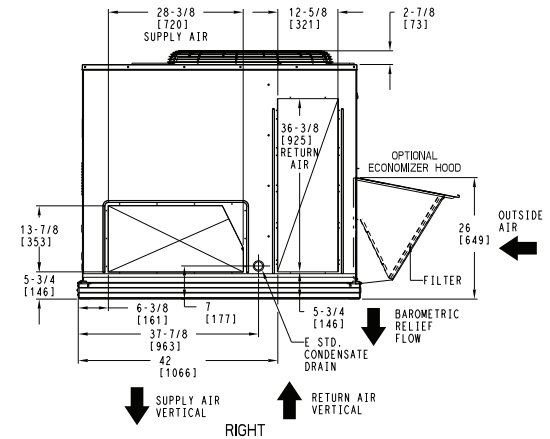


RIGHT

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHF 120 SINGLE ZONE ELECTRICAL HEAT PUMP	48TM009812	REV
U.S. ECCN:NSR	1 OF 3	02/20/24	-			-

RHF120 Base Unit Dimensions (cont)

UNIT	OUTDOOR COIL TYPE	STD. UNIT WEIGHT***		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
		LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
RHF-120	RTPF	955	433	239	108	194	88	234	106	288	131	39 1/2 [1003]	32 1/2 [826]	19 1/8 [486]
RTPF - ROUND TUBE, PLATE FIN (COPPER/ALUM)														


*** STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING.
FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

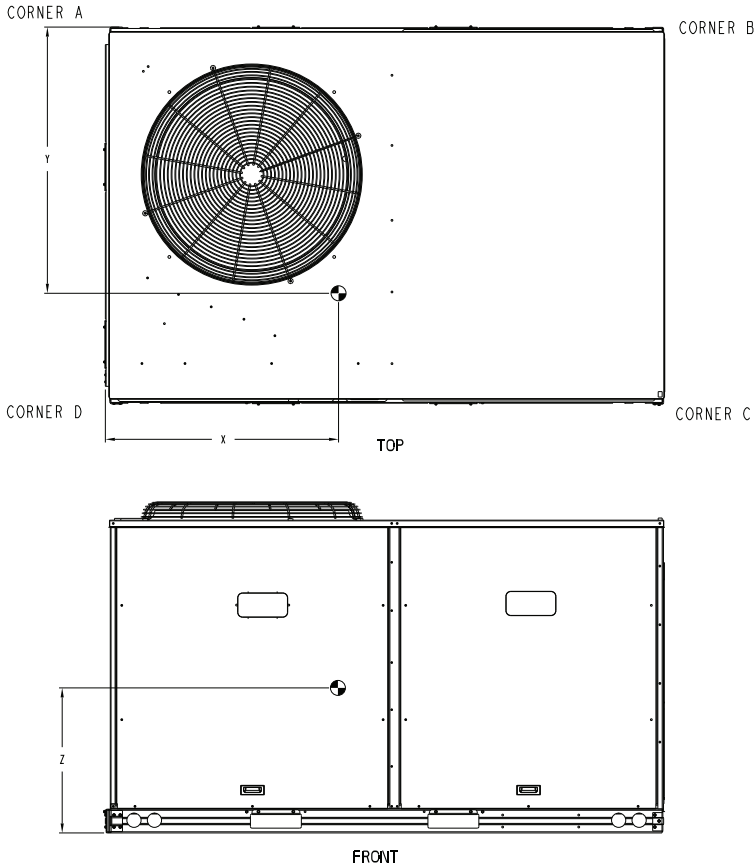

ICP

THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION
AND IS DELIVERED UPON THE EXPRESS CONDITION
THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED
WITHOUT WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS
DOES NOT CONSTITUTE PART PERFORMANCE OR
ACCEPTANCE OF CONTRACT.

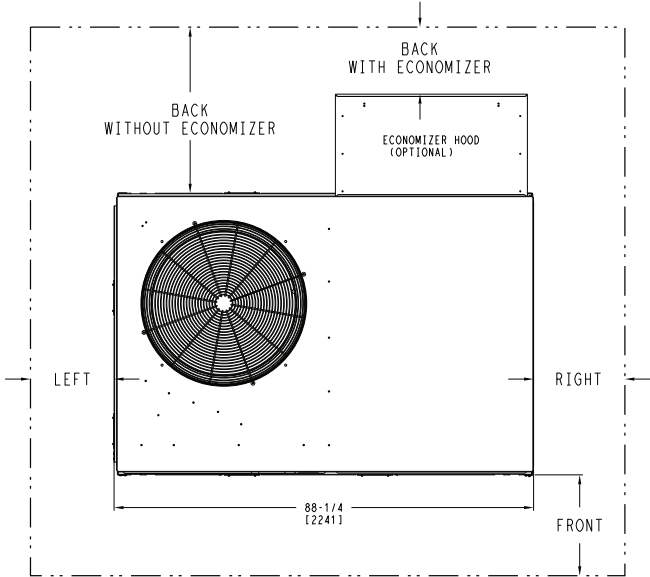


NOTE:
1. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.

SURFACE	CLEARANCE	
	SERVICE WITH: CONDUCTIVE BARRIER	SERVICE WITH: NONCONDUCTIVE BARRIER
FRONT	48 [1219mm]	36 [914mm]
LEFT	48 [1219mm]	42 [1067mm]
BACK W/O ECON	48 [1219mm]	42 [1067mm]
BACK W/ECON	36 [914mm]	36 [914mm]
RIGHT	36 [914mm]	36 [914mm]
TOP	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 2 OF 3	DATE 02/20/24	SUPERCEDES -	RHF 120 SINGLE ZONE ELECTRICAL HEAT PUMP	48TM009812	REV -
-------------------------------------	-----------------	------------------	-----------------	---	------------	----------

RHF120 Base Unit Dimensions (cont)

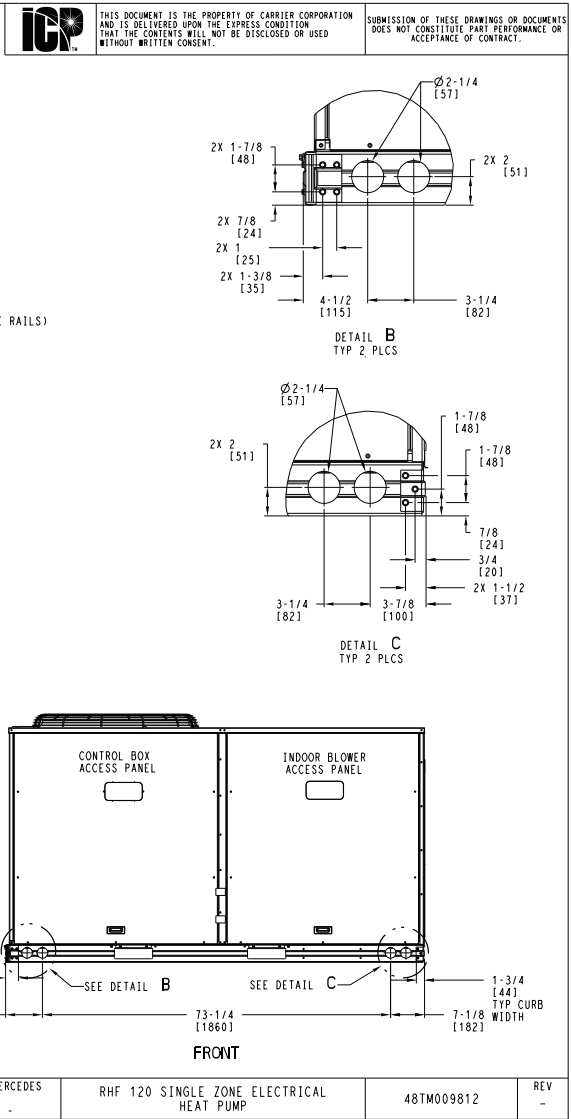

RHF150 Base Unit Dimensions

NOTES:

1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW








THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
B	2 1/2" [64] DIA POWER SUPPLY HOLE
D	7/8" [22] DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
F	7/8" [22] DIA FIELD CONVENIENCE OUTLET HOLE

THRU-THE-BASE CHART THESE HOLES REQUIRED FOR USE CRBTMPW005A00, 006A00, 007A00				
ACCESSORY NO.	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)	
005	W 1/2"	ACC.	7/8" [22.2]	
	X 1/2"	24V	7/8" [22.2]	
	Y 1 1/4"	POWER	1 1/2" [38.1]	
006	W 1/2"	ACC.	7/8" [22.2]	
	X 1/2"	24V	7/8" [22.2]	
	Y 1 1/2"	POWER	2" [50.8]	
007	W 1/2"	ACC.	7/8" [22.2]	
	X 1/2"	24V	7/8" [22.2]	
	Y 2"	POWER	2 1/2" [63.5]	
FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR X & Y ARE PROVIDED AS SPECIFIED ON "006".				

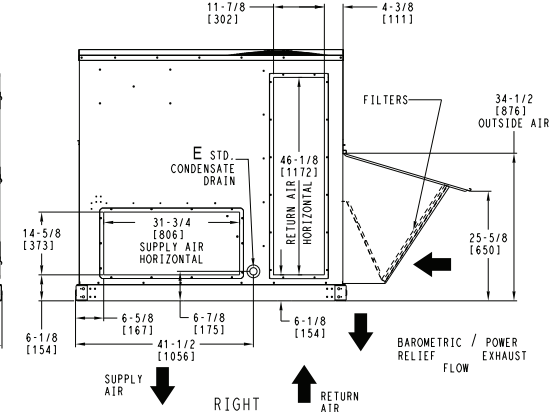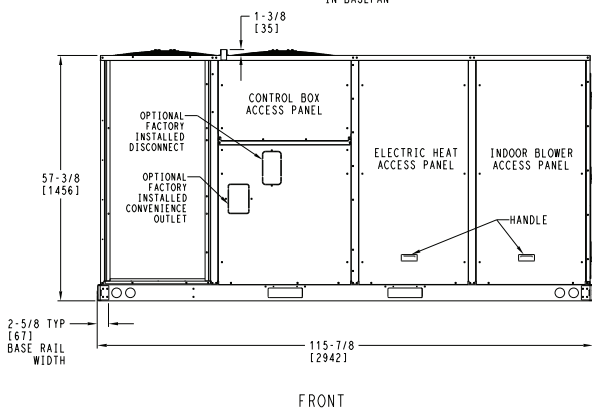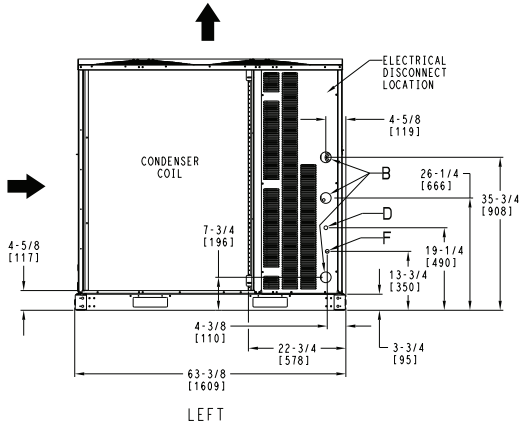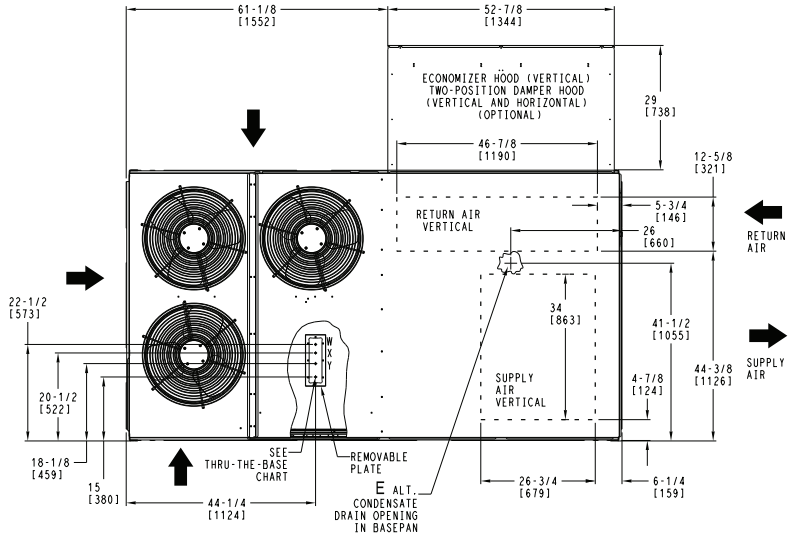
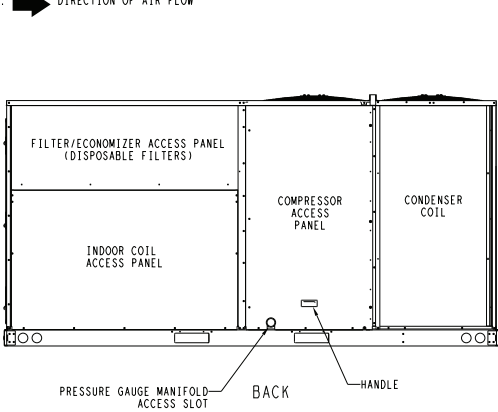


ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHF 150 SINGLE ZONE ELECTRICAL HEAT PUMP	50TM003170	REV
U.S. ECCN: NSR	1 OF 2	8/10/23	-			-

RHF150 Base Unit Dimensions (cont)

UNIT	STD UNIT WEIGHT		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
RHF-150	1250	567	350	159	338	153	277	125	286	130	57 [1448]	28 1/2 [724]	24 [610]



STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT & WITHOUT PACKAGING.
FOR OPTIONS & ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

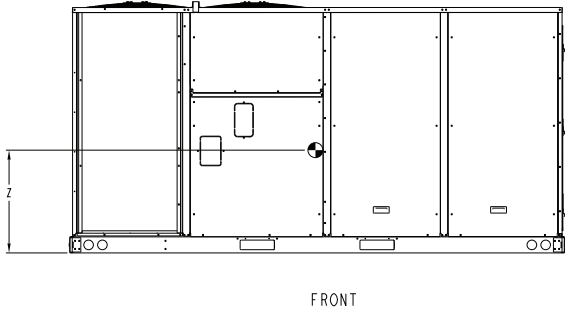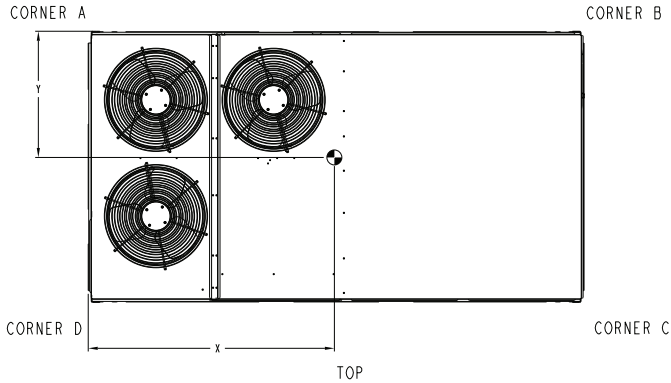



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

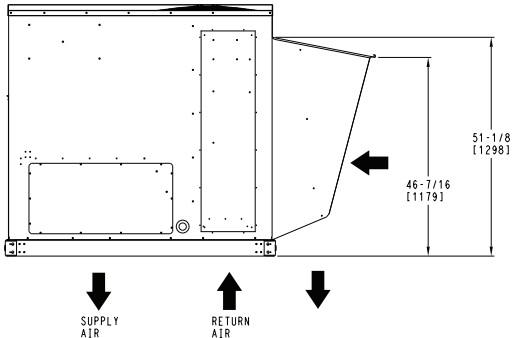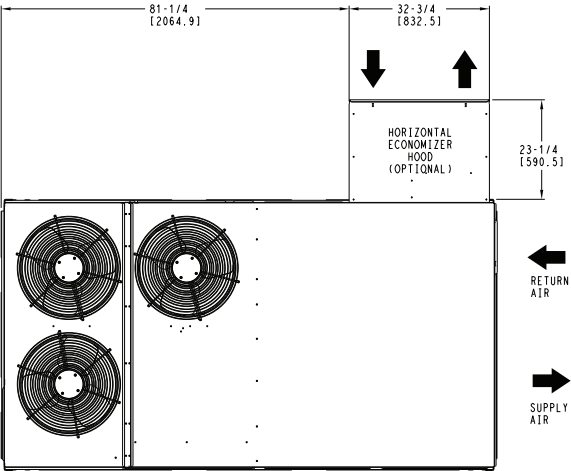


HORIZONTAL ECONOMIZER

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHF 150 SINGLE ZONE ELECTRICAL HEAT PUMP	50TM003170	REV
U.S. ECCN: NSR	2 OF 2	8/10/23	-			-

Base unit dimensions (cont)

RHF150 Base Unit Dimensions — Clearances

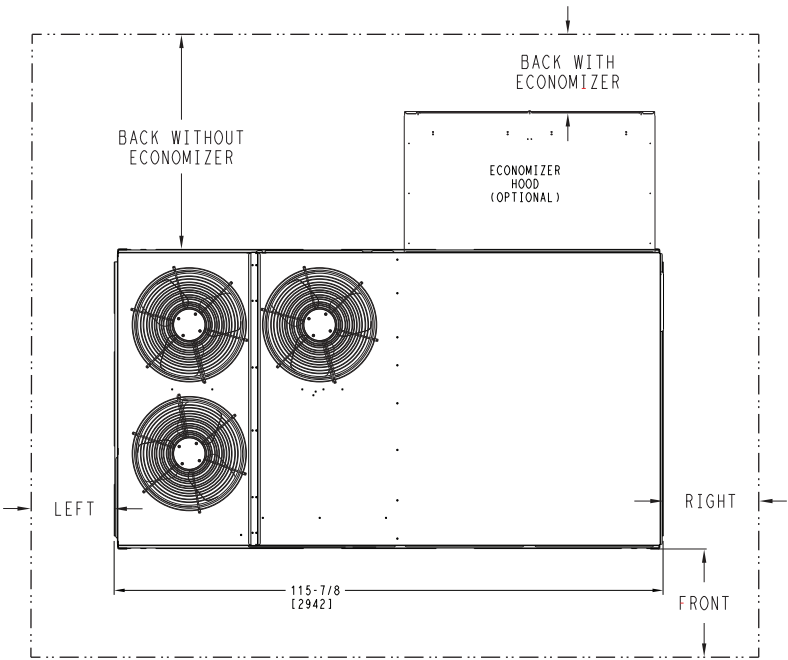

CLEARANCE ^{a,b}			
SURFACE	Service with Conductive Barrier	Service with Non-conductive Barrier	Operating Clearance
FRONT	48 in. (1219 mm)	36 in. (914 mm)	18 in. (457 mm)
LEFT	48 in. (1219 mm)	42 in. (1067 mm)	18 in. (457 mm)
BACK WITHOUT ECONOMIZER	48 in. (1219 mm)	42 in. (1067 mm)	18 in. (457 mm)
BACK WITH ECONOMIZER	36 in. (914 mm)	36 in. (914 mm)	18 in. (457 mm)
RIGHT	36 in. (914 mm)	36 in. (914 mm)	18 in. (457 mm)
LEFT	72 in. (1829 mm)	72 in. (1829 mm)	72 in. (1829 mm)



NOTE(S):
a. For all minimum clearances local codes or jurisdictions may prevail.
b. See page 12 for RHF090-102 clearances. See page 15 for RHF120 clearances.

Roof Curb Dimensions — RHF090-120



ROOF CURB ACCESSORY #	A
CRRFCURB003A01	14" [356]
CRRFCURB004A01	24" [610]

- NOTES:
1. ROOFCURB ACCESSORY IS SHIPPED DISASSEMBLED.
2. INSULATED PANELS: 25.4 [1"] THK. POLYURETHANE FOAM, 44.5 [1-3/4"] # DENSITY.
3. DIMENSIONS IN () ARE IN MILLIMETERS.
4. ROOFCURB: 18 GAGE STEEL.
5. ATTACH DUCTWORK TO CURB. (FLANGES OF DUCT REST ON CURB).
6. SERVICE CLEARANCE 4 FEET ON EACH SIDE.
7. DIRECTION OF AIR FLOW.
8. CONNECTOR PACKAGE CRBTMPWR002A01 IS FOR THRU-THE-CURB GAS TYPE PACKAGE CRBTMPWR004A01 IS FOR THRU-THE-BOTTOM TYPE GAS CONNECTIONS.


CONNECTOR PKG. ACC.	GAS CONNECTION TYPE	GAS FITTING	POWER WIRING FITTING	CONTROL WIRING FITTING	ACCESSORY CONVENIENCE OUTLET WIRING CONNECTOR
CRBTMPWR002A01	THRU THE CURB	3/4" [19] NPT	1 1/4" [31.7] NPT	1/2" [12.7] NPT	1/2" [12.7] NPT
CRBTMPWR004A01	THRU THE BOTTOM				

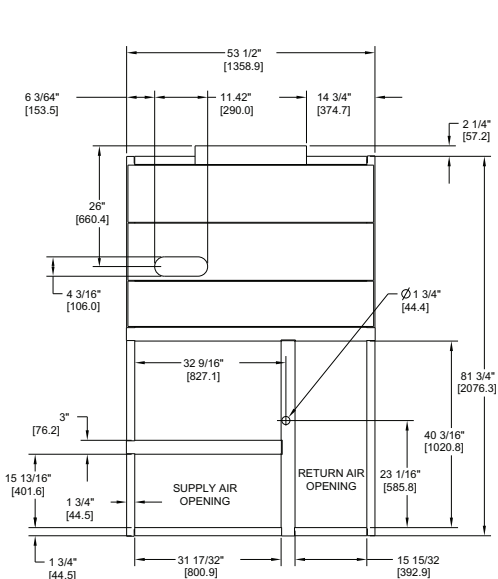

VIEW "B" CORNER DETAIL

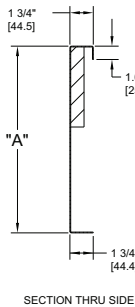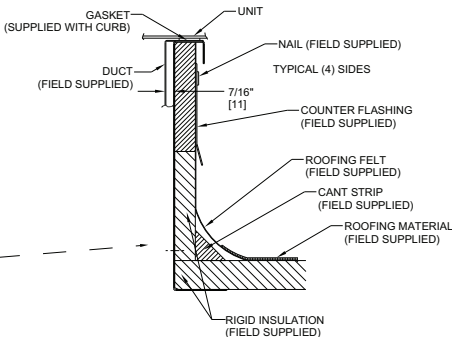

SECTION THRU SIDE

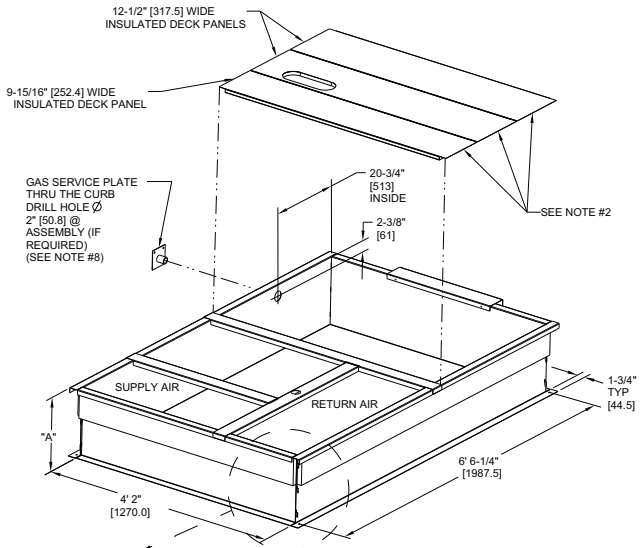


SEE VIEW "B"

CERTIFIED DRAWING

C	6' 61/4" WAS 6' 7 1/6", 4' 2" WAS 4' 2 13/16"; 18 GA WAS 16 GA.; 15 13/16" WAS 15 15/16"; NAIL FIELD SUPPLIED WAS WITH CURB	4/22/13	MMC	-	-	1067898
REV	REVISION RECORD	DATE	BY	CHKD	APPD	ECN NO.
DRAWING RELEASE LEVEL: PRODUCTION						
THIRD ANGLE PROJECTION		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ON:		THIS DOCUMENT AND THE INFORMATION CONTAINED THEREIN IS PROPRIETARY TO CARRIER CORPORATION AND SHALL NOT BE USED OR DISCLOSED TO OTHERS, IN WHOLE OR IN PART, WITHOUT THE WRITTEN AUTHORIZATION OF CARRIER CORPORATION.		
MATERIAL		1 DEC ± 1/16" 2 DEC ± 1/32" 3 DEC ± 1/64" ANG ± 1/2°		AUTHORIZATION NUMBER 1029120		
ENGINEERING REQUIREMENTS		T-005, Y-002		ENGINEERING MANUFACTURING		
WEIGHT: -		DRAFTER MMC 12/16/09		CHECKER		
SURFACE FINISH -		MFG/PURCH PURCH		MODEL (INTERNAL USE ONLY)		
TITLE		CURB ASY, ROOF		SIZE D		
DRAWING NUMBER		50HJ405012		SHEET 5 OF 5		
NEXT DRAWING		SCALE N/A		DISTRIBUTION		
REV		C		REV		

Roof Curb Dimensions — RHF150

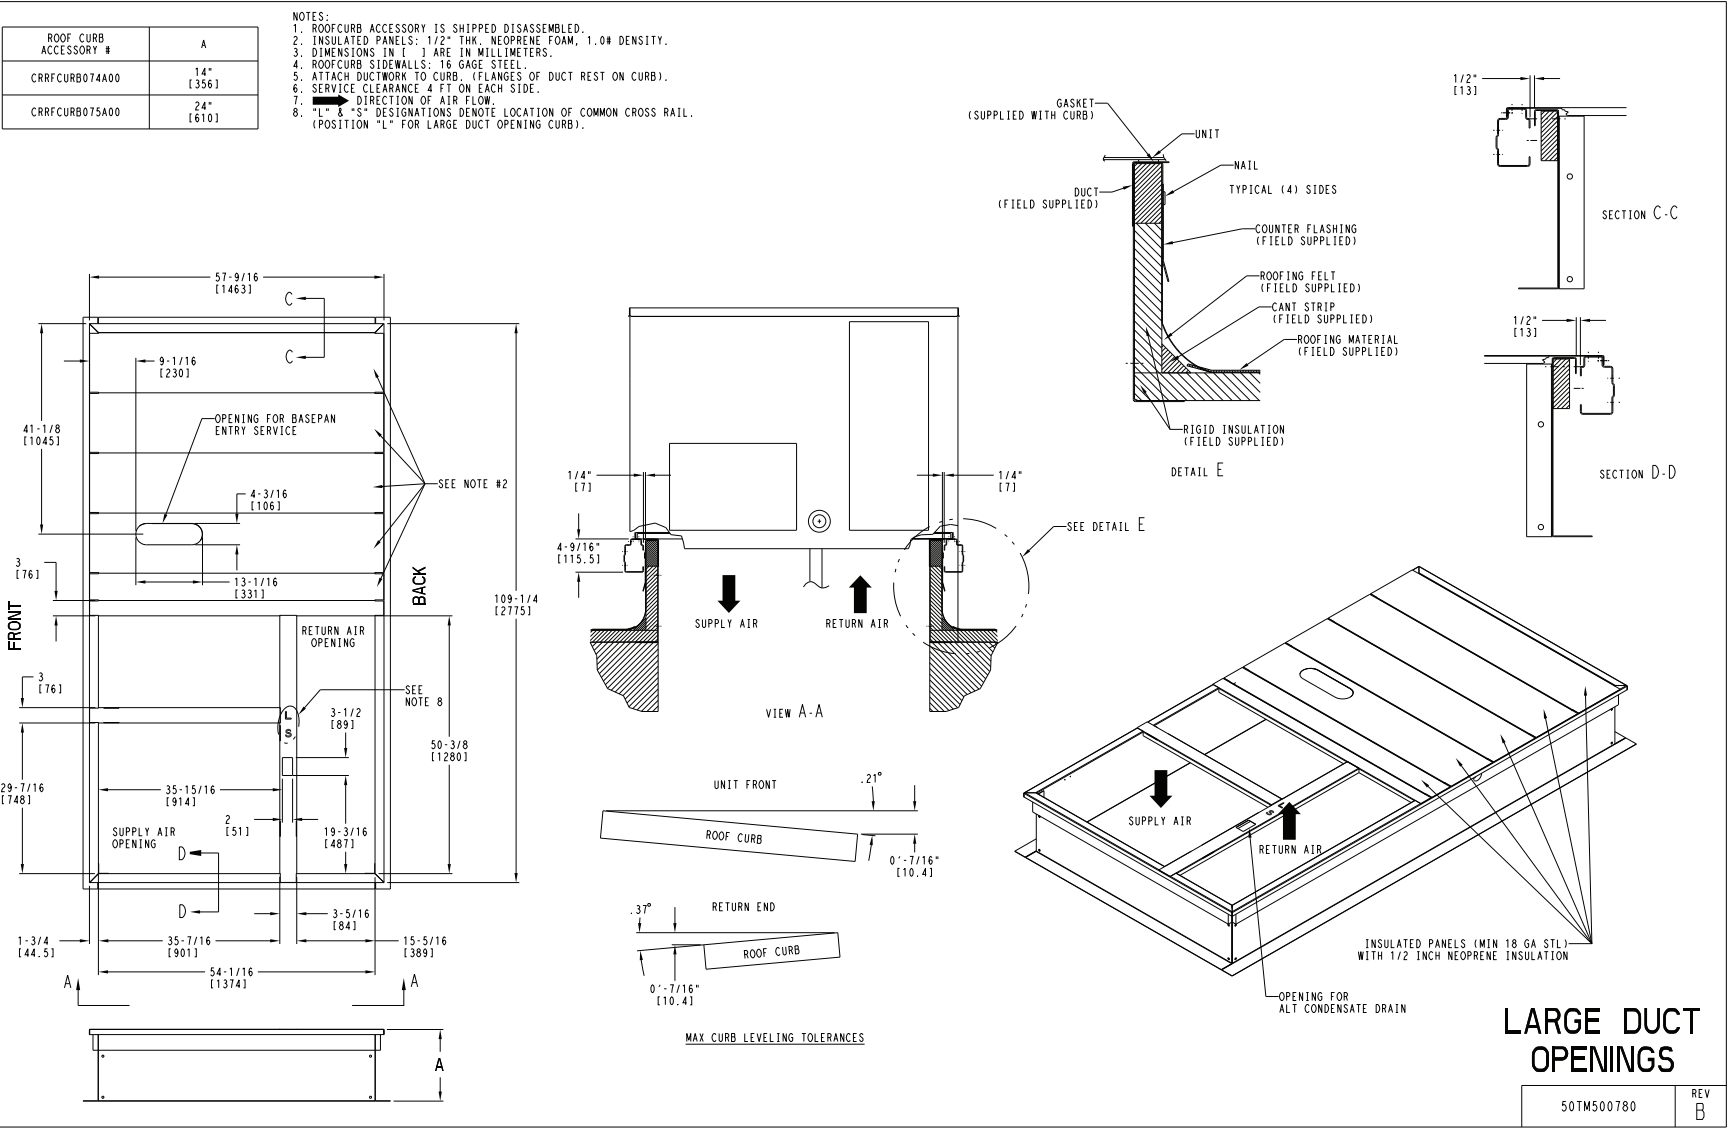

Performance data

RHF090 Two Stage Cooling Capacities

RHF090				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
2250 cfm	EA (wb)	58	TC	81.1	81.1	91.7	77.7	77.7	87.9	74.0	74.0	83.8	70.0	70.0	79.4	65.7	65.7	74.7
			SHC	70.5	81.1	91.7	67.4	77.7	87.9	64.1	74.0	83.8	60.6	70.0	79.4	56.8	65.7	74.7
		62	TC	85.4	85.4	87.2	81.1	81.1	84.9	76.5	76.5	82.3	71.6	71.6	79.6	66.4	66.4	76.5
			SHC	63.7	75.5	87.2	61.3	73.1	84.9	58.8	70.5	82.3	56.2	67.9	79.6	53.3	64.9	76.5
		67	TC	94.1	94.1	94.1	89.5	89.5	89.5	84.5	84.5	84.5	79.2	79.2	79.2	73.5	73.5	73.5
			SHC	52.2	64.0	75.9	49.9	61.7	73.6	47.4	59.3	71.1	44.9	56.7	68.6	42.2	54.1	65.9
		72	TC	103.8	103.8	103.8	98.6	98.6	98.6	93.3	93.3	93.3	87.6	87.6	87.6	81.6	81.6	81.6
			SHC	40.5	52.4	64.4	38.1	50.0	62.0	35.7	47.6	59.6	33.2	45.1	57.1	30.6	42.5	54.4
		76	TC	111.9	111.9	111.9	106.6	106.6	106.6	100.9	100.9	100.9	94.9	94.9	94.9	88.5	88.5	88.5
			SHC	30.6	42.9	55.3	28.3	40.6	53.0	26.0	38.2	50.5	23.5	35.7	47.9	21.0	33.1	45.3
2650 cfm	EA (wb)	58	TC	86.1	86.1	97.3	82.4	82.4	93.2	78.4	78.4	88.8	74.2	74.2	84.1	69.6	69.6	79.0
			SHC	74.9	86.1	97.3	71.6	82.4	93.2	68.0	78.4	88.8	64.2	74.2	84.1	60.2	69.6	79.0
		62	TC	88.4	88.4	96.5	83.9	83.9	93.9	79.2	79.2	91.0	75.5	75.5	83.1	69.7	69.7	82.2
			SHC	69.2	82.8	96.5	66.7	80.3	93.9	64.0	77.5	91.0	58.9	71.0	83.1	57.1	69.7	82.2
		67	TC	97.1	97.1	97.1	92.2	92.2	92.2	87.0	87.0	87.0	81.4	81.4	81.4	75.5	75.5	75.5
			SHC	55.8	69.6	83.4	53.4	67.2	81.1	50.9	64.8	78.6	48.4	62.2	76.0	45.7	59.5	73.2
		72	TC	107.0	107.0	107.0	101.5	101.5	101.5	95.9	95.9	95.9	90.0	90.0	90.0	83.7	83.7	83.7
			SHC	42.0	56.0	69.9	39.6	53.5	67.4	37.2	51.1	65.0	34.6	48.5	62.4	32.0	45.9	59.7
		76	TC	115.3	115.3	115.3	109.7	109.7	109.7	103.7	103.7	103.7	97.4	97.4	97.4	90.7	90.7	90.7
			SHC	30.6	44.8	59.1	28.3	42.5	56.7	25.9	40.0	54.2	23.4	37.5	51.6	20.8	34.8	48.9
3000 cfm	EA (wb)	58	TC	89.7	89.7	101.4	85.9	85.9	97.1	81.7	81.7	92.4	77.2	77.2	87.5	72.4	72.4	82.1
			SHC	78.1	89.7	101.4	74.6	85.9	97.1	70.9	81.7	92.4	66.9	77.2	87.5	62.6	72.4	82.1
		62	TC	90.7	90.7	103.7	86.9	86.9	97.7	83.4	83.4	89.1	77.3	77.3	91.0	72.4	72.4	85.5
			SHC	73.5	88.6	103.7	69.4	83.5	97.7	63.9	76.5	89.1	63.5	77.3	91.0	59.4	72.4	85.5
		67	TC	99.1	99.1	99.1	94.0	94.0	94.0	88.6	88.6	88.6	82.9	82.9	82.9	76.8	76.8	79.4
			SHC	58.8	74.3	89.8	56.4	71.9	87.4	53.9	69.3	84.8	51.2	66.7	82.2	48.5	64.0	79.4
		72	TC	109.1	109.1	109.1	103.5	103.5	103.5	97.7	97.7	97.7	91.6	91.6	91.6	85.1	85.1	85.1
			SHC	43.2	58.8	74.4	40.8	56.4	72.0	38.3	53.9	69.5	35.7	51.3	66.9	33.1	48.6	64.2
		76	TC	117.5	117.5	117.5	111.7	111.7	111.7	105.6	105.6	105.6	99.1	99.1	99.1	92.2	92.2	92.2
			SHC	30.4	46.3	62.2	28.0	43.9	59.7	25.6	41.4	57.2	23.1	38.8	54.6	20.4	36.2	51.9
3400 cfm	EA (wb)	58	TC	93.3	93.3	105.4	89.2	89.2	100.8	84.8	84.8	96.0	80.1	80.1	90.7	75.0	75.0	85.1
			SHC	81.2	93.3	105.4	77.6	89.2	100.8	73.6	84.8	96.0	69.4	80.1	90.7	65.0	75.0	85.1
		62	TC	94.5	94.5	105.2	90.6	90.6	98.9	84.9	84.9	99.8	80.2	80.2	94.4	75.1	75.1	88.6
			SHC	75.1	90.2	105.2	70.9	84.9	98.9	70.0	84.9	99.8	65.9	80.2	94.4	61.7	75.1	88.6
		67	TC	100.8	100.8	100.8	95.6	95.6	95.6	90.1	90.1	91.7	84.3	84.3	89.0	78.1	78.1	86.0
			SHC	62.0	79.4	96.8	59.5	76.9	94.3	57.0	74.3	91.7	54.4	71.7	89.0	51.6	68.8	86.0
		72	TC	110.9	110.9	110.9	105.3	105.3	105.3	99.3	99.3	99.3	93.0	93.0	93.0	86.4	86.4	86.4
			SHC	44.4	61.9	79.4	42.0	59.5	76.9	39.5	57.0	74.4	36.9	54.3	71.8	34.2	51.6	69.0
		76	TC	119.5	119.5	119.5	113.5	113.5	113.5	107.3	107.3	107.3	100.6	100.6	100.6	93.5	93.5	93.5
			SHC	30.0	47.8	65.5	27.6	45.3	63.0	25.2	42.9	60.5	22.6	40.2	57.9	20.0	37.5	55.1
3750 cfm	EA (wb)	58	TC	96.0	96.0	108.4	91.7	91.7	103.6	87.1	87.1	98.6	82.2	82.2	93.1	77.1	77.1	87.4
			SHC	83.6	96.0	108.4	79.8	91.7	103.6	75.7	87.1	98.6	71.4	82.2	93.1	66.8	77.1	87.4
		62	TC	96.0	96.0	112.6	91.8	91.8	107.7	87.2	87.2	102.5	82.3	82.3	96.9	77.1	77.1	90.9
			SHC	79.5	96.0	112.6	75.8	91.8	107.7	71.9	87.2	102.5	67.8	82.3	96.9	63.4	77.1	90.9
		67	TC	102.1	102.1	102.6	96.8	96.8	100.1	91.2	91.2	97.4	85.3	85.3	94.6	79.1	79.1	91.5
			SHC	64.7	83.7	102.6	62.2	81.2	100.1	59.7	78.6	97.4	57.0	75.8	94.6	54.2	72.9	91.5
		72	TC	112.3	112.3	112.3	106.5	106.5	106.5	100.5	100.5	100.5	94.0	94.0	94.0	87.2	87.2	87.2
			SHC	45.4	64.5	83.6	43.0	62.1	81.1	40.5	59.5	78.6	37.9	56.9	75.9	35.2	54.2	73.2
		76	TC	121.0	121.0	121.0	114.8	114.8	114.8	108.4	108.4	108.4	101.6	101.6	101.6	94.4	94.4	94.4
			SHC	29.6	48.9	68.3	27.2	46.5	65.8	24.8	44.0	63.3	22.2	41.4	60.6	19.5	38.6	57.8

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF090 Single Stage Cooling Capacities

RHF090				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1125 cfm	EA (wb)	58	TC	39.8	39.8	45.5	37.2	37.2	42.7	34.5	34.5	39.8	31.6	31.6	36.7	28.6	28.6	33.4
			SHC	34.1	39.8	45.5	31.7	37.2	42.7	29.2	34.5	39.8	26.6	31.6	36.7	23.8	28.6	33.4
		62	TC	42.8	42.8	43.0	39.6	39.6	41.0	36.3	36.3	38.8	32.8	32.8	36.6	29.1	29.1	34.3
			SHC	30.7	36.9	43.0	28.6	34.8	41.0	26.4	32.6	38.8	24.2	30.4	36.6	22.0	28.1	34.3
		67	TC	48.4	48.4	48.4	45.0	45.0	45.0	41.5	41.5	41.5	37.8	37.8	37.8	33.8	33.8	33.8
			SHC	25.3	31.5	37.7	23.3	29.4	35.6	21.1	27.3	33.5	18.9	25.1	31.3	16.6	22.8	29.0
		72	TC	54.5	54.5	54.5	50.9	50.9	50.9	47.2	47.2	47.2	43.2	43.2	43.2	39.0	39.0	39.0
			SHC	19.9	26.1	32.3	17.8	24.0	30.2	15.7	21.9	28.1	13.5	19.7	25.9	11.2	17.4	23.6
		76	TC	59.8	59.8	59.8	56.0	56.0	56.0	52.1	52.1	52.1	47.9	47.9	47.9	43.5	43.5	43.5
			SHC	15.5	21.7	27.9	13.4	19.6	25.8	11.3	17.5	23.7	9.1	15.3	21.5	6.9	13.1	19.2
1325 cfm	EA (wb)	58	TC	43.2	43.2	49.3	40.4	40.4	46.3	37.5	37.5	43.1	34.4	34.4	39.8	31.2	31.2	36.3
			SHC	37.1	43.2	49.3	34.6	40.4	46.3	31.9	37.5	43.1	29.1	34.4	39.8	26.1	31.2	36.3
		62	TC	44.8	44.8	48.6	41.5	41.5	46.5	38.0	38.0	44.3	34.5	34.5	41.7	31.3	31.3	38.1
			SHC	34.1	41.4	48.6	31.9	39.2	46.5	29.7	37.0	44.3	27.3	34.5	41.7	24.5	31.3	38.1
		67	TC	50.5	50.5	50.5	47.0	47.0	47.0	43.3	43.3	43.3	39.4	39.4	39.4	35.2	35.2	35.2
			SHC	27.7	34.9	42.2	25.5	32.8	40.1	23.3	30.6	37.9	21.1	28.3	35.6	18.7	26.0	33.3
		72	TC	56.8	56.8	56.8	53.1	53.1	53.1	49.1	49.1	49.1	45.0	45.0	45.0	40.6	40.6	40.6
			SHC	21.1	28.4	35.7	19.0	26.3	33.6	16.8	24.1	31.4	14.5	21.8	29.1	12.2	19.5	26.8
		76	TC	62.3	62.3	62.3	58.3	58.3	58.3	54.2	54.2	54.2	49.8	49.8	49.8	45.2	45.2	45.2
			SHC	15.8	23.1	30.4	13.7	21.0	28.3	11.5	18.8	26.1	9.3	16.6	23.8	7.0	14.2	21.5
1500 cfm	EA (wb)	58	TC	45.7	45.7	52.1	42.8	42.8	48.9	39.7	39.7	45.6	36.5	36.5	42.1	33.1	33.1	38.4
			SHC	39.4	45.7	52.1	36.7	42.8	48.9	33.9	39.7	45.6	30.9	36.5	42.1	27.8	33.1	38.4
		62	TC	46.2	46.2	53.4	42.9	42.9	51.1	39.8	39.8	47.7	36.6	36.6	44.1	33.2	33.2	40.3
			SHC	36.9	45.2	53.4	34.7	42.9	51.1	32.0	39.8	47.7	29.1	36.6	44.1	26.1	33.2	40.3
		67	TC	52.0	52.0	52.0	48.4	48.4	48.4	44.5	44.5	44.5	40.5	40.5	40.5	36.2	36.2	37.0
			SHC	29.5	37.8	46.0	27.4	35.6	43.9	25.1	33.4	41.6	22.9	31.1	39.4	20.5	28.7	37.0
		72	TC	58.4	58.4	58.4	54.5	54.5	54.5	50.4	50.4	50.4	46.1	46.1	46.1	41.6	41.6	41.6
			SHC	22.0	30.3	38.5	19.9	28.1	36.4	17.6	25.9	34.1	15.4	23.6	31.8	13.0	21.3	29.5
		76	TC	64.0	64.0	64.0	59.8	59.8	59.8	55.5	55.5	55.5	51.0	51.0	51.0	46.2	46.2	46.2
			SHC	16.0	24.2	32.5	13.8	22.1	30.3	11.6	19.8	28.1	9.3	17.6	25.8	7.0	15.2	23.5
1700 cfm	EA (wb)	58	TC	48.2	48.2	54.8	45.2	45.2	51.5	41.9	41.9	48.1	38.6	38.6	44.4	35.0	35.0	40.5
			SHC	41.6	48.2	54.8	38.8	45.2	51.5	35.8	41.9	48.1	32.7	38.6	44.4	29.5	35.0	40.5
		62	TC	48.3	48.3	57.2	45.2	45.2	53.8	42.0	42.0	50.2	38.6	38.6	46.4	35.1	35.1	42.4
			SHC	39.4	48.3	57.2	36.7	45.2	53.8	33.8	42.0	50.2	30.8	38.6	46.4	27.7	35.1	42.4
		67	TC	53.4	53.4	53.4	49.6	49.6	49.6	45.6	45.6	45.8	41.4	41.4	43.5	37.1	37.1	41.1
			SHC	31.6	41.0	50.3	29.4	38.7	48.1	27.1	36.5	45.8	24.8	34.2	43.5	22.4	31.8	41.1
		72	TC	59.9	59.9	59.9	55.8	55.8	55.8	51.6	51.6	51.6	47.2	47.2	47.2	42.5	42.5	42.5
			SHC	23.0	32.3	41.7	20.8	30.1	39.5	18.5	27.9	37.2	16.2	25.6	34.9	13.8	23.2	32.5
		76	TC	65.5	65.5	65.5	61.2	61.2	61.2	56.8	56.8	56.8	52.1	52.1	52.1	—	—	—
			SHC	16.0	25.4	34.7	13.8	23.2	32.5	11.6	20.9	30.3	9.3	18.6	28.0	—	—	—
1875 cfm	EA (wb)	58	TC	50.1	50.1	57.0	47.0	47.0	53.5	43.6	43.6	49.9	40.1	40.1	46.1	36.4	36.4	42.1
			SHC	43.3	50.1	57.0	40.4	47.0	53.5	37.3	43.6	49.9	34.1	40.1	46.1	30.8	36.4	42.1
		62	TC	50.2	50.2	59.4	47.0	47.0	55.8	43.7	43.7	52.1	40.2	40.2	48.2	36.5	36.5	44.1
			SHC	41.0	50.2	59.4	38.2	47.0	55.8	35.3	43.7	52.1	32.2	40.2	48.2	28.9	36.5	44.1
		67	TC	54.3	54.3	54.3	50.5	50.5	51.7	46.4	46.4	49.4	42.1	42.1	47.1	37.7	37.7	44.7
			SHC	33.4	43.7	54.0	31.1	41.4	51.7	28.8	39.1	49.4	26.5	36.8	47.1	24.1	34.4	44.7
		72	TC	60.9	60.9	60.9	56.8	56.8	56.8	52.4	52.4	52.4	47.9	47.9	47.9	43.1	43.1	43.1
			SHC	23.8	34.1	44.4	21.5	31.9	42.2	19.3	29.6	39.9	16.9	27.2	37.5	14.5	24.8	35.1
		76	TC	66.6	66.6	66.6	62.2	62.2	62.2	57.7	57.7	57.7	—	—	—	—	—	—
			SHC	16.0	26.3	36.6	13.8	24.1	34.4	11.5	21.8	32.1	—	—	—	—	—	—

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF102 Two Stage Cooling Capacities

RHF102				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
2550 cfm	EA (wb)	58	TC	93.3	93.3	105.4	89.2	89.2	100.8	84.6	84.6	95.7	79.4	79.4	89.9	—	—	—
			SHC	81.1	93.3	105.4	77.5	89.2	100.8	73.4	84.6	95.7	68.8	79.4	89.9	—	—	—
		62	TC	97.2	97.2	101.4	92.1	92.1	98.7	86.3	86.3	95.7	80.0	80.0	92.3	—	—	—
			SHC	73.7	87.5	101.4	71.0	84.9	98.7	68.1	81.9	95.7	64.9	78.6	92.3	—	—	—
		67	TC	107.0	107.0	107.0	101.4	101.4	101.4	95.2	95.2	95.2	88.2	88.2	88.2	—	—	—
			SHC	60.2	74.1	88.0	57.6	71.5	85.3	54.7	68.6	82.5	51.6	65.4	79.3	—	—	—
		72	TC	118.0	118.0	118.0	111.9	111.9	111.9	105.1	105.1	105.1	97.6	97.6	97.6	—	—	—
			SHC	46.5	60.5	74.4	43.8	57.8	71.8	41.0	54.9	68.9	37.9	51.8	65.8	—	—	—
		76	TC	—	127.4	127.4	—	120.8	120.8	—	113.6	113.6	—	105.7	105.7	—	—	—
			SHC	—	49.2	63.3	—	46.6	60.6	—	43.7	57.8	—	40.7	54.7	—	—	—
3000 cfm	EA (wb)	58	TC	99.0	99.0	111.8	94.6	94.6	106.9	89.6	89.6	101.3	84.0	84.0	95.0	—	—	—
			SHC	86.2	99.0	111.8	82.3	94.6	106.9	77.8	89.6	101.3	72.9	84.0	95.0	—	—	—
		62	TC	100.6	100.6	112.6	95.3	95.3	109.6	90.6	90.6	102.6	84.1	84.1	98.9	—	—	—
			SHC	80.4	96.5	112.6	77.6	93.6	109.6	72.7	87.7	102.6	69.3	84.1	98.9	—	—	—
		67	TC	110.5	110.5	110.5	104.4	104.4	104.4	97.9	97.9	97.9	90.6	90.6	90.6	—	—	—
			SHC	64.5	80.8	97.1	61.8	78.0	94.3	58.8	75.1	91.4	55.7	71.9	88.2	—	—	—
		72	TC	121.5	121.5	121.5	115.1	115.1	115.1	107.9	107.9	107.9	100.1	100.1	100.1	—	—	—
			SHC	48.2	64.6	80.9	45.5	61.9	78.2	42.6	58.9	75.3	39.5	55.8	72.1	—	—	—
		76	TC	—	131.1	131.1	—	124.1	124.1	—	116.5	116.5	—	108.2	108.2	—	—	—
			SHC	—	51.4	67.9	—	48.7	65.2	—	45.8	62.2	—	42.8	59.3	—	—	—
3400 cfm	EA (wb)	58	TC	103.3	103.3	116.6	98.5	98.5	111.3	93.3	93.3	105.4	87.3	87.3	98.8	—	—	—
			SHC	89.9	103.3	116.6	85.8	98.5	111.3	81.1	93.3	105.4	75.9	87.3	98.8	—	—	—
		62	TC	103.4	103.4	121.2	98.7	98.7	115.8	93.4	93.4	109.6	87.5	87.5	102.8	—	—	—
			SHC	85.6	103.4	121.2	81.6	98.7	115.8	77.1	93.4	109.6	72.1	87.5	102.8	—	—	—
		67	TC	112.7	112.7	112.7	106.5	106.5	106.5	99.7	99.7	99.7	92.2	92.2	95.8	—	—	—
			SHC	68.1	86.4	104.8	65.3	83.7	102.0	62.4	80.7	99.0	59.2	77.5	95.8	—	—	—
		72	TC	123.9	123.9	123.9	117.2	117.2	117.2	109.8	109.8	109.8	101.7	101.7	101.7	—	—	—
			SHC	49.5	68.0	86.5	46.8	65.3	83.7	43.8	62.3	80.8	40.7	59.1	77.6	—	—	—
		76	TC	—	133.5	133.5	—	126.3	126.3	—	118.4	118.4	—	109.9	109.9	—	—	—
			SHC	—	53.0	71.7	—	50.3	68.9	—	47.3	65.9	—	44.2	62.8	—	—	—
3850 cfm	EA (wb)	58	TC	107.3	107.3	121.2	102.4	102.4	115.6	96.8	96.8	109.4	90.6	90.6	102.4	—	—	—
			SHC	93.5	107.3	121.2	89.1	102.4	115.6	84.2	96.8	109.4	78.7	90.6	102.4	—	—	—
		62	TC	107.5	107.5	125.9	102.5	102.5	120.2	96.9	96.9	113.7	90.7	90.7	106.5	—	—	—
			SHC	89.0	107.5	125.9	84.7	102.5	120.2	80.0	96.9	113.7	74.8	90.7	106.5	—	—	—
		67	TC	114.7	114.7	114.7	108.4	108.4	110.5	101.4	101.4	107.5	93.7	93.7	104.1	—	—	—
			SHC	72.0	92.6	113.3	69.2	89.9	110.5	66.2	86.8	107.5	63.0	83.6	104.1	—	—	—
		72	TC	126.0	126.0	126.0	119.1	119.1	119.1	111.4	111.4	111.4	103.2	103.2	103.2	—	—	—
			SHC	50.9	71.7	92.5	48.1	68.9	89.7	45.1	65.9	86.7	42.0	62.8	83.5	—	—	—
		76	TC	—	135.7	135.7	—	128.2	128.2	—	120.1	120.1	—	111.4	111.4	—	—	—
			SHC	—	54.6	75.6	—	51.8	72.8	—	48.8	69.8	—	45.7	66.6	—	—	—
4250 cfm	EA (wb)	58	TC	110.6	110.6	124.8	105.2	105.2	118.8	99.4	99.4	112.4	93.0	93.0	105.2	—	—	—
			SHC	96.3	110.6	124.8	91.6	105.2	118.8	86.5	99.4	112.4	80.8	93.0	105.2	—	—	—
		62	TC	110.7	110.7	129.7	105.3	105.3	123.5	99.5	99.5	116.8	93.1	93.1	109.3	—	—	—
			SHC	91.7	110.7	129.7	87.2	105.3	123.5	82.3	99.5	116.8	76.8	93.1	109.3	—	—	—
		67	TC	116.2	116.2	120.7	109.7	109.7	117.9	102.6	102.6	114.8	94.8	94.8	111.3	—	—	—
			SHC	75.4	98.1	120.7	72.6	95.2	117.9	69.6	92.2	114.8	66.4	88.8	111.3	—	—	—
		72	TC	127.5	127.5	127.5	120.4	120.4	120.4	112.6	112.6	112.6	104.2	104.2	104.2	—	—	—
			SHC	51.9	74.8	97.7	49.2	72.0	94.9	46.2	69.1	91.9	43.1	65.9	88.7	—	—	—
		76	TC	—	137.2	137.2	—	129.6	129.6	—	121.3	121.3	—	112.4	112.4	—	—	—
			SHC	—	55.9	78.9	—	53.1	76.1	—	50.0	73.0	—	46.9	69.9	—	—	—

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF102 Single Stage Cooling Capacities

RHF102				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1300 cfm	EA (wb)	58	TC	48.0	48.0	54.2	46.1	46.1	52.1	44.0	44.0	49.7	41.6	41.6	47.1	38.9	38.9	44.1
			SHC	41.8	48.0	54.2	40.1	46.1	52.1	38.2	44.0	49.7	36.1	41.6	47.1	33.7	38.9	44.1
		62	TC	50.1	50.1	52.2	47.7	47.7	50.9	45.0	45.0	49.6	42.1	42.1	48.0	38.9	38.9	45.9
			SHC	38.0	45.1	52.2	36.7	43.8	50.9	35.3	42.5	49.6	33.8	40.9	48.0	32.0	38.9	45.9
		67	TC	55.5	55.5	55.5	52.9	52.9	52.9	50.0	50.0	50.0	46.7	46.7	46.7	43.1	43.1	43.1
			SHC	31.2	38.4	45.5	30.0	37.1	44.2	28.6	35.7	42.9	27.1	34.2	41.4	25.5	32.6	39.7
		72	TC	61.5	61.5	61.5	58.7	58.7	58.7	55.5	55.5	55.5	52.0	52.0	52.0	48.1	48.1	48.1
			SHC	24.4	31.5	38.7	23.1	30.3	37.4	21.8	28.9	36.1	20.3	27.4	34.6	18.7	25.8	33.0
		76	TC	—	66.8	66.8	—	63.7	63.7	—	60.3	60.3	—	56.6	56.6	—	52.4	52.4
			SHC	—	25.9	33.1	—	24.7	31.8	—	23.3	30.5	—	21.9	29.0	—	20.3	27.4
1500 cfm	EA (wb)	58	TC	50.8	50.8	57.3	48.7	48.7	55.1	46.4	46.4	52.5	43.9	43.9	49.7	41.0	41.0	46.4
			SHC	44.2	50.8	57.3	42.4	48.7	55.1	40.3	46.4	52.5	38.1	43.9	49.7	35.5	41.0	46.4
		62	TC	51.8	51.8	57.5	49.2	49.2	56.1	46.7	46.7	54.1	43.9	43.9	51.7	41.0	41.0	48.3
			SHC	41.1	49.3	57.5	39.8	47.9	56.1	38.1	46.1	54.1	36.2	43.9	51.7	33.7	41.0	48.3
		67	TC	57.2	57.2	57.2	54.5	54.5	54.5	51.4	51.4	51.4	48.0	48.0	48.0	44.2	44.2	44.2
			SHC	33.3	41.5	49.7	32.0	40.2	48.4	30.6	38.8	47.0	29.1	37.3	45.5	27.4	35.6	43.8
		72	TC	63.4	63.4	63.4	60.3	60.3	60.3	57.0	57.0	57.0	53.3	53.3	53.3	49.2	49.2	49.2
			SHC	25.3	33.6	41.8	24.0	32.3	40.5	22.6	30.9	39.1	21.1	29.4	37.6	19.5	27.7	36.0
		76	TC	—	68.7	68.7	—	65.4	65.4	—	61.9	61.9	—	58.0	58.0	—	53.6	53.6
			SHC	—	27.1	35.3	—	25.8	34.0	—	24.4	32.7	—	22.9	31.2	—	21.3	29.5
1700 cfm	EA (wb)	58	TC	53.1	53.1	60.0	51.0	51.0	57.6	48.5	48.5	54.9	45.8	45.8	51.8	42.8	42.8	48.4
			SHC	46.3	53.1	60.0	44.3	51.0	57.6	42.2	48.5	54.9	39.8	45.8	51.8	37.1	42.8	48.4
		62	TC	53.4	53.4	61.8	51.0	51.0	59.9	48.6	48.6	57.1	45.9	45.9	53.9	42.8	42.8	50.4
			SHC	43.8	52.8	61.8	42.2	51.0	59.9	40.1	48.6	57.1	37.8	45.9	53.9	35.2	42.8	50.4
		67	TC	58.6	58.6	58.6	55.7	55.7	55.7	52.5	52.5	52.5	49.0	49.0	49.5	45.0	45.0	47.8
			SHC	35.2	44.5	53.8	33.9	43.2	52.5	32.5	41.8	51.1	30.9	40.2	49.5	29.3	38.5	47.8
		72	TC	64.8	64.8	64.8	61.6	61.6	61.6	58.2	58.2	58.2	54.4	54.4	54.4	50.1	50.1	50.1
			SHC	26.2	35.5	44.8	24.9	34.2	43.5	23.4	32.8	42.1	21.9	31.2	40.6	20.2	29.6	38.9
		76	TC	—	70.2	70.2	—	66.8	66.8	—	63.1	63.1	—	59.1	59.1	—	54.5	54.5
			SHC	—	28.1	37.5	—	26.8	36.2	—	25.4	34.8	—	23.9	33.3	—	22.3	31.6
1950 cfm	EA (wb)	58	TC	55.7	55.7	62.8	53.3	53.3	60.2	50.7	50.7	57.4	47.9	47.9	54.1	44.6	44.6	50.5
			SHC	48.5	55.7	62.8	46.4	53.3	60.2	44.1	50.7	57.4	41.6	47.9	54.1	38.7	44.6	50.5
		62	TC	55.7	55.7	65.3	53.4	53.4	62.6	50.8	50.8	59.7	47.9	47.9	56.3	44.7	44.7	52.6
			SHC	46.1	55.7	65.3	44.2	53.4	62.6	42.0	50.8	59.7	39.5	47.9	56.3	36.8	44.7	52.6
		67	TC	59.9	59.9	59.9	56.9	56.9	57.5	53.6	53.6	56.0	49.9	49.9	54.4	45.9	45.9	52.7
			SHC	37.5	48.2	58.8	36.2	46.8	57.5	34.8	45.4	56.0	33.2	43.8	54.4	31.5	42.1	52.7
		72	TC	66.2	66.2	66.2	62.9	62.9	62.9	59.3	59.3	59.3	55.3	55.3	55.3	51.0	51.0	51.0
			SHC	27.1	37.8	48.5	25.8	36.5	47.2	24.4	35.1	45.7	22.8	33.5	44.2	21.1	31.8	42.5
		76	TC	—	71.7	71.7	—	68.1	68.1	—	64.3	64.3	—	60.1	60.1	—	—	—
			SHC	—	29.4	40.1	—	28.0	38.8	—	26.6	37.3	—	25.1	35.8	—	—	—
2150 cfm	EA (wb)	58	TC	57.4	57.4	64.8	55.0	55.0	62.1	52.3	52.3	59.1	49.3	49.3	55.7	45.9	45.9	52.0
			SHC	50.0	57.4	64.8	47.9	55.0	62.1	45.5	52.3	59.1	42.8	49.3	55.7	39.8	45.9	52.0
		62	TC	57.5	57.5	67.3	55.0	55.0	64.5	52.3	52.3	61.4	49.3	49.3	58.0	45.9	45.9	54.0
			SHC	47.6	57.5	67.3	45.5	55.0	64.5	43.2	52.3	61.4	40.7	49.3	58.0	37.8	45.9	54.0
		67	TC	60.7	60.7	62.7	57.6	57.6	61.4	54.3	54.3	59.9	50.6	50.6	58.3	46.5	46.5	56.4
			SHC	39.4	51.0	62.7	38.0	49.7	61.4	36.6	48.2	59.9	35.0	46.6	58.3	33.2	44.8	56.4
		72	TC	67.0	67.0	67.0	63.7	63.7	63.7	60.0	60.0	60.0	56.0	56.0	56.0	51.5	51.5	51.5
			SHC	27.9	39.6	51.4	26.5	38.3	50.0	25.1	36.8	48.6	23.5	35.3	47.0	21.8	33.6	45.3
		76	TC	—	72.5	72.5	—	69.0	69.0	—	65.1	65.1	—	—	—	—	—	—
			SHC	—	30.3	42.1	—	29.0	40.8	—	27.5	39.4	—	—	—	—	—	—

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF120 Two Stage Cooling Capacities

RHF120				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
3000 cfm	EA (wb)	58	TC	109.7	109.7	124.3	104.6	104.6	118.7	99.2	99.2	112.7	93.4	93.4	106.3	87.1	87.1	99.3
			SHC	95.1	109.7	124.3	90.6	104.6	118.7	85.7	99.2	112.7	80.4	93.4	106.3	74.8	87.1	99.3
		62	TC	115.8	115.8	117.5	109.5	109.5	113.8	102.8	102.8	110.0	95.7	95.7	105.9	88.2	88.2	101.5
			SHC	85.5	101.5	117.5	81.9	97.9	113.8	78.1	94.1	110.0	74.1	90.0	105.9	69.9	85.7	101.5
		67	TC	128.0	128.0	128.0	121.2	121.2	121.2	113.9	113.9	113.9	106.1	106.1	106.1	97.9	97.9	97.9
			SHC	70.0	86.1	102.2	66.4	82.5	98.6	62.7	78.8	94.8	58.8	74.8	90.9	54.7	70.8	86.8
		72	TC	141.4	141.4	141.4	134.0	134.0	134.0	126.1	126.1	126.1	117.7	117.7	117.7	108.9	108.9	108.9
			SHC	54.2	70.4	86.6	50.6	66.8	83.0	46.9	63.0	79.2	43.0	59.1	75.3	39.0	55.1	71.2
		76	TC	—	152.8	152.8	—	144.9	144.9	—	136.5	136.5	—	127.6	127.6	—	118.2	118.2
			SHC	—	57.6	74.1	—	54.0	70.5	—	50.3	66.8	—	46.4	62.9	—	42.4	58.8
3500 cfm	EA (wb)	58	TC	116.4	116.4	131.7	110.9	110.9	125.7	105.1	105.1	119.3	98.9	98.9	112.4	92.2	92.2	105.0
			SHC	101.0	116.4	131.7	96.1	110.9	125.7	90.9	105.1	119.3	85.3	98.9	112.4	79.3	92.2	105.0
		62	TC	119.9	119.9	129.7	113.3	113.3	125.8	106.4	106.4	121.6	99.6	99.6	115.5	92.3	92.3	109.5
			SHC	92.8	111.2	129.7	89.0	107.4	125.8	85.1	103.3	121.6	80.2	97.9	115.5	75.1	92.3	109.5
		67	TC	132.1	132.1	132.1	124.9	124.9	124.9	117.2	117.2	117.2	109.1	109.1	109.1	100.5	100.5	100.5
			SHC	74.7	93.4	112.0	71.1	89.7	108.3	67.3	85.9	104.5	63.3	81.9	100.5	59.2	77.8	96.3
		72	TC	145.6	145.6	145.6	137.8	137.8	137.8	129.6	129.6	129.6	120.8	120.8	120.8	111.6	111.6	111.6
			SHC	56.2	75.0	93.7	52.5	71.3	90.0	48.7	67.5	86.2	44.8	63.5	82.2	40.7	59.4	78.1
		76	TC	—	157.1	157.1	—	148.8	148.8	—	140.0	140.0	—	130.8	130.8	—	121.0	121.0
			SHC	—	60.0	79.2	—	56.3	75.4	—	52.5	71.5	—	48.5	67.5	—	44.5	63.4
4000 cfm	EA (wb)	58	TC	122.0	122.0	138.0	116.2	116.2	131.7	110.1	110.1	124.9	103.5	103.5	117.6	96.4	96.4	109.7
			SHC	106.0	122.0	138.0	100.8	116.2	131.7	95.3	110.1	124.9	89.4	103.5	117.6	83.0	96.4	109.7
		62	TC	123.4	123.4	140.8	117.8	117.8	132.9	111.9	111.9	124.2	103.6	103.6	122.4	96.5	96.5	114.3
			SHC	99.5	120.2	140.8	93.8	113.4	132.9	87.7	106.0	124.2	84.7	103.6	122.4	78.7	96.5	114.3
		67	TC	135.2	135.2	135.2	127.7	127.7	127.7	119.8	119.8	119.8	111.4	111.4	111.4	102.5	102.5	105.5
			SHC	79.2	100.4	121.5	75.5	96.6	117.7	71.6	92.7	113.7	67.6	88.7	109.7	63.5	84.5	105.5
		72	TC	148.9	148.9	148.9	140.8	140.8	140.8	132.2	132.2	132.2	123.2	123.2	123.2	113.7	113.7	113.7
			SHC	58.0	79.2	100.4	54.3	75.5	96.7	50.4	71.6	92.8	46.4	67.6	88.7	42.3	63.4	84.6
		76	TC	—	160.4	160.4	—	151.8	151.8	—	142.8	142.8	—	133.2	133.2	—	123.2	123.2
			SHC	—	62.1	83.7	—	58.3	79.9	—	54.5	76.0	—	50.5	71.9	—	46.3	67.7
4500 cfm	EA (wb)	58	TC	126.7	126.7	143.3	120.7	120.7	136.6	114.2	114.2	129.5	107.3	107.3	121.8	99.9	99.9	113.6
			SHC	110.2	126.7	143.3	104.7	120.7	136.6	98.9	114.2	129.5	92.7	107.3	121.8	86.1	99.9	113.6
		62	TC	128.4	128.4	143.8	120.8	120.8	142.1	114.3	114.3	134.8	107.4	107.4	126.8	100.0	100.0	118.4
			SHC	102.2	123.0	143.8	99.5	120.8	142.1	93.9	114.3	134.8	87.9	107.4	126.8	81.6	100.0	118.4
		67	TC	137.6	137.6	137.6	129.9	129.9	129.9	121.8	121.8	122.8	113.2	113.2	118.6	104.2	104.2	114.3
			SHC	83.5	107.0	130.6	79.7	103.3	126.8	75.8	99.3	122.8	71.8	95.2	118.6	67.6	90.9	114.3
		72	TC	151.4	151.4	151.4	143.1	143.1	143.1	134.3	134.3	134.3	125.0	125.0	125.0	115.3	115.3	115.3
			SHC	59.5	83.2	106.9	55.8	79.5	103.1	51.9	75.5	99.2	47.9	71.5	95.1	43.7	67.3	90.9
		76	TC	—	163.1	163.1	—	154.2	154.2	—	144.9	144.9	—	135.1	135.1	—	124.8	124.8
			SHC	—	64.0	88.0	—	60.2	84.1	—	56.2	80.1	—	52.2	76.0	—	48.0	71.7
5000 cfm	EA (wb)	58	TC	130.8	130.8	147.9	124.5	124.5	140.9	117.7	117.7	133.4	110.5	110.5	125.5	102.9	102.9	117.0
			SHC	113.7	130.8	147.9	108.1	124.5	140.9	102.0	117.7	133.4	95.6	110.5	125.5	88.7	102.9	117.0
		62	TC	131.0	131.0	153.8	124.6	124.6	146.5	117.9	117.9	138.8	110.6	110.6	130.6	103.0	103.0	121.8
			SHC	108.1	131.0	153.8	102.7	124.6	146.5	96.9	117.9	138.8	90.7	110.6	130.6	84.1	103.0	121.8
		67	TC	139.6	139.6	139.6	131.8	131.8	135.6	123.5	123.5	131.5	114.7	114.7	127.2	105.6	105.6	122.6
			SHC	87.6	113.5	139.5	83.8	109.7	135.6	79.9	105.7	131.5	75.8	101.5	127.2	71.5	97.0	122.6
		72	TC	153.5	153.5	153.5	145.0	145.0	145.0	136.0	136.0	136.0	126.5	126.5	126.5	116.6	116.6	116.6
			SHC	61.0	87.1	113.2	57.2	83.3	109.4	53.3	79.3	105.4	49.3	75.3	101.3	45.1	71.1	97.1
		76	TC	—	165.2	165.2	—	156.1	156.1	—	146.6	146.6	—	136.6	136.6	—	126.1	126.1
			SHC	—	65.6	92.0	—	61.8	88.1	—	57.8	84.1	—	53.7	79.9	—	49.5	75.6

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF120 Single Stage Cooling Capacities

RHF120				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1500 cfm	EA (wb)	58	TC	53.5	53.5	61.1	50.1	50.1	57.4	46.5	46.5	53.5	42.7	42.7	49.4	38.6	38.6	44.9
			SHC	45.9	53.5	61.1	42.8	50.1	57.4	39.5	46.5	53.5	36.0	42.7	49.4	32.3	38.6	44.9
		62	TC	57.3	57.3	57.6	53.1	53.1	54.9	48.7	48.7	52.1	44.1	44.1	49.3	39.1	39.1	46.2
			SHC	41.2	49.4	57.6	38.5	46.7	54.9	35.7	43.9	52.1	32.8	41.0	49.3	29.8	38.0	46.2
		67	TC	64.4	64.4	64.4	59.9	59.9	59.9	55.2	55.2	55.2	50.3	50.3	50.3	45.0	45.0	45.0
			SHC	33.9	42.2	50.4	31.2	39.4	47.7	28.4	36.7	44.9	25.6	33.8	42.0	22.6	30.8	39.1
		72	TC	72.1	72.1	72.1	67.3	67.3	67.3	62.3	62.3	62.3	56.9	56.9	56.9	51.5	51.5	51.5
			SHC	26.5	34.8	43.0	23.8	32.1	40.3	21.0	29.3	37.5	18.1	26.4	34.6	15.2	23.5	31.7
		76	TC	—	78.8	78.8	—	73.8	73.8	—	68.4	68.4	—	62.7	62.7	—	57.0	57.0
			SHC	—	28.8	37.0	—	26.0	34.3	—	23.2	31.5	—	20.4	28.6	—	17.5	25.7
1750 cfm	EA (wb)	58	TC	57.6	57.6	65.6	53.9	53.9	61.7	50.1	50.1	57.5	46.0	46.0	53.1	41.6	41.6	48.3
			SHC	49.6	57.6	65.6	46.2	53.9	61.7	42.6	50.1	57.5	38.9	46.0	53.1	35.0	41.6	48.3
		62	TC	59.7	59.7	64.5	55.3	55.3	61.7	50.8	50.8	58.8	46.1	46.1	55.5	41.8	41.8	50.7
			SHC	45.4	54.9	64.5	42.6	52.1	61.7	39.7	49.3	58.8	36.6	46.1	55.5	32.8	41.8	50.7
		67	TC	66.9	66.9	66.9	62.2	62.2	62.2	57.3	57.3	57.3	52.1	52.1	52.1	46.6	46.6	46.6
			SHC	36.7	46.3	55.9	33.9	43.5	53.1	31.1	40.7	50.3	28.2	37.8	47.3	25.1	34.7	44.3
		72	TC	74.8	74.8	74.8	69.7	69.7	69.7	64.5	64.5	64.5	58.8	58.8	58.8	52.9	52.9	52.9
			SHC	27.9	37.5	47.2	25.1	34.7	44.4	22.3	31.9	41.5	19.3	28.9	38.6	16.3	25.9	35.5
		76	TC	—	81.6	81.6	—	76.3	76.3	—	70.7	70.7	—	64.9	64.9	—	58.8	58.8
			SHC	—	30.4	40.0	—	27.6	37.2	—	24.7	34.4	—	21.9	31.5	—	18.9	28.5
2000 cfm	EA (wb)	58	TC	61.0	61.0	69.4	57.1	57.1	65.2	53.0	53.0	60.8	48.6	48.6	56.0	44.2	44.2	51.2
			SHC	52.6	61.0	69.4	49.0	57.1	65.2	45.3	53.0	60.8	41.3	48.6	56.0	37.3	44.2	51.2
		62	TC	61.7	61.7	71.1	57.2	57.2	68.1	53.2	53.2	63.5	48.9	48.9	58.7	44.3	44.3	53.6
			SHC	49.3	60.2	71.1	46.4	57.2	68.1	42.8	53.2	63.5	39.0	48.9	58.7	35.0	44.3	53.6
		67	TC	68.9	68.9	68.9	64.0	64.0	64.0	58.8	58.8	58.8	53.5	53.5	53.5	47.7	47.7	49.4
			SHC	39.3	50.3	61.2	36.5	47.4	58.4	33.6	44.5	55.5	30.6	41.6	52.5	27.5	38.4	49.4
		72	TC	76.8	76.8	76.8	71.6	71.6	71.6	66.1	66.1	66.1	60.3	60.3	60.3	54.4	54.4	54.4
			SHC	29.1	40.1	51.1	26.3	37.3	48.3	23.4	34.4	45.4	20.4	31.4	42.4	17.4	28.4	39.4
		76	TC	—	83.8	83.8	—	78.3	78.3	—	72.4	72.4	—	66.5	66.5	—	60.2	60.2
			SHC	—	31.9	42.9	—	29.0	40.0	—	26.1	37.1	—	23.3	34.3	—	20.2	31.2
2250 cfm	EA (wb)	58	TC	63.9	63.9	72.7	59.9	59.9	68.3	55.7	55.7	63.7	51.2	51.2	58.8	46.4	46.4	53.6
			SHC	55.2	63.9	72.7	51.5	59.9	68.3	47.6	55.7	63.7	43.5	51.2	58.8	39.2	46.4	53.6
		62	TC	63.8	63.8	75.6	60.0	60.0	71.2	55.8	55.8	66.5	51.3	51.3	61.5	46.5	46.5	56.2
			SHC	51.9	63.8	75.6	48.7	60.0	71.2	45.0	55.8	66.5	41.1	51.3	61.5	36.9	46.5	56.2
		67	TC	70.4	70.4	70.4	65.3	65.3	65.3	60.1	60.1	60.6	54.5	54.5	57.5	48.8	48.8	54.4
			SHC	41.8	54.1	66.4	38.9	51.2	63.5	36.0	48.3	60.6	33.0	45.3	57.5	29.9	42.2	54.4
		72	TC	78.4	78.4	78.4	73.1	73.1	73.1	67.4	67.4	67.4	61.4	61.4	61.4	55.2	55.2	55.2
			SHC	30.2	42.6	54.9	27.4	39.8	52.1	24.4	36.8	49.1	21.4	33.7	46.1	18.3	30.6	43.0
		76	TC	—	85.5	85.5	—	79.8	79.8	—	73.8	73.8	—	67.6	67.6	—	61.1	61.1
			SHC	—	33.2	45.6	—	30.4	42.7	—	27.4	39.8	—	24.4	36.8	—	21.3	33.7
2500 cfm	EA (wb)	58	TC	66.5	66.5	75.5	62.3	62.3	71.0	57.9	57.9	66.2	53.0	53.0	60.9	48.1	48.1	55.4
			SHC	57.5	66.5	75.5	53.6	62.3	71.0	49.6	57.9	66.2	45.2	53.0	60.9	40.7	48.1	55.4
		62	TC	66.6	66.6	78.7	60.4	60.4	73.5	57.9	57.9	69.0	53.3	53.3	63.9	48.3	48.3	58.2
			SHC	54.4	66.6	78.7	47.3	60.4	73.5	46.8	57.9	69.0	42.8	53.3	63.9	38.4	48.3	58.2
		67	TC	71.7	71.7	71.7	66.5	66.5	68.6	61.1	61.1	65.6	55.4	55.4	62.5	49.7	49.7	59.3
			SHC	44.2	57.8	71.5	41.3	54.9	68.6	38.3	52.0	65.6	35.3	48.9	62.5	32.2	45.8	59.3
		72	TC	79.7	79.7	79.7	74.2	74.2	74.2	68.4	68.4	68.4	62.5	62.5	62.5	56.0	56.0	56.0
			SHC	31.2	45.0	58.7	28.3	42.1	55.8	25.4	39.1	52.8	22.4	36.1	49.8	19.2	32.9	46.6
		76	TC	—	86.9	86.9	—	81.0	81.0	—	75.0	75.0	—	68.7	68.7	—	61.9	61.9
			SHC	—	34.5	48.2	—	31.6	45.3	—	28.6	42.4	—	25.6	39.4	—	22.5	36.2

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF150 Two Stage Cooling Capacities

RHF150				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
3750 cfm	EA (wb)	58	TC	132.1	132.1	150.2	125.1	125.1	142.6	117.8	117.8	134.6	110.0	110.0	126.1	101.7	101.7	117.1
			SHC	114.0	132.1	150.2	107.6	125.1	142.6	100.9	117.8	134.6	93.8	110.0	126.1	86.3	101.7	117.1
		62	TC	140.2	140.2	141.4	131.7	131.7	136.0	122.8	122.8	130.4	113.5	113.5	124.6	103.7	103.7	118.4
			SHC	101.9	121.6	141.4	96.6	116.3	136.0	91.1	110.8	130.4	85.4	105.0	124.6	79.5	98.9	118.4
		67	TC	155.2	155.2	155.2	146.2	146.2	146.2	136.7	136.7	136.7	126.6	126.6	126.6	116.0	116.0	116.0
			SHC	82.8	102.6	122.4	77.5	97.3	117.1	72.0	91.8	111.6	66.4	86.2	105.9	60.6	80.4	100.1
		72	TC	171.8	171.8	171.8	162.1	162.1	162.1	151.9	151.9	151.9	141.1	141.1	141.1	129.7	129.7	129.7
			SHC	63.4	83.4	103.3	58.1	78.0	98.0	52.6	72.5	92.4	47.0	66.8	86.7	41.1	60.9	80.7
		76	TC	—	185.7	185.7	—	175.4	175.4	—	164.5	164.5	—	153.0	153.0	—	140.7	140.7
			SHC	—	67.6	88.3	—	62.3	83.0	—	56.9	77.5	—	51.2	71.7	—	45.2	65.5
4000 cfm	EA (wb)	58	TC	140.8	140.8	159.9	133.4	133.4	151.8	125.5	125.5	143.2	117.2	117.2	134.1	108.3	108.3	124.5
			SHC	121.8	140.8	159.9	114.9	133.4	151.8	107.8	125.5	143.2	100.2	117.2	134.1	92.2	108.3	124.5
		62	TC	145.5	145.5	156.9	136.7	136.7	151.2	127.6	127.6	145.1	118.1	118.1	138.5	109.8	109.8	125.8
			SHC	111.4	134.1	156.9	105.9	128.5	151.2	100.1	122.6	145.1	94.0	116.2	138.5	84.9	105.3	125.8
		67	TC	160.4	160.4	160.4	150.9	150.9	150.9	141.0	141.0	141.0	130.5	130.5	130.5	119.5	119.5	119.5
			SHC	89.1	112.1	135.1	83.7	106.7	129.7	78.2	101.2	124.1	72.5	95.5	118.4	66.6	89.5	112.4
		72	TC	177.3	177.3	177.3	167.2	167.2	167.2	156.5	156.5	156.5	145.2	145.2	145.2	133.3	133.3	133.3
			SHC	66.5	89.6	112.7	61.1	84.1	107.2	55.5	78.5	101.5	49.8	72.7	95.7	43.8	66.7	89.6
		76	TC	—	191.1	191.1	—	180.2	180.2	—	168.9	168.9	—	156.7	156.7	—	—	—
			SHC	—	71.3	95.2	—	65.8	89.6	—	60.2	83.7	—	54.3	77.7	—	—	—
5000 cfm	EA (wb)	58	TC	147.5	147.5	167.3	139.6	139.6	158.7	131.3	131.3	149.7	122.6	122.6	140.2	113.4	113.4	130.1
			SHC	127.7	147.5	167.3	120.5	139.6	158.7	112.9	131.3	149.7	105.0	122.6	140.2	96.7	113.4	130.1
		62	TC	149.6	149.6	169.8	140.7	140.7	163.4	133.6	133.6	149.0	123.0	123.0	146.5	113.5	113.5	135.9
			SHC	119.2	144.5	169.8	113.3	138.4	163.4	103.6	126.3	149.0	99.4	123.0	146.5	91.2	113.5	135.9
		67	TC	164.0	164.0	164.0	154.2	154.2	154.2	144.0	144.0	144.0	133.3	133.3	133.3	122.0	122.0	123.0
			SHC	94.6	120.5	146.4	89.2	115.0	140.9	83.5	109.3	135.2	77.7	103.5	129.2	71.7	97.4	123.0
		72	TC	181.1	181.1	181.1	170.6	170.6	170.6	159.6	159.6	159.6	148.0	148.0	148.0	135.7	135.7	135.7
			SHC	69.0	94.9	120.9	63.5	89.4	115.3	57.9	83.7	109.5	52.1	77.8	103.5	46.0	71.6	97.2
		76	TC	—	194.7	194.7	—	183.5	183.5	—	171.7	171.7	—	159.2	159.2	—	—	—
			SHC	—	74.2	100.7	—	68.6	95.0	—	62.9	89.0	—	56.9	82.8	—	—	—
5650 cfm	EA (wb)	58	TC	153.5	153.5	174.0	145.3	145.3	165.1	136.7	136.7	155.7	127.6	127.6	145.8	118.0	118.0	135.2
			SHC	133.0	153.5	174.0	125.5	145.3	165.1	117.7	136.7	155.7	109.5	127.6	145.8	100.8	118.0	135.2
		62	TC	156.3	156.3	171.7	147.2	147.2	165.8	136.9	136.9	162.3	127.8	127.8	152.0	118.1	118.1	141.2
			SHC	121.8	146.8	171.7	116.1	141.0	165.8	111.5	136.9	162.3	103.5	127.8	152.0	95.1	118.1	141.2
		67	TC	167.1	167.1	167.1	157.2	157.2	157.2	146.7	146.7	146.7	135.7	135.7	140.3	124.1	124.1	133.9
			SHC	100.2	129.1	158.0	94.7	123.5	152.3	89.0	117.7	146.5	83.0	111.7	140.3	76.9	105.4	133.9
		72	TC	184.4	184.4	184.4	173.6	173.6	173.6	162.3	162.3	162.3	150.4	150.4	150.4	137.7	137.7	137.7
			SHC	71.5	100.4	129.3	66.0	94.8	123.6	60.3	89.0	117.7	54.4	83.0	111.6	48.3	76.7	105.2
		76	TC	—	197.8	197.8	—	186.3	186.3	—	174.1	174.1	—	161.2	161.2	—	—	—
			SHC	—	77.1	106.3	—	71.4	100.5	—	65.5	94.3	—	59.4	87.9	—	—	—
6250 cfm	EA (wb)	58	TC	158.3	158.3	179.4	149.9	149.9	170.2	141.0	141.0	160.5	131.6	131.6	150.2	121.6	121.6	139.3
			SHC	137.3	158.3	179.4	129.5	149.9	170.2	121.5	141.0	160.5	113.0	131.6	150.2	104.0	121.6	139.3
		62	TC	158.5	158.5	186.7	150.0	150.0	177.1	141.1	141.1	167.2	131.7	131.7	156.6	121.7	121.7	145.3
			SHC	130.3	158.5	186.7	122.9	150.0	177.1	115.1	141.1	167.2	106.9	131.7	156.6	98.2	121.7	145.3
		67	TC	169.8	169.8	169.8	159.6	159.6	162.5	148.8	148.8	156.4	137.6	137.6	150.0	125.8	125.8	143.4
			SHC	105.2	136.8	168.3	99.5	131.0	162.5	93.7	125.1	156.4	87.7	118.9	150.0	81.4	112.4	143.4
		72	TC	186.8	186.8	186.8	175.8	175.8	175.8	164.3	164.3	164.3	152.1	152.1	152.1	139.2	139.2	139.2
			SHC	73.6	105.2	136.7	68.0	99.5	130.9	62.3	93.6	124.9	56.3	87.5	118.7	50.2	81.2	112.2
		76	TC	—	200.0	200.0	—	188.2	188.2	—	175.8	175.8	—	162.6	162.6	—	—	—
			SHC	—	79.5	111.2	—	73.7	105.2	—	67.7	98.9	—	61.5	92.2	—	—	—

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF150 Single Stage Cooling Capacities

RHF150				AMBIENT TEMPERATURE (°F)														
				85			95			105			115			125		
				EA (db)			EA (db)			EA (db)			EA (db)			EA (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1900 cfm	EA (wb)	58	TC	64.9	64.9	74.5	60.3	60.3	69.5	55.4	55.4	64.4	50.4	50.4	59.0	45.2	45.2	53.3
			SHC	55.4	64.9	74.5	51.0	60.3	69.5	46.5	55.4	64.4	41.8	50.4	59.0	37.0	45.2	53.3
		62	TC	70.1	70.1	70.1	64.6	64.6	66.0	58.9	58.9	62.0	52.9	52.9	57.9	46.7	46.7	53.7
			SHC	49.4	59.6	69.9	45.5	55.7	66.0	41.5	51.7	62.0	37.4	47.7	57.9	33.3	43.5	53.7
		67	TC	79.5	79.5	79.5	73.6	73.6	73.6	67.5	67.5	67.5	61.1	61.1	61.1	54.5	54.5	54.5
			SHC	40.6	50.9	61.3	36.7	47.0	57.3	32.7	43.0	53.3	28.7	39.0	49.3	24.5	34.8	45.1
		72	TC	89.6	89.6	89.6	83.4	83.4	83.4	76.9	76.9	76.9	70.1	70.1	70.1	63.0	63.0	63.0
			SHC	31.7	42.1	52.4	27.8	38.1	48.5	23.8	34.1	44.5	19.7	30.0	40.3	15.5	25.8	36.1
		76	TC	—	98.1	98.1	—	91.5	91.5	—	84.5	84.5	—	77.3	77.3	—	69.5	69.5
			SHC	—	34.7	45.1	—	30.7	41.2	—	26.7	37.1	—	22.6	33.0	—	18.3	28.8
2200 cfm	EA (wb)	58	TC	69.9	69.9	80.0	65.0	65.0	74.8	59.9	59.9	69.3	54.6	54.6	63.6	49.0	49.0	57.6
			SHC	59.8	69.9	80.0	55.2	65.0	74.8	50.5	59.9	69.3	45.5	54.6	63.6	40.4	49.0	57.6
		62	TC	73.2	73.2	77.9	67.5	67.5	73.8	61.5	61.5	69.7	55.3	55.3	65.5	49.1	49.1	60.6
			SHC	54.3	66.1	77.9	50.3	62.1	73.8	46.2	57.9	69.7	42.0	53.8	65.5	37.6	49.1	60.6
		67	TC	82.6	82.6	82.6	76.5	76.5	76.5	70.1	70.1	70.1	63.5	63.5	63.5	56.6	56.6	56.6
			SHC	44.0	55.9	67.8	40.0	51.9	63.8	35.9	47.8	59.7	31.8	43.6	55.5	27.5	39.4	51.2
		72	TC	92.9	92.9	92.9	86.4	86.4	86.4	79.6	79.6	79.6	72.5	72.5	72.5	65.1	65.1	65.1
			SHC	33.5	45.4	57.3	29.5	41.4	53.3	25.4	37.3	49.1	21.2	33.1	44.9	17.0	28.8	40.6
		76	TC	—	101.2	101.2	—	94.2	94.2	—	86.8	86.8	—	79.1	79.1	—	71.0	71.0
			SHC	—	36.7	48.8	—	32.6	44.7	—	28.5	40.5	—	24.2	36.1	—	19.8	31.5
2500 cfm	EA (wb)	58	TC	74.2	74.2	84.7	69.0	69.0	79.2	63.6	63.6	73.5	58.1	58.1	67.5	52.2	52.2	61.2
			SHC	63.6	74.2	84.7	58.8	69.0	79.2	53.8	63.6	73.5	48.7	58.1	67.5	43.3	52.2	61.2
		62	TC	75.8	75.8	85.4	69.9	69.9	81.2	63.9	63.9	76.6	58.2	58.2	70.8	52.3	52.3	64.3
			SHC	58.9	72.2	85.4	54.8	68.0	81.2	50.5	63.6	76.6	45.6	58.2	70.8	40.4	52.3	64.3
		67	TC	85.1	85.1	85.1	78.7	78.7	78.7	72.2	72.2	72.2	65.3	65.3	65.3	58.2	58.2	58.2
			SHC	47.2	60.6	74.0	43.1	56.5	69.9	38.9	52.3	65.7	34.7	48.1	61.4	30.4	43.7	57.1
		72	TC	95.5	95.5	95.5	88.7	88.7	88.7	81.7	81.7	81.7	74.4	74.4	74.4	66.7	66.7	66.7
			SHC	35.0	48.5	61.9	31.0	44.4	57.8	26.8	40.2	53.6	22.6	35.9	49.2	18.2	31.5	44.8
		76	TC	—	103.4	103.4	—	96.0	96.0	—	88.4	88.4	—	80.4	80.4	—	72.0	72.0
			SHC	—	38.4	52.0	—	34.2	47.7	—	29.9	43.2	—	25.5	38.7	—	20.9	33.9
2850 cfm	EA (wb)	58	TC	78.4	78.4	89.4	73.0	73.0	83.6	67.4	67.4	77.6	61.5	61.5	71.3	55.4	55.4	64.7
			SHC	67.4	78.4	89.4	62.3	73.0	83.6	57.2	67.4	77.6	51.8	61.5	71.3	46.1	55.4	64.7
		62	TC	78.9	78.9	92.5	73.1	73.1	87.3	67.5	67.5	81.2	61.6	61.6	74.7	55.5	55.5	68.0
			SHC	63.4	78.0	92.5	58.9	73.1	87.3	53.8	67.5	81.2	48.6	61.6	74.7	43.1	55.5	68.0
		67	TC	87.4	87.4	87.4	80.8	80.8	80.8	74.1	74.1	74.1	67.0	67.0	68.1	59.7	59.7	63.6
			SHC	50.6	65.8	81.0	46.5	61.6	76.8	42.2	57.4	72.5	37.9	53.0	68.1	33.5	48.6	63.6
		72	TC	97.8	97.8	97.8	90.8	90.8	90.8	83.5	83.5	83.5	76.0	76.0	76.0	68.1	68.1	68.1
			SHC	36.7	51.8	67.0	32.5	47.6	62.7	28.3	43.3	58.4	24.0	39.0	54.0	19.5	34.4	49.3
		76	TC	—	105.1	105.1	—	97.5	97.5	—	89.6	89.6	—	81.3	81.3	—	72.5	72.5
			SHC	—	40.0	55.1	—	35.7	50.6	—	31.3	46.0	—	26.8	41.2	—	22.0	36.2
3150 cfm	EA (wb)	58	TC	81.5	81.5	92.9	75.9	75.9	86.9	70.1	70.1	80.7	64.1	64.1	74.2	57.8	57.8	67.3
			SHC	70.1	81.5	92.9	65.0	75.9	86.9	59.6	70.1	80.7	54.0	64.1	74.2	48.2	57.8	67.3
		62	TC	81.6	81.6	96.8	76.0	76.0	90.7	70.2	70.2	84.3	64.2	64.2	77.6	57.9	57.9	70.6
			SHC	66.4	81.6	96.8	61.4	76.0	90.7	56.2	70.2	84.3	50.7	64.2	77.6	45.1	57.9	70.6
		67	TC	89.0	89.0	89.0	82.3	82.3	82.4	75.4	75.4	78.1	68.3	68.3	73.6	60.8	60.8	69.0
			SHC	53.4	70.1	86.7	49.2	65.8	82.4	44.9	61.5	78.1	40.6	57.1	73.6	36.1	52.6	69.0
		72	TC	99.4	99.4	99.4	92.2	92.2	92.2	84.8	84.8	84.8	77.1	77.1	77.1	68.9	68.9	68.9
			SHC	37.9	54.5	71.1	33.7	50.2	66.8	29.4	45.9	62.3	25.1	41.4	57.8	20.5	36.8	53.0
		76	TC	—	106.2	106.2	—	98.4	98.4	—	90.2	90.2	—	81.7	81.7	—	72.9	72.9
			SHC	—	41.2	57.5	—	36.8	52.9	—	32.3	48.1	—	27.7	43.1	—	22.9	37.9

LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

Performance data (cont)

RHF090 Heating Capacities

RETURN AIR (°F db)	CFM (Standard Air)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db at 70% rh)								
			-10.0	0.0	10.0	17.0	30.0	40.0	47.0	50.0	60.0
55	2250	Capacity	21.5	29.6	41.6	48.7	63.0	74.8	86.4	89.8	103.7
		Int. Cap.	19.8	27.3	38.2	44.4	55.2	74.8	86.4	89.8	103.7
	3000	Capacity	22.7	31.0	43.1	50.3	65.1	77.6	89.6	93.2	108.1
		Int. Cap.	21.0	28.5	39.6	45.9	57.1	77.6	89.6	93.2	108.1
	3750	Capacity	24.1	32.3	44.5	51.6	66.9	79.4	92.0	95.6	111.3
		Int. Cap.	22.3	29.8	40.8	47.1	58.6	79.4	92.0	95.6	111.3
70	2250	Capacity	17.0	25.2	37.6	44.3	58.1	69.7	81.2	84.6	98.1
		Int. Cap.	15.8	23.1	34.5	40.4	50.9	69.7	81.2	84.6	98.1
	3000	Capacity	18.5	26.8	39.1	46.2	60.1	72.5	84.6	88.1	102.7
		Int. Cap.	17.1	24.6	35.9	42.1	52.7	72.5	84.6	88.1	102.7
	3750	Capacity	20.0	28.4	40.9	47.9	62.5	74.8	87.1	90.6	105.8
		Int. Cap.	18.5	26.2	37.5	43.7	54.7	74.8	87.1	90.6	105.8
80	2250	Capacity	13.7	21.9	34.4	41.3	54.8	66.0	78.0	81.1	94.3
		Int. Cap.	12.7	20.2	31.6	37.6	48.0	66.0	78.0	81.1	94.3
	3000	Capacity	15.2	23.6	36.2	43.2	57.2	69.0	81.2	84.5	98.8
		Int. Cap.	14.0	21.7	33.2	39.4	50.1	69.0	81.2	84.5	98.8
	3750	Capacity	16.9	25.3	37.9	45.0	59.2	71.3	83.7	87.1	102.0
		Int. Cap.	15.6	23.3	34.8	41.1	51.8	71.3	83.7	87.1	102.0

LEGEND

Capacity	—	Instantaneous Capacity (1000 Btuh) — includes indoor fan motor heat at AHRI static conditions
db	—	Dry Bulb
Int. Cap.	—	Integrated Capacity = instantaneous capacity minus the effects of frost on the OD coil and the heat required to defrost it
rh	—	Relative Humidity
	—	Standard rating point

RHF102 Heating Capacities

RETURN AIR (°F db)	CFM (Standard Air)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db at 70% rh)								
			-10.0	0.0	10.0	17.0	30.0	40.0	47.0	50.0	60.0
55	2550	Capacity	35.4	40.6	49.9	56.5	71.8	83.2	95.1	98.7	112.9
		Int. Cap.	32.7	37.4	45.8	51.5	62.9	83.2	95.1	98.7	112.9
	3400	Capacity	37.0	44.4	53.0	58.2	72.6	84.5	96.7	100.5	115.6
		Int. Cap.	34.2	40.9	48.7	53.0	63.7	84.5	96.7	100.5	115.6
	4250	Capacity	37.8	43.9	54.0	59.3	73.8	85.7	97.9	102.0	117.5
		Int. Cap.	34.9	40.4	49.5	54.1	64.6	85.7	97.9	102.0	117.5
70	2550	Capacity	33.5	39.5	49.0	55.7	69.3	80.4	92.0	95.8	108.9
		Int. Cap.	31.0	36.4	45.0	50.7	60.7	80.4	92.0	95.8	108.9
	3400	Capacity	35.0	40.5	49.9	56.4	70.1	81.7	93.7	97.6	111.7
		Int. Cap.	32.4	37.3	45.8	51.4	61.4	81.7	93.7	97.6	111.7
	4250	Capacity	35.9	43.4	52.1	57.6	70.9	82.9	95.0	98.8	113.7
		Int. Cap.	33.2	40.0	47.8	52.5	62.1	82.9	95.0	98.8	113.7
80	2550	Capacity	32.1	38.2	47.8	55.1	68.5	78.7	90.6	94.0	106.8
		Int. Cap.	29.7	35.2	43.9	50.2	60.0	78.7	90.6	94.0	106.8
	3400	Capacity	32.9	39.1	47.7	55.7	69.3	79.9	92.3	95.8	109.4
		Int. Cap.	30.4	36.0	43.8	50.8	60.7	79.9	92.3	95.8	109.4
	4250	Capacity	34.3	41.9	49.8	56.5	70.4	81.3	93.4	97.2	111.1
		Int. Cap.	31.7	38.6	45.7	51.5	61.7	81.3	93.4	97.2	111.1

LEGEND

Capacity	—	Instantaneous Capacity (1000 Btuh) — includes indoor fan motor heat at AHRI static conditions
db	—	Dry Bulb
Int. Cap.	—	Integrated Capacity = instantaneous capacity minus the effects of frost on the OD coil and the heat required to defrost it
rh	—	Relative Humidity
	—	Standard rating point

Performance data (cont)

RF120 Heating Capacities

RETURN AIR (°F db)	CFM (Standard Air)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db at 70% rh)								
			−10.0	0.0	10.0	17.0	30.0	40.0	47.0	50.0	60.0
55	3000	Capacity	—	45.7	56.2	68.9	85.6	99.7	114.7	118.6	135.8
		Int. Cap.	—	42.0	51.6	62.8	75.0	99.7	114.7	118.6	135.8
	4000	Capacity	—	47.7	58.4	70.2	88.2	102.9	118.2	122.2	140.6
		Int. Cap.	—	43.9	53.6	64.0	77.3	102.9	118.2	122.2	140.6
	5000	Capacity	—	50.5	61.2	72.9	91.1	106.2	121.6	125.8	144.8
		Int. Cap.	—	46.5	56.2	66.5	79.9	106.2	121.6	125.8	144.8
70	3000	Capacity	32.0	41.7	52.0	64.7	81.5	95.3	110.6	114.3	130.8
		Int. Cap.	29.6	38.4	47.7	59.0	71.4	95.3	110.6	114.3	130.8
	4000	Capacity	34.0	43.7	54.4	66.7	84.1	98.4	113.9	117.8	135.5
		Int. Cap.	31.5	40.2	50.0	60.8	73.7	98.4	113.9	117.8	135.5
	5000	Capacity	36.8	46.6	57.3	70.4	87.1	101.6	117.2	121.2	139.7
		Int. Cap.	34.0	42.8	52.6	64.2	76.3	101.6	117.2	121.2	139.7
80	3000	Capacity	29.6	39.2	49.6	62.6	79.0	92.4	108.0	111.7	127.6
		Int. Cap.	27.4	36.1	45.6	57.1	69.2	92.4	108.0	111.7	127.6
	4000	Capacity	31.6	41.3	51.8	64.6	81.5	95.5	111.2	115.0	132.0
		Int. Cap.	29.2	38.0	47.6	58.9	71.4	95.5	111.2	115.0	132.0
	5000	Capacity	34.4	44.1	54.7	67.4	84.5	98.7	114.6	118.5	136.2
		Int. Cap.	31.8	40.6	50.2	61.5	74.0	98.7	114.6	118.5	136.2

LEGEND

Capacity	—	Instantaneous Capacity (1000 Btuh) — includes indoor fan motor heat at AHRI static conditions
db	—	Dry Bulb
Int. Cap.	—	Integrated Capacity = instantaneous capacity minus the effects of frost on the OD coil and the heat required to defrost it
rh	—	Relative Humidity
	—	Standard rating point

RGF150 Heating Capacities

RETURN AIR (°F db)	CFM (Standard Air)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db at 70% rh)								
			−10.0	0.0	10.0	17.0	30.0	40.0	47.0	50.0	60.0
55	3750	Capacity	46.3	58.8	74.6	84.7	104.4	123.6	137.3	141.7	160.4
		Int. Cap.	42.9	54.1	68.5	77.3	91.5	123.6	137.3	141.7	160.4
	5000	Capacity	45.4	59.9	76.1	86.2	107.1	126.4	140.9	145.6	166.2
		Int. Cap.	42.0	55.2	69.9	78.6	93.8	126.4	140.9	145.6	166.2
	6250	Capacity	45.8	61.3	78.0	88.3	109.5	129.0	143.9	148.8	170.2
		Int. Cap.	42.4	56.4	71.6	80.5	96.0	129.0	143.9	148.8	170.2
70	3750	Capacity	43.7	56.4	71.9	82.0	100.9	119.8	132.9	137.1	155.4
		Int. Cap.	40.4	51.9	66.0	74.7	88.4	119.8	132.9	137.1	155.4
	5000	Capacity	43.1	57.5	73.4	83.4	103.5	122.6	136.5	141.0	160.6
		Int. Cap.	39.8	52.9	67.4	76.1	90.6	122.6	136.5	141.0	160.6
	6250	Capacity	44.1	59.0	75.2	85.8	105.8	125.1	139.5	144.1	164.5
		Int. Cap.	40.8	54.2	69.0	78.2	92.7	125.1	139.5	144.1	164.5
80	3750	Capacity	41.8	54.9	70.5	79.9	98.6	117.5	130.1	134.3	151.8
		Int. Cap.	38.7	50.6	64.7	72.9	86.4	117.5	130.1	134.3	151.8
	5000	Capacity	41.5	56.0	71.7	81.5	101.2	120.2	133.6	138.0	156.8
		Int. Cap.	38.4	51.5	65.8	74.3	88.6	120.2	133.6	138.0	156.8
	6250	Capacity	42.8	57.4	73.5	83.7	103.5	122.7	136.6	141.1	160.7
		Int. Cap.	39.6	52.9	67.5	76.3	90.7	122.7	136.6	141.1	160.7


LEGEND

Capacity	—	Instantaneous Capacity (1000 Btuh) — includes indoor fan motor heat at AHRI static conditions
db	—	Dry Bulb
Int. Cap.	—	Integrated Capacity = instantaneous capacity minus the effects of frost on the OD coil and the heat required to defrost it
rh	—	Relative Humidity


Performance data (cont)

Pressure Drop for Electric Heating Units

7.5 to 10 Ton Units

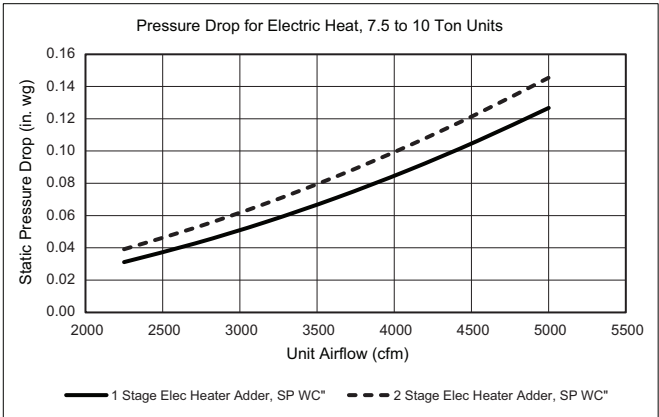


12.5 Ton Units

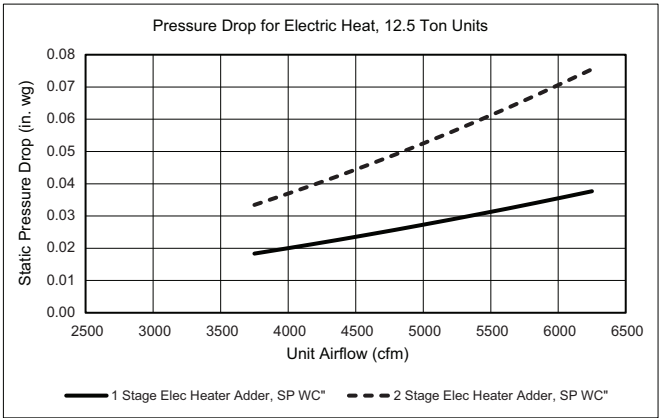


Performance data (cont)

Economizer Barometric Relief and Damper Leakage — 7.5 to 10 Ton Units


Horizontal Economizer Barometric Relief

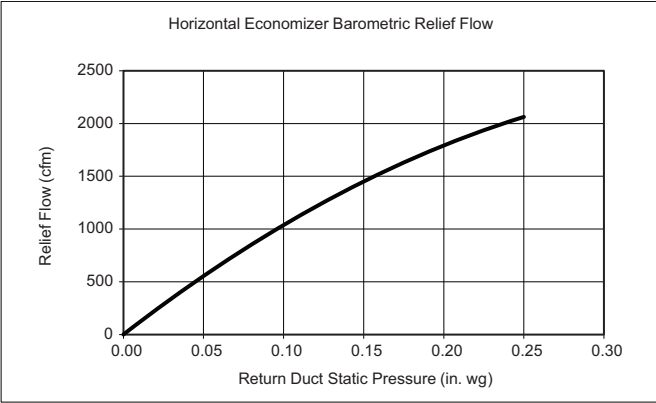


Vertical Economizer Barometric Relief

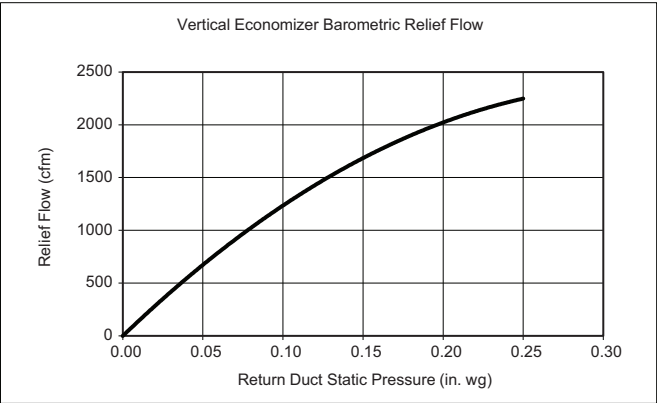

Horizontal Economizer Damper Leakage

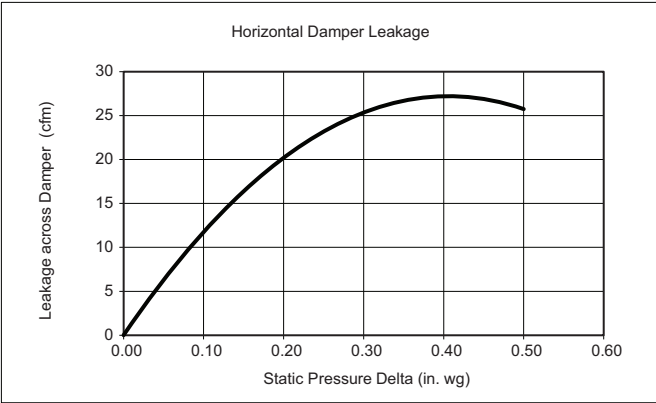


Vertical Economizer Damper Leakage

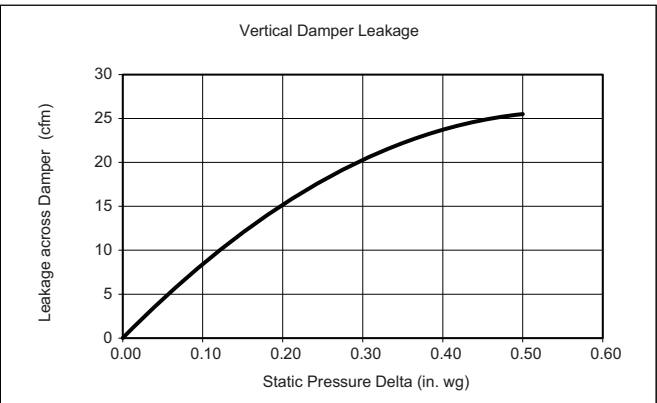


Performance data (cont)

Economizer Barometric Relief and Damper Leakage — 12.5 Ton Units


Horizontal Economizer Barometric Relief

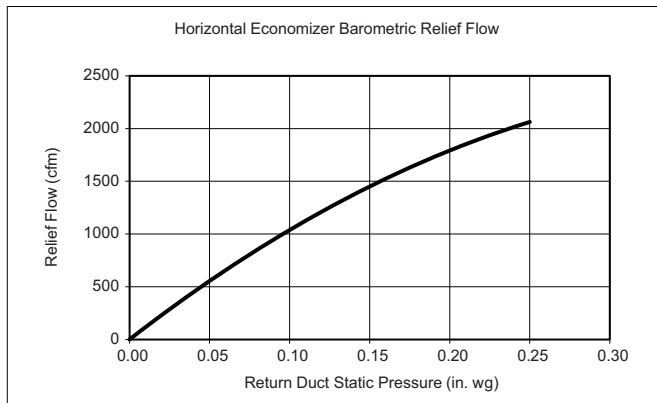


Vertical Economizer Barometric Relief

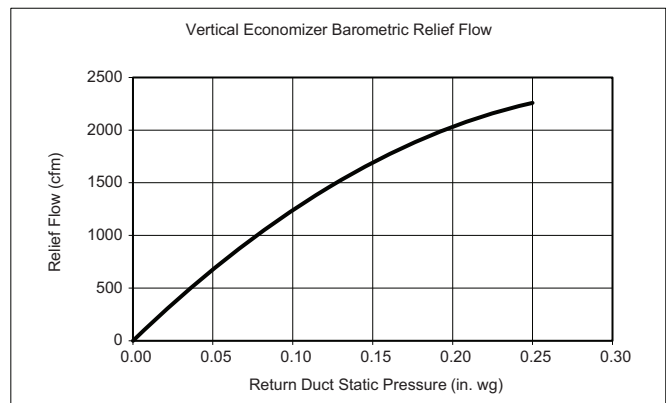

Horizontal Economizer Damper Leakage

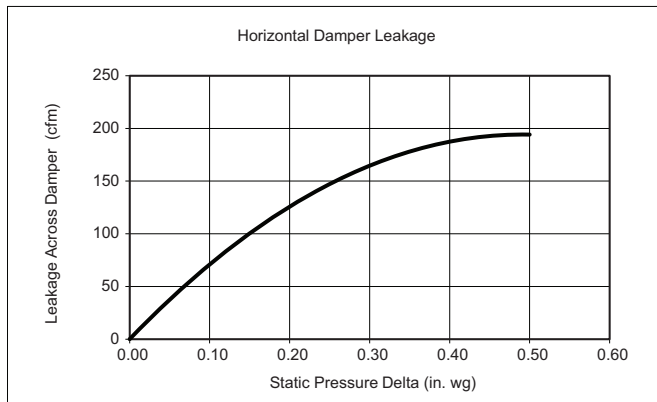


Vertical Economizer Damper Leakage

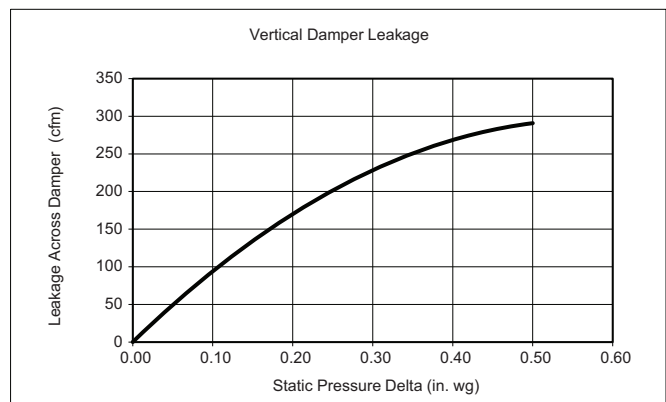


Economizer Pressure Drop

7.5 to 10 Ton Units

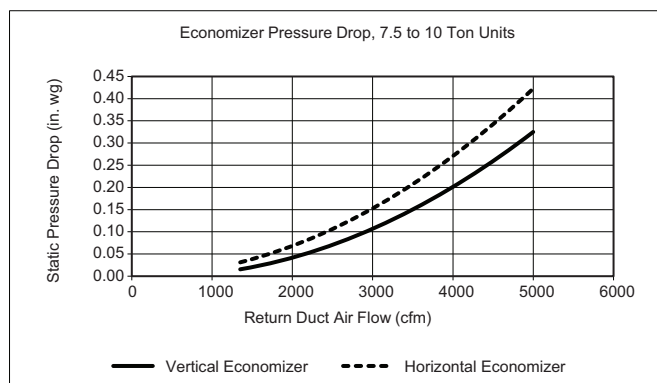

12.5 Ton Units

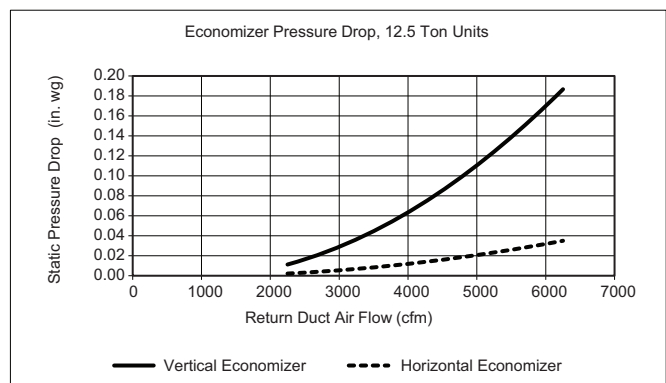

Fan data

General Fan Performance Notes

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, wet coils, and highest gas heat exchanger (when gas heat unit).
4. Factory options and accessories may effect static pressure losses. Gas heat unit fan tables assume highest gas heat models; for fan selections with low or medium heat models, the user must deduct low and medium heat static pressures. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
5. The fan performance tables offer motor/drive recommendations. In cases when 2 motor/drive combinations would work, the lower horsepower option is recommended.
6. For information on the electrical properties of the fan motors, please see the Electrical information section of this book.
7. For more information on the performance limits of the fan motors, see the application data section of this book.
8. The EPACT (Energy Policy Act of 1992) regulates energy requirements for specific types of indoor fan motors. Motors regulated by EPACT include any general purpose, T-frame (3-digit, 143 and larger), single-speed, foot mounted, polyphase, squirrel cage induction motors of NEMA (National Electrical Manufacturers Association) design A and B, manufactured for use in the United States. Ranging from 1 to 200 Hp, these continuous-duty motors operate on 230 and 460 volt, 60 Hz power. If a motor does not fit into these specifications, the motor does not have to be replaced by an EPACT compliant energy-efficient motor. Variable-speed motors are exempt from EPACT compliance requirements.

Fan data (cont)

RHF090 — 7.5 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	920	0.29	1045	0.43	1158	0.58	1262	0.75	1356	0.93
2440	980	0.35	1097	0.49	1205	0.65	1304	0.82	1397	1.01
2625	1039	0.41	1150	0.56	1252	0.72	1348	0.90	1438	1.09
2815	1101	0.49	1205	0.64	1303	0.81	1396	0.99	1482	1.19
3000	1163	0.57	1261	0.72	1355	0.90	1443	1.08	1527	1.28
3190	1226	0.66	1320	0.82	1409	1.00	1494	1.19	1575	1.39
3375	1289	0.75	1378	0.92	1463	1.10	1545	1.30	1623	1.51
3565	1354	0.86	1438	1.03	1520	1.22	1598	1.42	1674	1.63
3750	1417	0.97	1498	1.15	1576	1.33	1651	1.53	1724	1.75

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	1444	1.12	1527	1.33	1604	1.54	1678	1.76	1748	1.99
2440	1483	1.21	1564	1.42	1640	1.63	1713	1.86	1782	2.10
2625	1522	1.30	1602	1.51	1677	1.73	1748	1.96	1817	2.20
2815	1565	1.40	1642	1.61	1716	1.84	1786	2.08	1853	2.32
3000	1607	1.50	1683	1.72	1755	1.95	1824	2.19	1891	2.44
3190	1652	1.61	1727	1.84	1797	2.07	1865	2.31	1930	2.57
3375	1698	1.72	1770	1.95	1839	2.19	1906	2.44	1970	2.69
3565	1746	1.85	1816	2.08	1884	2.32	1949	2.57	2012	2.83
3750	1795	1.97	1863	2.20	1929	2.45	1993	2.70	2055	2.96

Std/Med Static 920-2000 rpm, 2.4 Max bhp

High Static 920-2200 rpm, 3.0 Max bhp

RHF090 — Standard/Medium Static — 7.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	920	4.4	1045	5.1	1158	5.7	1262	6.2	1356	6.7
2440	980	4.8	1097	5.4	1205	5.9	1304	6.4	1397	6.9
2625	1039	5.1	1150	5.6	1252	6.2	1348	6.6	1438	7.1
2815	1101	5.4	1205	5.9	1303	6.4	1396	6.9	1482	7.3
3000	1163	5.7	1261	6.2	1355	6.7	1443	7.1	1527	7.6
3190	1226	6.0	1320	6.5	1409	7.0	1494	7.4	1575	7.8
3375	1289	6.3	1378	6.8	1463	7.2	1545	7.7	1623	8.1
3565	1354	6.7	1438	7.1	1520	7.5	1598	7.9	1674	8.3
3750	1417	7.0	1498	7.4	1576	7.8	1651	8.2	1724	8.6

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	1444	7.1	1527	7.6	1604	8.0	1678	8.3	1748	8.7
2440	1483	7.3	1564	7.8	1640	8.1	1713	8.5	1782	8.9
2625	1522	7.5	1602	8.0	1677	8.3	1748	8.7	1817	9.1
2815	1565	7.8	1642	8.2	1716	8.5	1786	8.9	1853	9.2
3000	1607	8.0	1683	8.4	1755	8.7	1824	9.1	1891	9.4
3190	1652	8.2	1727	8.6	1797	9.0	1865	9.3	—	—
3375	1698	8.4	1770	8.8	1839	9.2	1906	9.5	—	—
3565	1746	8.7	1816	9.1	1884	9.4	—	—	—	—
3750	1795	8.9	1863	9.3	1929	9.6	—	—	—	—

Std/Med Static 920-2000 rpm

Fan data (cont)

RHF090 — High Static — 7.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	920	4.1	1045	4.7	1158	5.2	1262	5.7	1356	6.1
2440	980	4.4	1097	4.9	1205	5.4	1304	5.9	1397	6.3
2625	1039	4.6	1150	5.2	1252	5.6	1348	6.1	1438	6.5
2815	1101	4.9	1205	5.4	1303	5.9	1396	6.3	1482	6.7
3000	1163	5.2	1261	5.7	1355	6.1	1443	6.5	1527	6.9
3190	1226	5.5	1320	5.9	1409	6.3	1494	6.7	1575	7.1
3375	1289	5.8	1378	6.2	1463	6.6	1545	7.0	1623	7.3
3565	1354	6.1	1438	6.5	1520	6.9	1598	7.2	1674	7.6
3750	1417	6.4	1498	6.8	1576	7.1	1651	7.5	1724	7.8

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	1444	6.5	1527	6.9	1604	7.2	1678	7.6	1748	7.9
2440	1483	6.7	1564	7.1	1640	7.4	1713	7.8	1782	8.1
2625	1522	6.9	1602	7.2	1677	7.6	1748	7.9	1817	8.2
2815	1565	7.1	1642	7.4	1716	7.8	1786	8.1	1853	8.4
3000	1607	7.3	1683	7.6	1755	7.9	1824	8.3	1891	8.6
3190	1652	7.5	1727	7.8	1797	8.1	1865	8.5	1930	8.8
3375	1698	7.7	1770	8.0	1839	8.3	1906	8.6	1970	8.9
3565	1746	7.9	1816	8.2	1884	8.5	1949	8.8	2012	9.1
3750	1795	8.1	1863	8.4	1929	8.7	1993	9.0	2055	9.3

High Static 920-2200 rpm

Fan data (cont)

RHF102 — 8.5 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	1035	0.41	1147	0.56	1251	0.73	1348	0.91	1438	1.11
2765	1104	0.50	1209	0.65	1308	0.83	1401	1.02	1488	1.22
2975	1173	0.59	1272	0.76	1365	0.93	1454	1.13	1538	1.34
3190	1244	0.70	1337	0.87	1426	1.06	1511	1.26	1592	1.47
3400	1314	0.82	1402	0.99	1487	1.19	1568	1.39	1646	1.61
3615	1387	0.95	1470	1.13	1551	1.33	1629	1.54	1703	1.76
3825	1458	1.09	1538	1.28	1615	1.48	1689	1.69	1761	1.92
4040	1532	1.24	1608	1.44	1681	1.64	1752	1.86	1822	2.09
4250	1605	1.41	1677	1.60	1747	1.81	1815	2.03	1882	2.27

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	522	1.32	1602	1.53	1677	1.76	1749	2.00	1817	2.24
2765	1570	1.43	1647	1.65	1721	1.89	1792	2.13	1859	2.38
2975	1618	1.56	1693	1.78	1766	2.02	1835	2.27	1901	2.52
3190	1669	1.69	1743	1.93	1813	2.17	1881	2.42	1946	2.68
3400	1721	1.84	1792	2.07	1861	2.32	1927	2.58	1991	2.84
3615	1776	2.00	1845	2.24	1912	2.49	1976	2.75	2039	3.02
3825	1831	2.16	1898	2.40	1963	2.66	2026	2.92	2087	3.20
4040	1889	2.33	1954	2.58	2017	2.84	2078	3.11	—	—
4250	1947	2.51	2010	2.76	2071	3.02	—	—	—	—

Std/Med Static 1035-2000 rpm, 2.4 Max bhp

High Static 1035-2200 rpm, 3.0 Max bhp

RHF102 — Standard/Medium Static — 8.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	1035	5.0	1147	5.6	1251	6.1	1348	6.6	1438	7.1
2765	1104	5.4	1209	5.9	1308	6.4	1401	6.9	1488	7.4
2975	1173	5.7	1272	6.3	1365	6.7	1454	7.2	1538	7.6
3190	1244	6.1	1337	6.6	1426	7.0	1511	7.5	1592	7.9
3400	1314	6.5	1402	6.9	1487	7.4	1568	7.8	1646	8.2
3615	1387	6.8	1470	7.3	1551	7.7	1629	8.1	1703	8.5
3825	1458	7.2	1538	7.6	1615	8.0	1689	8.4	1761	8.8
4040	1532	7.6	1608	8.0	1681	8.4	1752	8.7	1822	9.1
4250	1605	8.0	1677	8.3	1747	8.7	1815	9.0	1882	9.4

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	1522	7.5	1602	8.0	1677	8.3	1749	8.7	1817	9.1
2765	1570	7.8	1647	8.2	1721	8.6	1792	8.9	1859	9.3
2975	1618	8.0	1693	8.4	1766	8.8	1835	9.2	1901	9.5
3190	1669	8.3	1743	8.7	1813	9.0	1881	9.4	—	—
3400	1721	8.6	1792	8.9	1861	9.3	—	—	—	—
3615	1776	8.8	1845	9.2	1912	9.5	—	—	—	—
3825	1831	9.1	1898	9.5	—	—	—	—	—	—
4040	1889	9.4	—	—	—	—	—	—	—	—
4250	1947	9.7	—	—	—	—	—	—	—	—

Std/Med Static 1035-2000 rpm

Fan data (cont)

RHF102 — High Static — 8.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	1035	4.6	1147	5.1	1251	5.6	1348	6.1	1438	6.5
2765	1104	4.9	1209	5.4	1308	5.9	1401	6.3	1488	6.7
2975	1173	5.3	1272	5.7	1365	6.1	1454	6.6	1538	6.9
3190	1244	5.6	1337	6.0	1426	6.4	1511	6.8	1592	7.2
3400	1314	5.9	1402	6.3	1487	6.7	1568	7.1	1646	7.4
3615	1387	6.2	1470	6.6	1551	7.0	1629	7.4	1703	7.7
3825	1458	6.6	1538	6.9	1615	7.3	1689	7.6	1761	8.0
4040	1532	6.9	1608	7.3	1681	7.6	1752	7.9	1822	8.3
4250	1605	7.3	1677	7.6	1747	7.9	1815	8.2	1882	8.5

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	1522	6.9	1602	7.2	1677	7.6	1749	7.9	1817	8.2
2765	1570	7.1	1647	7.4	1721	7.8	1792	8.1	1859	8.4
2975	1618	7.3	1693	7.7	1766	8.0	1835	8.3	1901	8.6
3190	1669	7.5	1743	7.9	1813	8.2	1881	8.5	1946	8.8
3400	1721	7.8	1792	8.1	1861	8.4	1927	8.7	1991	9.0
3615	1776	8.0	1845	8.4	1912	8.7	1976	9.0	2039	9.3
3825	1831	8.3	1898	8.6	1963	8.9	2026	9.2	2087	9.5
4040	1889	8.6	1954	8.9	2017	9.2	2078	9.4	—	—
4250	1947	8.8	2010	9.1	2071	9.4	—	—	—	—

High Static 1035-2200 rpm

Fan data (cont)

RHF120 — 10 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3000	1181	0.60	1279	0.77	1372	0.95	1461	1.14	1544	1.35
3250	1264	0.73	1356	0.91	1443	1.09	1527	1.29	1607	1.51
3500	1348	0.88	1434	1.06	1517	1.25	1596	1.46	1673	1.68
3750	1433	1.04	1514	1.23	1592	1.43	1667	1.64	1740	1.86
4000	1518	1.21	1595	1.41	1669	1.61	1740	1.83	1810	2.06
4250	1605	1.41	1677	1.60	1747	1.81	1815	2.03	1882	2.27
4500	1691	1.60	1760	1.81	1826	2.02	1892	2.24	1955	2.48
4750	1778	1.81	1843	2.01	1907	2.23	1969	2.46	2030	2.69
5000	1866	2.02	1928	2.23	1988	2.44	2048	2.67	2106	2.91

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3000	1624	1.57	1699	1.80	1771	2.04	1840	2.29	1906	2.54
3250	1684	1.73	1757	1.97	1827	2.21	1894	2.47	1958	2.72
3500	1746	1.91	1817	2.15	1884	2.40	1950	2.66	2013	2.92
3750	1811	2.10	1879	2.34	1945	2.60	2008	2.86	2070	3.13
4000	1878	2.30	1943	2.55	2007	2.81	2069	3.08	2128	3.35
4250	1947	2.51	2010	2.76	2071	3.02	2131	3.29	2189	3.56
4500	2017	2.72	2078	2.97	2138	3.24	2195	3.50	—	—
4750	2090	2.94	2148	3.19	—	—	—	—	—	—
5000	2164	3.15	—	—	—	—	—	—	—	—

Std/Med Static 1181-2000 rpm, 2.4 Max bhp

High Static 1181-2200 rpm, 5.0 Max bhp

RHF120 — Standard/Medium Static — 10 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1181	5.8	1279	6.3	1372	6.8	1461	7.2	1544	7.7
3250	1264	6.2	1356	6.7	1443	7.1	1527	7.6	1607	8.0
3500	1348	6.6	1434	7.1	1517	7.5	1596	7.9	1673	8.3
3750	1433	7.1	1514	7.5	1592	7.9	1667	8.3	1740	8.7
4000	1518	7.5	1595	7.9	1669	8.3	1740	8.7	1810	9.0
4250	1605	8.0	1677	8.3	1747	8.7	1815	9.0	1882	9.4
4500	1691	8.4	1760	8.8	1826	9.1	1892	9.4	1955	9.8
4750	1778	8.9	1843	9.2	1907	9.5	1969	9.8	—	—
5000	1866	9.3	1928	9.6	1988	9.9	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1624	8.1	1699	8.5	1771	8.8	1840	9.2	1906	9.5
3250	1684	8.4	1757	8.8	1827	9.1	1894	9.5	—	—
3500	1746	8.7	1817	9.1	1884	9.4	—	—	—	—
3750	1811	9.0	1879	9.4	—	—	—	—	—	—
4000	1878	9.4	1943	9.7	—	—	—	—	—	—
4250	1947	9.7	—	—	—	—	—	—	—	—
4500	—	—	—	—	—	—	—	—	—	—
4750	—	—	—	—	—	—	—	—	—	—
5000	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1181-2000 rpm

Fan data (cont)

RHF120 — High Static — 10 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1181	5.3	1279	5.7	1372	6.2	1461	6.6	1544	7.0
3250	1264	5.7	1356	6.1	1443	6.5	1527	6.9	1607	7.3
3500	1348	6.1	1434	6.5	1517	6.8	1596	7.2	1673	7.6
3750	1433	6.5	1514	6.8	1592	7.2	1667	7.5	1740	7.9
4000	1518	6.9	1595	7.2	1669	7.5	1740	7.9	1810	8.2
4250	1605	7.3	1677	7.6	1747	7.9	1815	8.2	1882	8.5
4500	1691	7.7	1760	8.0	1826	8.3	1892	8.6	1955	8.9
4750	1778	8.1	1843	8.4	1907	8.6	1969	8.9	2030	9.2
5000	1866	8.5	1928	8.7	1988	9.0	2048	9.3	2106	9.6

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1624	7.3	1699	7.7	1771	8.0	1840	8.3	1906	8.6
3250	1684	7.6	1757	8.0	1827	8.3	1894	8.6	1958	8.9
3500	1746	7.9	1817	8.2	1884	8.5	1950	8.8	2013	9.1
3750	1811	8.2	1879	8.5	1945	8.8	2008	9.1	2070	9.4
4000	1878	8.5	1943	8.8	2007	9.1	2069	9.4	2128	9.7
4250	1947	8.8	2010	9.1	2071	9.4	2131	9.7	2189	9.9
4500	2017	9.2	2078	9.4	2138	9.7	2195	10.0	—	—
4750	2090	9.5	2148	9.8	—	—	—	—	—	—
5000	2164	9.8	—	—	—	—	—	—	—	—

High Static 1181-2200 rpm

Fan data (cont)

RHF150 — 12.5 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	947	0.45	1044	0.60	1140	0.78	1236	0.99	1329	1.23
4065	1019	0.55	1108	0.71	1197	0.90	1286	1.11	1373	1.36
4375	1091	0.68	1174	0.85	1257	1.04	1339	1.26	1421	1.50
4690	1164	0.82	1242	1.00	1319	1.20	1396	1.42	1473	1.67
5000	1237	0.98	1310	1.16	1383	1.37	1455	1.60	1527	1.85
5315	1312	1.16	1381	1.35	1449	1.56	1517	1.79	1585	2.05
5625	1387	1.36	1452	1.56	1516	1.77	1580	2.00	1645	2.26
5940	1463	1.57	1524	1.77	1585	2.00	1646	2.23	1707	2.49
6250	1537	1.79	1596	2.01	1654	2.23	1712	2.48	1770	2.74

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	1419	1.50	1506	1.79	1589	2.11	1668	2.44	1743	2.78
4065	1459	1.63	1542	1.92	1622	2.24	1699	2.57	1773	2.92
4375	1502	1.77	1581	2.07	1658	2.38	1732	2.72	1805	3.08
4690	1549	1.94	1624	2.23	1698	2.55	1769	2.88	1839	3.24
5000	1599	2.12	1670	2.41	1740	2.73	1809	3.07	1877	3.43
5315	1653	2.32	1721	2.62	1787	2.93	1853	3.27	1918	3.63
5625	1709	2.54	1773	2.83	1836	3.14	1899	3.48	1961	3.83
5940	1768	2.77	1829	3.07	1889	3.38	1949	3.71	2008	4.06
6250	1828	3.01	1886	3.31	1943	3.62	2001	3.95	2057	4.29

Std/Med Static 947-2200 rpm, 3.0 Max bhp

High Static 947-2200 rpm, 5.0 Max bhp

RHF150 — Standard/Medium Static — 12.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	947	4.2	1044	4.7	1140	5.1	1236	5.6	1329	6.0
4065	1019	4.5	1108	5.0	1197	5.4	1286	5.8	1373	6.2
4375	1091	4.9	1174	5.3	1257	5.6	1339	6.0	1421	6.4
4690	1164	5.2	1242	5.6	1319	5.9	1396	6.3	1473	6.6
5000	1237	5.6	1310	5.9	1383	6.2	1455	6.6	1527	6.9
5315	1312	5.9	1381	6.2	1449	6.5	1517	6.8	1585	7.2
5625	1387	6.2	1452	6.5	1516	6.8	1580	7.1	1645	7.4
5940	1463	6.6	1524	6.9	1585	7.2	1646	7.4	1707	7.7
6250	1537	6.9	1596	7.2	1654	7.5	1712	7.7	1770	8.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	1419	6.4	1506	6.8	1589	7.2	1668	7.5	1743	7.9
4065	1459	6.6	1542	7.0	1622	7.3	1699	7.7	1773	8.0
4375	1502	6.8	1581	7.1	1658	7.5	1732	7.8	1805	8.2
4690	1549	7.0	1624	7.3	1698	7.7	1769	8.0	—	—
5000	1599	7.2	1670	7.6	1740	7.9	1809	8.2	—	—
5315	1653	7.5	1721	7.8	1787	8.1	—	—	—	—
5625	1709	7.7	1773	8.0	1836	8.3	—	—	—	—
5940	1768	8.0	1829	8.3	—	—	—	—	—	—
6250	1828	8.3	—	—	—	—	—	—	—	—

Std/Med Static 947-2200 rpm

Fan data (cont)

RHF150 — High Static — 12.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	947	4.2	1044	4.7	1140	5.1	1236	5.6	1329	6.0
4065	1019	4.5	1108	5.0	1197	5.4	1286	5.8	1373	6.2
4375	1091	4.9	1174	5.3	1257	5.6	1339	6.0	1421	6.4
4690	1164	5.2	1242	5.6	1319	5.9	1396	6.3	1473	6.6
5000	1237	5.6	1310	5.9	1383	6.2	1455	6.6	1527	6.9
5315	1312	5.9	1381	6.2	1449	6.5	1517	6.8	1585	7.2
5625	1387	6.2	1452	6.5	1516	6.8	1580	7.1	1645	7.4
5940	1463	6.6	1524	6.9	1585	7.2	1646	7.4	1707	7.7
6250	1537	6.9	1596	7.2	1654	7.5	1712	7.7	1770	8.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	1419	6.4	1506	6.8	1589	7.2	1668	7.5	1743	7.9
4065	1459	6.6	1542	7.0	1622	7.3	1699	7.7	1773	8.0
4375	1502	6.8	1581	7.1	1658	7.5	1732	7.8	1805	8.2
4690	1549	7.0	1624	7.3	1698	7.7	1769	8.0	1839	8.3
5000	1599	7.2	1670	7.6	1740	7.9	1809	8.2	1877	8.5
5315	1653	7.5	1721	7.8	1787	8.1	1853	8.4	1918	8.7
5625	1709	7.7	1773	8.0	1836	8.3	1899	8.6	1961	8.9
5940	1768	8.0	1829	8.3	1889	8.6	1949	8.8	2008	9.1
6250	1828	8.3	1886	8.6	1943	8.8	2001	9.1	2057	9.3

High Static 947-2200 rpm

Fan data (cont)

RHF090 — 7.5 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	861	0.24	993	0.37	1116	0.52	1227	0.69	1329	0.88
2440	915	0.28	1038	0.41	1155	0.57	1262	0.74	1362	0.94
2625	969	0.33	1084	0.47	1195	0.63	1299	0.81	1396	1.00
2815	1026	0.39	1134	0.53	1238	0.69	1338	0.87	1432	1.07
3000	1082	0.46	1183	0.60	1283	0.76	1378	0.94	1469	1.14
3190	1140	0.53	1236	0.67	1330	0.84	1421	1.02	1509	1.23
3375	1198	0.61	1288	0.75	1378	0.92	1465	1.11	1549	1.31
3565	1257	0.69	1343	0.84	1428	1.01	1512	1.20	1593	1.40
3750	1316	0.78	1398	0.93	1479	1.10	1558	1.29	1637	1.50

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	1422	1.07	1508	1.28	1589	1.50	1665	1.72	1736	1.95
2440	1454	1.14	1539	1.35	1620	1.58	1695	1.80	1767	2.04
2625	1486	1.21	1571	1.43	1650	1.65	1725	1.89	1797	2.13
2815	1520	1.28	1604	1.50	1682	1.73	1757	1.98	1828	2.23
3000	1555	1.36	1637	1.58	1715	1.82	1789	2.07	1859	2.32
3190	1593	1.44	1673	1.67	1749	1.91	1822	2.16	1892	2.42
3375	1631	1.53	1709	1.76	1784	2.00	1855	2.25	1924	2.51
3565	1672	1.62	1747	1.85	1821	2.09	1891	2.35	1959	2.61
3750	1713	1.71	1786	1.94	1858	2.19	1927	2.44	1993	2.70

Std/Med Static 861-2000 rpm, 2.4 Max bhp

High Static 861-2200 rpm, 3.0 Max bhp

RHF090 — Standard/Medium Static — 7.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	861	4.1	993	4.8	1116	5.5	1227	6.0	1329	6.5
2440	915	4.4	1038	5.1	1155	5.7	1262	6.2	1362	6.7
2625	969	4.7	1084	5.3	1195	5.9	1299	6.4	1396	6.9
2815	1026	5.0	1134	5.5	1238	6.1	1338	6.6	1432	7.1
3000	1082	5.3	1183	5.8	1283	6.3	1378	6.8	1469	7.3
3190	1140	5.6	1236	6.1	1330	6.6	1421	7.0	1509	7.5
3375	1198	5.9	1288	6.3	1378	6.8	1465	7.2	1549	7.7
3565	1257	6.2	1343	6.6	1428	7.1	1512	7.5	1593	7.9
3750	1316	6.5	1398	6.9	1479	7.3	1558	7.7	1637	8.1

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	1422	7.0	1508	7.5	1589	7.9	1665	8.3	1736	8.6
2440	1454	7.2	1539	7.6	1620	8.0	1695	8.4	1767	8.8
2625	1486	7.4	1571	7.8	1650	8.2	1725	8.6	1797	9.0
2815	1520	7.5	1604	8.0	1682	8.4	1757	8.8	1828	9.1
3000	1555	7.7	1637	8.1	1715	8.5	1789	8.9	1859	9.3
3190	1593	7.9	1673	8.3	1749	8.7	1822	9.1	1892	9.4
3375	1631	8.1	1709	8.5	1784	8.9	1855	9.3	1924	9.6
3565	1672	8.3	1747	8.7	1821	9.1	1891	9.4	—	—
3750	1713	8.5	1786	8.9	1858	9.3	1927	9.6	—	—

Std/Med Static 861-2000 rpm

Fan data (cont)

RHF090 — High Static — 7.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	861	3.8	993	4.4	1116	5.0	1227	5.5	1329	6.0
2440	915	4.1	1038	4.6	1155	5.2	1262	5.7	1362	6.1
2625	969	4.3	1084	4.8	1195	5.4	1299	5.8	1396	6.3
2815	1026	4.6	1134	5.1	1238	5.6	1338	6.0	1432	6.5
3000	1082	4.8	1183	5.3	1283	5.8	1378	6.2	1469	6.6
3190	1140	5.1	1236	5.6	1330	6.0	1421	6.4	1509	6.8
3375	1198	5.4	1288	5.8	1378	6.2	1465	6.6	1549	7.0
3565	1257	5.6	1343	6.0	1428	6.4	1512	6.8	1593	7.2
3750	1316	5.9	1398	6.3	1479	6.7	1558	7.0	1637	7.4

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2250	1422	6.4	1508	6.8	1589	7.2	1665	7.5	1736	7.9
2440	1454	6.6	1539	6.9	1620	7.3	1695	7.7	1767	8.0
2625	1486	6.7	1571	7.1	1650	7.5	1725	7.8	1797	8.1
2815	1520	6.9	1604	7.2	1682	7.6	1757	8.0	1828	8.3
3000	1555	7.0	1637	7.4	1715	7.8	1789	8.1	1859	8.4
3190	1593	7.2	1673	7.6	1749	7.9	1822	8.3	1892	8.6
3375	1631	7.4	1709	7.7	1784	8.1	1855	8.4	1924	8.7
3565	1672	7.6	1747	7.9	1821	8.3	1891	8.6	1959	8.9
3750	1713	7.8	1786	8.1	1858	8.4	1927	8.7	1993	9.0

High Static 861-2200 rpm

Fan data (cont)

RHF102 — 8.5 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	967	0.34	1085	0.48	1198	0.64	1303	0.83	1400	1.02
2765	1030	0.40	1140	0.55	1246	0.72	1346	0.90	1441	1.11
2975	1092	0.48	1195	0.63	1295	0.80	1391	0.99	1482	1.20
3190	1157	0.56	1254	0.72	1348	0.89	1439	1.08	1527	1.30
3400	1222	0.66	1312	0.81	1402	0.99	1489	1.19	1573	1.40
3615	1288	0.76	1374	0.92	1458	1.10	1541	1.30	1621	1.52
3825	1354	0.87	1435	1.04	1515	1.22	1594	1.42	1671	1.64
4040	1422	1.00	1498	1.16	1575	1.35	1650	1.55	1724	1.77
4250	1488	1.12	1561	1.29	1634	1.48	1706	1.69	1776	1.90

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	1490	1.23	1575	1.46	1654	1.69	1729	1.93	1800	2.18
2765	1529	1.32	1612	1.55	1691	1.79	1765	2.04	1835	2.29
2975	1568	1.42	1650	1.65	1727	1.89	1801	2.15	1871	2.41
3190	1611	1.52	1690	1.76	1766	2.00	1839	2.26	1908	2.53
3400	1654	1.63	1731	1.87	1806	2.12	1877	2.38	1945	2.65
3615	1699	1.75	1775	1.99	1847	2.24	1917	2.51	1985	2.79
3825	1746	1.87	1819	2.12	1890	2.37	1958	2.64	2024	2.92
4040	1796	2.00	1866	2.25	1935	2.51	2001	2.77	2066	3.05
4250	1846	2.14	1914	2.38	1980	2.64	2045	2.91	2108	3.18

Std/Med Static 967-2000 rpm, 2.4 Max bhp

High Static 967-2200 rpm, 3.0 Max bhp

RHF102 — Standard/Medium Static — 8.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	967	4.7	1085	5.3	1198	5.9	1303	6.4	1400	6.9
2765	1030	5.0	1140	5.6	1246	6.1	1346	6.6	1441	7.1
2975	1092	5.3	1195	5.9	1295	6.4	1391	6.9	1482	7.3
3190	1157	5.7	1254	6.2	1348	6.6	1439	7.1	1527	7.6
3400	1222	6.0	1312	6.5	1402	6.9	1489	7.4	1573	7.8
3615	1288	6.3	1374	6.8	1458	7.2	1541	7.6	1621	8.1
3825	1354	6.7	1435	7.1	1515	7.5	1594	7.9	1671	8.3
4040	1422	7.0	1498	7.4	1575	7.8	1650	8.2	1724	8.6
4250	1488	7.4	1561	7.7	1634	8.1	1706	8.5	1776	8.8

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	1490	7.4	1575	7.8	1654	8.2	1729	8.6	1800	9.0
2765	1529	7.6	1612	8.0	1691	8.4	1765	8.8	1835	9.2
2975	1568	7.8	1650	8.2	1727	8.6	1801	9.0	1871	9.3
3190	1611	8.0	1690	8.4	1766	8.8	1839	9.2	1908	9.5
3400	1654	8.2	1731	8.6	1806	9.0	1877	9.4	—	—
3615	1699	8.5	1775	8.8	1847	9.2	1917	9.6	—	—
3825	1746	8.7	1819	9.1	1890	9.4	—	—	—	—
4040	1796	9.0	1866	9.3	1935	9.7	—	—	—	—
4250	1846	9.2	1914	9.6	—	—	—	—	—	—

Std/Med Static 967-2000 rpm

Fan data (cont)

RHF102 — High Static — 8.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	967	4.3	1085	4.9	1198	5.4	1303	5.9	1400	6.3
2765	1030	4.6	1140	5.1	1246	5.6	1346	6.1	1441	6.5
2975	1092	4.9	1195	5.4	1295	5.8	1391	6.3	1482	6.7
3190	1157	5.2	1254	5.6	1348	6.1	1439	6.5	1527	6.9
3400	1222	5.5	1312	5.9	1402	6.3	1489	6.7	1573	7.1
3615	1288	5.8	1374	6.2	1458	6.6	1541	7.0	1621	7.3
3825	1354	6.1	1435	6.5	1515	6.8	1594	7.2	1671	7.6
4040	1422	6.4	1498	6.8	1575	7.1	1650	7.5	1724	7.8
4250	1488	6.7	1561	7.1	1634	7.4	1706	7.7	1776	8.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
2550	1490	6.7	1575	7.1	1654	7.5	1729	7.8	1800	8.2
2765	1529	6.9	1612	7.3	1691	7.7	1765	8.0	1835	8.3
2975	1568	7.1	1650	7.5	1727	7.8	1801	8.2	1871	8.5
3190	1611	7.3	1690	7.6	1766	8.0	1839	8.3	1908	8.7
3400	1654	7.5	1731	7.8	1806	8.2	1877	8.5	1945	8.8
3615	1699	7.7	1775	8.0	1847	8.4	1917	8.7	1985	9.0
3825	1746	7.9	1819	8.2	1890	8.6	1958	8.9	2024	9.2
4040	1796	8.1	1866	8.5	1935	8.8	2001	9.1	2066	9.4
4250	1846	8.4	1914	8.7	1980	9.0	2045	9.3	2108	9.6

High Static 967-2200 rpm

Fan data (cont)

RHF120 — 10 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3000	1100	0.49	1202	0.64	1301	0.81	1396	1.00	1487	1.21
3250	1176	0.59	1270	0.74	1363	0.92	1453	1.11	1539	1.32
3500	1252	0.70	1341	0.86	1428	1.04	1512	1.24	1595	1.45
3750	1330	0.83	1413	1.00	1495	1.18	1575	1.38	1653	1.60
4000	1409	0.97	1487	1.14	1563	1.33	1639	1.53	1714	1.75
4250	1488	1.12	1561	1.29	1634	1.48	1706	1.69	1776	1.90
4500	1568	1.28	1637	1.45	1706	1.65	1774	1.85	1841	2.07
4750	1648	1.44	1714	1.62	1779	1.81	1844	2.02	1908	2.23
5000	1728	1.61	1791	1.79	1853	1.98	1915	2.19	1976	2.40

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3000	1573	1.43	1654	1.66	1732	1.91	1805	2.16	1875	2.42
3250	1622	1.55	1702	1.79	1777	2.04	1849	2.29	1919	2.57
3500	1674	1.68	1751	1.92	1825	2.18	1895	2.44	1964	2.72
3750	1729	1.83	1803	2.07	1874	2.33	1943	2.59	2010	2.87
4000	1786	1.98	1857	2.22	1926	2.48	1993	2.75	2058	3.03
4250	1846	2.14	1914	2.38	1980	2.64	2045	2.91	2108	3.18
4500	1908	2.30	1973	2.54	2036	2.80	2099	3.06	2160	3.34
4750	1971	2.46	2034	2.71	2095	2.96	2155	3.22	—	—
5000	2036	2.63	2096	2.87	2155	3.11	—	—	—	—

Std/Med Static 1100-2000 rpm, 2.4 Max bhp

High Static 1100-2200 rpm, 5.0 Max bhp

RHF120 — Standard/Medium Static — 10 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1100	5.4	1202	5.9	1301	6.4	1396	6.9	1487	7.4
3250	1176	5.8	1270	6.2	1363	6.7	1453	7.2	1539	7.6
3500	1252	6.2	1341	6.6	1428	7.1	1512	7.5	1595	7.9
3750	1330	6.6	1413	7.0	1495	7.4	1575	7.8	1653	8.2
4000	1409	7.0	1487	7.4	1563	7.8	1639	8.1	1714	8.5
4250	1488	7.4	1561	7.7	1634	8.1	1706	8.5	1776	8.8
4500	1568	7.8	1637	8.1	1706	8.5	1774	8.8	1841	9.2
4750	1648	8.2	1714	8.5	1779	8.9	1844	9.2	1908	9.5
5000	1728	8.6	1791	8.9	1853	9.2	1915	9.6	1976	9.9

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1573	7.8	1654	8.2	1732	8.6	1805	9.0	1875	9.4
3250	1622	8.1	1702	8.5	1777	8.9	1849	9.2	—	—
3500	1674	8.3	1751	8.7	1825	9.1	1895	9.5	—	—
3750	1729	8.6	1803	9.0	1874	9.4	—	—	—	—
4000	1786	8.9	1857	9.3	1926	9.6	—	—	—	—
4250	1846	9.2	1914	9.6	—	—	—	—	—	—
4500	1908	9.5	1973	9.9	—	—	—	—	—	—
4750	1971	9.9	—	—	—	—	—	—	—	—
5000	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1100-2000 rpm

Fan data (cont)

RHF120 — High Static — 10 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1100	4.9	1202	5.4	1301	5.9	1396	6.3	1487	6.7
3250	1176	5.3	1270	5.7	1363	6.1	1453	6.6	1539	6.9
3500	1252	5.6	1341	6.0	1428	6.4	1512	6.8	1595	7.2
3750	1330	6.0	1413	6.4	1495	6.7	1575	7.1	1653	7.5
4000	1409	6.3	1487	6.7	1563	7.1	1639	7.4	1714	7.8
4250	1488	6.7	1561	7.1	1634	7.4	1706	7.7	1776	8.0
4500	1568	7.1	1637	7.4	1706	7.7	1774	8.0	1841	8.3
4750	1648	7.5	1714	7.8	1779	8.1	1844	8.4	1908	8.7
5000	1728	7.8	1791	8.1	1853	8.4	1915	8.7	1976	9.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3000	1573	7.1	1654	7.5	1732	7.8	1805	8.2	1875	8.5
3250	1622	7.3	1702	7.7	1777	8.0	1849	8.4	1919	8.7
3500	1674	7.6	1751	7.9	1825	8.3	1895	8.6	1964	8.9
3750	1729	7.8	1803	8.2	1874	8.5	1943	8.8	2010	9.1
4000	1786	8.1	1857	8.4	1926	8.7	1993	9.0	2058	9.3
4250	1846	8.4	1914	8.7	1980	9.0	2045	9.3	2108	9.6
4500	1908	8.7	1973	9.0	2036	9.2	2099	9.5	2160	9.8
4750	1971	8.9	2034	9.2	2095	9.5	2155	9.8	—	—
5000	2036	9.2	2096	9.5	2155	9.8	—	—	—	—

High Static 1100-2200 rpm

Fan data (cont)

RHF150 — 12.5 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	947	0.45	1044	0.60	1140	0.78	1236	0.99	1329	1.23
4065	1019	0.55	1108	0.71	1197	0.90	1286	1.11	1373	1.36
4375	1091	0.68	1174	0.85	1257	1.04	1339	1.26	1421	1.50
4690	1164	0.82	1242	1.00	1319	1.20	1396	1.42	1473	1.67
5000	1237	0.98	1310	1.16	1383	1.37	1455	1.60	1527	1.85
5315	1312	1.16	1381	1.35	1449	1.56	1517	1.79	1585	2.05
5625	1387	1.36	1452	1.56	1516	1.77	1580	2.00	1645	2.26
5940	1463	1.57	1524	1.77	1585	2.00	1646	2.23	1707	2.49
6250	1537	1.79	1596	2.01	1654	2.23	1712	2.48	1770	2.74

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	1419	1.50	1506	1.79	1589	2.11	1668	2.44	1743	2.78
4065	1459	1.63	1542	1.92	1622	2.24	1699	2.57	1773	2.92
4375	1502	1.77	1581	2.07	1658	2.38	1732	2.72	1805	3.08
4690	1549	1.94	1624	2.23	1698	2.55	1769	2.88	1839	3.24
5000	1599	2.12	1670	2.41	1740	2.73	1809	3.07	1877	3.43
5315	1653	2.32	1721	2.62	1787	2.93	1853	3.27	1918	3.63
5625	1709	2.54	1773	2.83	1836	3.14	1899	3.48	1961	3.83
5940	1768	2.77	1829	3.07	1889	3.38	1949	3.71	2008	4.06
6250	1828	3.01	1886	3.31	1943	3.62	2001	3.95	2057	4.29

Std/Med Static 947-2200 rpm, 3.0 Max bhp

High Static 947-2200 rpm, 5.0 Max bhp

RHF150 — Standard/Medium Static — 12.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	947	4.2	1044	4.7	1140	5.1	1236	5.6	1329	6.0
4065	1019	4.5	1108	5.0	1197	5.4	1286	5.8	1373	6.2
4375	1091	4.9	1174	5.3	1257	5.6	1339	6.0	1421	6.4
4690	1164	5.2	1242	5.6	1319	5.9	1396	6.3	1473	6.6
5000	1237	5.6	1310	5.9	1383	6.2	1455	6.6	1527	6.9
5315	1312	5.9	1381	6.2	1449	6.5	1517	6.8	1585	7.2
5625	1387	6.2	1452	6.5	1516	6.8	1580	7.1	1645	7.4
5940	1463	6.6	1524	6.9	1585	7.2	1646	7.4	1707	7.7
6250	1537	6.9	1596	7.2	1654	7.5	1712	7.7	1770	8.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	1419	6.4	1506	6.8	1589	7.2	1668	7.5	1743	7.9
4065	1459	6.6	1542	7.0	1622	7.3	1699	7.7	1773	8.0
4375	1502	6.8	1581	7.1	1658	7.5	1732	7.8	1805	8.2
4690	1549	7.0	1624	7.3	1698	7.7	1769	8.0	—	—
5000	1599	7.2	1670	7.6	1740	7.9	1809	8.2	—	—
5315	1653	7.5	1721	7.8	1787	8.1	—	—	—	—
5625	1709	7.7	1773	8.0	1836	8.3	—	—	—	—
5940	1768	8.0	1829	8.3	—	—	—	—	—	—
6250	1828	8.3	—	—	—	—	—	—	—	—

Std/Med Static 947-2200 rpm

Fan data (cont)

RHF150 — High Static — 12.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	947	4.2	1044	4.7	1140	5.1	1236	5.6	1329	6.0
4065	1019	4.5	1108	5.0	1197	5.4	1286	5.8	1373	6.2
4375	1091	4.9	1174	5.3	1257	5.6	1339	6.0	1421	6.4
4690	1164	5.2	1242	5.6	1319	5.9	1396	6.3	1473	6.6
5000	1237	5.6	1310	5.9	1383	6.2	1455	6.6	1527	6.9
5315	1312	5.9	1381	6.2	1449	6.5	1517	6.8	1585	7.2
5625	1387	6.2	1452	6.5	1516	6.8	1580	7.1	1645	7.4
5940	1463	6.6	1524	6.9	1585	7.2	1646	7.4	1707	7.7
6250	1537	6.9	1596	7.2	1654	7.5	1712	7.7	1770	8.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
3750	1419	6.4	1506	6.8	1589	7.2	1668	7.5	1743	7.9
4065	1459	6.6	1542	7.0	1622	7.3	1699	7.7	1773	8.0
4375	1502	6.8	1581	7.1	1658	7.5	1732	7.8	1805	8.2
4690	1549	7.0	1624	7.3	1698	7.7	1769	8.0	1839	8.3
5000	1599	7.2	1670	7.6	1740	7.9	1809	8.2	1877	8.5
5315	1653	7.5	1721	7.8	1787	8.1	1853	8.4	1918	8.7
5625	1709	7.7	1773	8.0	1836	8.3	1899	8.6	1961	8.9
5940	1768	8.0	1829	8.3	1889	8.6	1949	8.8	2008	9.1
6250	1828	8.3	1886	8.6	1943	8.8	2001	9.1	2057	9.3

High Static 947-2200 rpm

Electrical data

Legend and Notes

Applicable for Electrical Data Tables on pages 53-69

LEGEND

BRKR	—	Circuit Breaker
C.O.	—	Convenience Outlet
FLA	—	Full Load Amps
IFM	—	Indoor Fan Motor
LRA	—	Locked Rotor Amps
MCA	—	Minimum Circuit Amps
P.E.	—	Power Exhaust
PWRD C.O.	—	Powered Convenience Outlet
RLA	—	Rated Load Amps
SCCR	—	Short Circuit Current Rating
UNPWR C.O.	—	Unpowered Convenience Outlet

NOTES:

1. In compliance with NEC requirements for multi-motor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.
2. For 208/230 v units, where one value is show it is the same for either 208 or 230 volts.
3. **Unbalanced 3-Phase Supply Voltage:** Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.


% Voltage Imbalance

= 100 x

max voltage deviation from average voltage

average voltage

Example: Supply voltage is 230-3-60



AB = 224-v
BC = 231-v
AC = 226-v

Average Voltage

=

(224 + 231 + 226)

3

=

681

3

=

227

Determine maximum deviation from average voltage.

(AB) 227-224 = 3-v

(BC) 231-227 = 4-v

(AC) 227-226 = 1-v

Maximum deviation is 4-v.

Determine percent of voltage imbalance.

% Voltage Imbalance

=

100x

4

227

=

1.76%

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

Electrical data (cont)

RHF090-150 Cooling Electrical Data

RHF UNIT SIZE	V-Ph-Hz	UNIT VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		STD SCCR kA	HIGH SCCR kA	IFM			POWER EXHAUST	
		MIN	MAX	RLA	LRA	RLA	LRA	Watts	FLA			Type	EFF at Full Load	FLA	Kit Qty	FLA (ea kit)
090	208-3-60	187	253	12.2	120	12.2	120	325	1.5	5	10	MED	90%	6.4	1	3.8
												HIGH	90%	7.5	1	3.8
	230-3-60	187	253	12.2	120	12.2	120	325	1.5	5	10	MED	90%	6.4	1	3.8
												HIGH	90%	7.5	1	3.8
	460-3-60	414	506	6.4	49	6.4	49	325	0.8	5	10	MED	90%	3.0	1	3.8
												HIGH	90%	3.5	1	3.8
	575-3-60	518	633	5.1	41	5.1	41	325	0.6	5	—	MED	90%	2.5	1	3.8
												HIGH	90%	3.0	1	3.8
102	208-3-60	187	253	13.4	120	12.8	120	325	1.5	5	10	MED	90%	6.4	1	3.8
												HIGH	90%	7.5	1	3.8
	230-3-60	187	253	13.4	120	12.8	120	325	1.5	5	10	MED	90%	6.4	1	3.8
												HIGH	90%	7.5	1	3.8
	460-3-60	414	506	6.4	50	6.0	49	325	0.8	5	10	MED	90%	3.0	1	3.8
												HIGH	90%	3.5	1	3.8
	575-3-60	518	633	5.1	41	5.8	41	325	0.6	5	—	MED	90%	2.5	1	3.8
												HIGH	90%	3.0	1	3.8
120	208-3-60	187	253	18.6	155	18.6	155	1070	7.4	5	10	MED	90%	6.4	1	3.8
												HIGH	90%	12.6	1	3.8
	230-3-60	187	253	18.6	155	18.6	155	1070	7.4	5	10	MED	90%	6.4	1	3.8
												HIGH	90%	12.6	1	3.8
	460-3-60	414	506	8.3	58	8.3	58	1070	7.4	5	10	MED	90%	3.0	1	3.8
												HIGH	90%	5.6	1	3.8
	575-3-60	518	633	7.7	48	7.7	48	1070	7.4	5	—	MED	90%	2.5	1	3.8
												HIGH	90%	4.6	1	3.8
150	208-3-60	187	253	22.3	166	22.3	166	280	1.5	5	10	MED	90%	7.5	1	3.8
												HIGH	90%	12.6	1	3.8
	230-3-60	187	253	22.3	166	22.3	166	280	1.5	5	10	MED	90%	7.5	1	3.8
												HIGH	90%	12.6	1	3.8
	460-3-60	414	506	8.8	75	8.8	75	280	0.8	5	10	MED	90%	3.5	1	3.8
												HIGH	90%	5.6	1	3.8
	575-3-60	518	633	7.2	54	7.2	54	280	0.6	5	—	MED	90%	3.0	1	3.8
												HIGH	90%	4.6	1	3.8

Electrical data (cont)

RHF090 MCA MOCP Electrical Data

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	HIGH SCCR kA ^a	ELECTRIC HEATER			NO C.O. OR UNPWR C.O.							
					CRHEATER ****00	NOM. (kW)	FLA	NO P.E.				WITH P.E. (pwrdr fr/unit)			
								MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
										FLA	LRA			FLA	LRA
090	208/ 230-3-60	MED	5	10	—	—	—	37	45	39	257	41	50	43	261
			5	10	411A	7.8/10.4	21.7/25.0	64/69	70/70	64/68	279/282	68/72	70/80	68/72	283/286
			5	10	412A	12.0/16.0	33.4/38.5	79/85	80/90	77/83	290/296	83/89	90/90	82/88	294/300
			5	10	414A	18.8/25.0	52.1/60.1	102/112	110/125	99/108	309/317	106/116	110/125	103/112	313/321
			5	10	415A	24.0/32.0	66.7/77.0	121/134	125/150	116/127	324/334	124/137	125/150	120/132	328/338
			5	10	416A	31.8/42.4	88.4/102.0	148/165	150/175	141/156	345/359	152/169	175/175	145/161	349/363
		HIGH	5	10	—	—	—	38	50	40	259	42	50	45	263
			5	10	411A	7.8/10.4	21.7/25.0	66/70	70/70	65/69	281/284	69/73	70/80	69/73	285/288
			5	10	412A	12.0/16.0	33.4/38.5	80/87	80/90	79/84	292/298	84/90	90/90	83/89	296/302
			5	10	414A	18.8/25.0	52.1/60.1	104/114	110/125	100/109	311/319	107/117	110/125	104/114	315/323
			5	10	415A	24.0/32.0	66.7/77.0	122/135	125/150	117/129	326/336	126/138	150/150	121/133	330/340
			5	10	416A	31.8/42.4	88.4/102.0	149/166	150/175	142/157	347/361	153/170	175/175	146/162	351/365
	460-3-60	MED	5	10	—	—	—	19	25	20	106	21	25	22	108
			5	10	420A	15.0	18.0	42	45	41	124	44	45	43	126
			5	10	421A	25.0	30.1	57	60	55	136	59	60	57	138
			5	10	422A	33.0	39.7	69	70	66	146	71	80	68	148
			5	10	423A	41.7	50.2	82	90	78	156	84	90	80	158
		HIGH	5	10	—	—	—	20	25	21	109	22	25	23	111
			5	10	420A	15.0	18.0	42	45	41	127	44	45	43	129
			5	10	421A	25.0	30.1	58	60	55	139	59	60	57	141
			5	10	422A	33.0	39.7	70	70	66	149	71	80	68	151
			5	10	423A	41.7	50.2	83	90	78	159	85	90	80	161
	575-3-60	MED	5	—	—	—	—	16	20	16	90	19	25	20	94
			5	—	425A	18.0	17.3	37	40	36	107	41	45	40	111
			5	—	427A	36.0	34.6	59	60	56	125	63	70	60	129
		HIGH	5	—	—	—	—	16	20	17	91	20	25	21	95
			5	—	425A	18.0	17.3	38	40	36	108	42	45	41	112
			5	—	427A	36.0	34.6	59	60	56	126	63	70	61	130

NOTE(S):

a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF090 MCA MOCP Electrical Data (cont)

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH PWRD C.O.							
				CRHEATER ****00	Nom. (kW)	FLA	NO P.E.				WITH P.E. (pwrd fr/unit)			
							MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
									FLA	LRA			FLA	LRA
090	208/ 230-3-60	MED	5	—	—	—	42	50	44	262	46	50	49	266
			5	411A	7.8/10.4	21.7/25.0	69/73	70/80	69/73	284/287	73/77	80/80	74/78	288/291
			5	412A	12.0/16.0	33.4/38.5	84/90	90/90	83/89	295/301	88/94	90/100	87/93	299/305
			5	414A	18.8/25.0	52.1/60.1	107/117	110/125	104/114	314/322	111/121	125/125	109/118	318/326
			5	415A	24.0/32.0	66.7/77.0	125/138	150/150	121/133	329/339	129/142	150/150	125/137	333/343
			5	416A	31.8/42.4	88.4/102.0	153/170	175/175	146/162	350/364	156/173	175/175	150/166	354/368
		HIGH	5	—	—	—	43	50	46	264	47	50	50	268
			5	411A	7.8/10.4	21.7/25.0	70/74	70/80	71/74	286/289	74/78	80/80	75/79	290/293
			5	412A	12.0/16.0	33.4/38.5	85/91	90/100	84/90	297/303	89/95	90/100	88/94	301/307
			5	414A	18.8/25.0	52.1/60.1	108/118	110/125	106/115	316/324	112/122	125/125	110/119	320/328
			5	415A	24.0/32.0	66.7/77.0	127/139	150/150	122/134	331/341	130/143	150/150	127/139	335/345
			5	416A	31.8/42.4	88.4/102.0	154/171	175/175	147/163	352/366	158/175	175/175	152/167	356/370
	460-3-60	MED	5	—	—	—	22	25	23	108	23	25	25	110
			5	420A	15.0	18.0	44	45	43	126	46	50	45	128
			5	421A	25.0	30.1	59	60	57	138	61	70	59	140
			5	422A	33.0	39.7	71	80	68	148	73	80	70	150
			5	423A	41.7	50.2	84	90	80	158	86	90	82	160
		HIGH	5	—	—	—	22	25	23	111	24	30	25	113
			5	420A	15.0	18.0	45	45	44	129	46	50	46	131
			5	421A	25.0	30.1	60	60	58	141	62	70	60	143
			5	422A	33.0	39.7	72	80	69	151	74	80	71	153
			5	423A	41.7	50.2	85	90	81	161	87	90	83	163
	575-3-60	MED	5	—	—	—	17	20	18	92	21	25	22	96
			5	425A	18.0	17.3	39	40	38	109	43	45	42	113
			5	427A	36.0	34.6	61	70	58	127	64	70	62	131
		HIGH	5	—	—	—	18	20	19	93	22	25	23	97
			5	425A	18.0	17.3	39	40	38	110	43	45	43	114
			5	427A	36.0	34.6	61	70	58	128	65	70	63	132

Electrical data (cont)

RHF102 MCA MOCP Electrical Data

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	HIGH SCCR kA ^a	ELECTRIC HEATER			NO C.O. OR UNPWR C.O.							
					CRHEATER ****00	Nom. (kW)	FLA	NO P.E.				WITH P.E. (pwrd fr/unit)			
								MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
										FLA	LRA			FLA	LRA
102	208/ 230-3-60	MED	5	10	—	—	—	39	50	41	257	43	50	45	261
			5	10	411A	7.8/10.4	21.7/25.0	67/71	70/80	66/70	279/282	70/74	70/80	70/74	283/286
			5	10	412A	12.0/16.0	33.4/38.5	81/88	90/90	79/85	290/296	85/91	90/100	84/90	294/300
			5	10	414A	18.8/25.0	52.1/60.1	105/115	110/125	101/110	309/317	108/118	110/125	105/114	313/321
			5	10	415A	24.0/32.0	66.7/77.0	123/136	125/150	118/129	324/334	127/139	150/150	122/134	328/338
			5	10	416A	31.8/42.4	88.4/102.0	150/167	150/175	143/158	345/359	154/171	175/175	147/163	349/363
		HIGH	5	10	—	—	—	41	50	42	259	44	50	47	263
			5	10	411A	7.8/10.4	21.7/25.0	68/72	70/80	67/71	281/284	71/76	80/80	72/75	285/288
			5	10	412A	12.0/16.0	33.4/38.5	82/89	90/90	81/86	292/298	86/92	90/100	85/91	296/302
			5	10	414A	18.8/25.0	52.1/60.1	106/116	110/125	102/111	311/319	109/119	110/125	106/116	315/323
			5	10	415A	24.0/32.0	66.7/77.0	124/137	125/150	119/131	326/336	128/141	150/150	123/135	330/340
			5	10	416A	31.8/42.4	88.4/102.0	151/168	175/175	144/160	347/361	155/172	175/175	148/164	351/365
	460-3-60	MED	5	10	—	—	—	19	25	20	107	21	25	22	109
			5	10	420A	15.0	18.0	42	45	40	125	43	45	42	127
			5	10	421A	25.0	30.1	57	60	54	137	58	60	56	139
			5	10	422A	33.0	39.7	69	70	65	147	70	80	67	149
			5	10	423A	41.7	50.2	82	90	77	157	84	90	79	159
		HIGH	5	10	—	—	—	20	25	20	110	21	25	22	112
			5	10	420A	15.0	18.0	42	45	41	128	44	45	43	130
			5	10	421A	25.0	30.1	57	60	55	140	59	60	57	142
			5	10	422A	33.0	39.7	69	70	66	150	71	80	68	152
			5	10	423A	41.7	50.2	82	90	78	160	84	90	80	162
	575-3-60	MED	5	—	—	—	—	17	20	17	90	20	25	21	94
			5	—	425A	18.0	17.3	38	40	37	107	42	45	41	111
			5	—	427A	36.0	34.6	60	60	57	125	64	70	61	129
		HIGH	5	—	—	—	—	17	20	17	91	21	25	22	95
			5	—	425A	18.0	17.3	39	40	37	108	42	45	42	112
			5	—	427A	36.0	34.6	60	60	57	126	64	70	62	130

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF102 MCA MOCP Electrical Data (cont)

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH PWRD C.O.							
				CRHEATER ****00	Nom. (kW)	FLA	NO P.E.				WITH P.E. (pwrd fr/unit)			
							MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
									FLA	LRA			FLA	LRA
102	208/ 230-3-60	MED	5	—	—	—	44	50	46	262	48	60	51	266
			5	411A	7.8/10.4	21.7/25.0	71/75	80/80	71/75	284/287	75/79	80/80	76/80	288/291
			5	412A	12.0/16.0	33.4/38.5	86/92	90/100	85/91	295/301	90/96	90/100	89/95	299/305
			5	414A	18.8/25.0	52.1/60.1	109/119	110/125	106/116	314/322	113/123	125/125	111/120	318/326
			5	415A	24.0/32.0	66.7/77.0	128/140	150/150	123/135	329/339	131/144	150/150	128/139	333/343
			5	416A	31.8/42.4	88.4/102.0	155/172	175/175	148/164	350/364	159/176	175/200	152/168	354/368
		HIGH	5	—	—	—	45	50	48	264	49	60	52	268
			5	411A	7.8/10.4	21.7/25.0	72/77	80/80	73/76	286/289	76/80	80/80	77/81	290/293
			5	412A	12.0/16.0	33.4/38.5	87/93	90/100	86/92	297/303	91/97	100/100	91/96	301/307
			5	414A	18.8/25.0	52.1/60.1	110/120	110/125	108/117	316/324	114/124	125/125	112/121	320/328
			5	415A	24.0/32.0	66.7/77.0	129/142	150/150	124/136	331/341	132/145	150/150	129/141	335/345
			5	416A	31.8/42.4	88.4/102.0	156/173	175/175	149/165	352/366	160/177	175/200	154/169	356/370
	460-3-60	MED	5	—	—	—	21	25	22	109	23	25	24	111
			5	420A	15.0	18.0	44	45	43	127	46	50	45	129
			5	421A	25.0	30.1	59	60	57	139	61	70	59	141
			5	422A	33.0	39.7	71	80	68	149	73	80	70	151
			5	423A	41.7	50.2	84	90	80	159	86	90	82	161
		HIGH	5	—	—	—	22	25	23	112	24	25	25	114
			5	420A	15.0	18.0	44	45	43	130	46	50	45	132
			5	421A	25.0	30.1	59	60	57	142	61	70	59	144
			5	422A	33.0	39.7	71	80	68	152	73	80	70	154
			5	423A	41.7	50.2	85	90	80	162	86	90	82	164
	575-3-60	MED	5	—	—	—	18	20	19	92	22	25	23	96
			5	425A	18.0	17.3	40	40	39	109	44	45	43	113
			5	427A	36.0	34.6	61	70	59	127	65	70	63	131
		HIGH	5	—	—	—	19	20	19	93	23	25	24	97
			5	425A	18.0	17.3	40	40	39	110	44	45	44	114
			5	427A	36.0	34.6	62	70	59	128	66	70	63	132

Electrical data (cont)

RHF120 MCA MOCP Electrical Data

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	HIGH SCCR kA ^a	ELECTRIC HEATER			NO C.O. OR UNPWR C.O.							
					CRHEATER ****00	Nom. (kW)	FLA	NO P.E.				WITH P.E. (pwrd fr/unit)			
								MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
										FLA	LRA			FLA	LRA
120	208/ 230-3-60	MED	5	10	—	—	—	56	70	59	326	60	70	63	330
			5	10	411A	7.8/10.4	21.7/25.0	83/87	90/90	84/87	348/351	87/91	90/100	88/92	352/355
			5	10	412A	12.0/16.0	33.4/38.5	98/104	100/110	97/103	359/365	102/108	110/110	101/107	363/369
			5	10	415A	24.0/32.0	66.7/77.0	139/152	150/175	135/147	393/403	143/156	150/175	140/152	397/407
			5	10	416A	31.8/42.4	88.4/102.0	167/184	175/200	160/176	414/428	170/187	175/200	165/180	418/432
			5	10	417A	37.6/50.0	104.2/120.3	186/176	200/200	178/197	430/446	190/180	200/200	183/201	434/450
		HIGH	5	10	—	—	—	62	80	66	335	66	80	70	339
			5	10	411A	7.8/10.4	21.7/25.0	89/94	100/100	91/95	357/360	93/97	100/100	95/99	361/364
			5	10	412A	12.0/16.0	33.4/38.5	104/110	110/110	104/110	368/374	108/114	110/125	109/114	372/378
			5	10	415A	24.0/32.0	66.7/77.0	146/159	150/175	142/154	402/412	149/162	150/175	147/159	406/416
			5	10	416A	31.8/42.4	88.4/102.0	173/190	175/200	167/183	423/437	177/194	200/200	172/187	427/441
			5	10	417A	37.6/50.0	104.2/120.3	193/183	200/200	186/204	439/455	196/186	200/200	190/208	443/459
	460-3-60	MED	5	10	—	—	—	30	35	31	127	31	35	33	129
			5	10	420A	15.0	18.0	52	60	52	145	54	60	54	147
			5	10	422A	33.0	39.7	79	80	77	167	81	90	79	169
			5	10	423A	41.7	50.2	92	100	89	177	94	100	91	179
			5	10	424A	50.0	60.1	90	100	100	187	91	100	102	189
		HIGH	5	10	—	—	—	32	35	34	131	34	40	36	133
			5	10	420A	15.0	18.0	55	60	55	149	56	60	57	151
			5	10	422A	33.0	39.7	82	90	80	171	84	90	82	173
			5	10	423A	41.7	50.2	95	100	92	181	97	100	94	183
			5	10	424A	50.0	60.1	92	100	103	191	94	100	105	193
	575-3-60	MED	5	—	—	—	—	28	30	29	107	31	35	33	111
			5	—	425A	18.0	17.3	49	50	49	124	53	60	53	128
			5	—	427A	36.0	34.6	71	80	69	142	75	80	73	146
			5	—	428A	50.0	48.1	76	80	84	155	80	90	89	159
		HIGH	5	—	—	—	—	30	35	32	109	34	40	36	113
			5	—	425A	18.0	17.3	51	60	51	126	55	60	56	130
			5	—	427A	36.0	34.6	73	80	71	144	77	80	76	148
			5	—	428A	50.0	48.1	78	80	87	157	82	90	91	161

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF120 MCA MOCP Electrical Data (cont)

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH PWRD C.O.							
				CRHEATER ****00	Nom. (kW)	FLA	NO P.E.				WITH P.E. (pwrd fr/unit)			
							MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
									FLA	LRA			FLA	LRA
120	208/ 230-3-60	MED	5	—	—	—	61	70	64	331	65	80	69	335
			5	411A	7.8/10.4	21.7/25.0	88/92	100/100	89/93	353/356	92/96	100/100	93/97	357/360
			5	412A	12.0/16.0	33.4/38.5	103/109	110/110	103/108	364/370	106/113	110/125	107/113	368/374
			5	415A	24.0/32.0	66.7/77.0	144/157	150/175	141/153	398/408	148/161	150/175	145/157	402/412
			5	416A	31.8/42.4	88.4/102.0	171/188	175/200	166/181	419/433	175/192	175/200	170/186	423/437
			5	417A	37.6/50.0	104.2/120.3	191/181	200/200	184/203	435/451	195/185	200/200	188/207	439/455
		HIGH	5	—	—	—	67	80	71	340	71	80	76	344
			5	411A	7.8/10.4	21.7/25.0	94/98	100/100	96/100	362/365	98/102	100/110	101/104	366/369
			5	412A	12.0/16.0	33.4/38.5	109/115	110/125	110/116	373/379	113/119	125/125	114/120	377/383
			5	415A	24.0/32.0	66.7/77.0	150/163	175/175	148/160	407/417	154/167	175/175	152/164	411/421
			5	416A	31.8/42.4	88.4/102.0	178/195	200/200	173/189	428/442	181/198	200/200	177/193	432/446
			5	417A	37.6/50.0	104.2/120.3	197/187	200/200	191/210	444/460	201/191	225/200	196/214	448/464
	460-3-60	MED	5	—	—	—	32	35	34	129	34	40	36	131
			5	420A	15.0	18.0	54	60	54	147	56	60	56	149
			5	422A	33.0	39.7	81	90	79	169	83	90	81	171
			5	423A	41.7	50.2	94	100	91	179	96	100	93	181
			5	424A	50.0	60.1	92	100	103	189	94	100	105	191
		HIGH	5	—	—	—	34	40	37	133	36	40	39	135
			5	420A	15.0	18.0	57	60	57	151	59	60	59	153
			5	422A	33.0	39.7	84	90	82	173	86	90	84	175
			5	423A	41.7	50.2	97	100	94	183	99	100	96	185
			5	424A	50.0	60.1	94	100	106	193	96	100	108	195
	575-3-60	MED	5	—	—	—	29	35	31	109	33	40	35	113
			5	425A	18.0	17.3	51	60	51	126	55	60	55	130
			5	427A	36.0	34.6	73	80	71	144	76	80	75	148
			5	428A	50.0	48.1	77	80	86	157	81	90	91	161
		HIGH	5	—	—	—	31	35	33	111	35	40	38	115
			5	425A	18.0	17.3	53	60	53	128	57	60	58	132
			5	427A	36.0	34.6	75	80	73	146	79	80	78	150
			5	428A	50.0	48.1	80	90	89	159	83	90	93	163

Electrical data (cont)

RHF150 MCA MOCP Electrical Data

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	HIGH SCCR kA ^a	ELECTRIC HEATER			NO C.O. OR UNPWR C.O.							
					CRHEATER ****00	Nom. (kW)	FLA	NO P.E.				WITH P.E. (pwrd fr/unit)			
								MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
										FLA	LRA			FLA	LRA
150	208/ 230-3-60	MED	5	10	—	—	—	63	80	65	355	66	80	69	359
			5	10	411A	7.8/10.4	21.7/25.0	90/94	100/100	90/94	377/380	94/98	100/100	94/98	381/384
			5	10	412A	12.0/16.0	33.4/38.5	104/111	110/125	104/109	388/394	108/115	110/125	108/114	392/398
			5	10	415A	24.0/32.0	66.7/77.0	146/159	150/175	142/154	422/432	150/163	150/175	146/158	426/436
			5	10	416A	31.8/42.4	88.4/102.0	173/190	175/200	167/182	443/457	177/194	200/200	171/187	447/461
			5	10	417A	37.6/50.0	104.2/120.3	193/183	200/200	185/203	459/475	197/187	200/200	189/208	463/479
		HIGH	5	10	—	—	—	68	80	71	362	72	80	75	366
			5	10	411A	7.8/10.4	21.7/25.0	95/99	100/100	96/100	384/387	99/103	100/110	100/104	388/391
			5	10	412A	12.0/16.0	33.4/38.5	109/116	110/125	109/115	395/401	113/120	125/125	114/120	399/405
			5	10	415A	24.0/32.0	66.7/77.0	151/164	175/175	148/160	429/439	155/168	175/175	152/164	433/443
			5	10	416A	31.8/42.4	88.4/102.0	178/195	200/200	173/188	450/464	182/199	200/200	177/193	454/468
			5	10	417A	37.6/50.0	104.2/120.3	198/188	200/200	191/209	466/482	202/192	225/200	195/214	470/486
	460-3-60	MED	5	10	—	—	—	26	30	27	163	28	30	29	165
			5	10	420A	15.0	18.0	49	50	48	181	50	50	50	183
			5	10	422A	33.0	39.7	76	80	73	203	78	80	75	205
			5	10	423A	41.7	50.2	89	90	85	213	91	100	87	215
			5	10	424A	50.0	60.1	86	90	96	223	88	90	98	225
		HIGH	5	10	—	—	—	28	35	29	164	30	35	32	166
			5	10	420A	15.0	18.0	51	60	50	182	53	60	52	184
			5	10	422A	33.0	39.7	78	80	75	204	80	80	77	206
			5	10	423A	41.7	50.2	91	100	87	214	93	100	89	216
			5	10	424A	50.0	60.1	88	100	99	224	90	100	101	226
	575-3-60	MED	5	—	—	—	—	21	25	22	119	25	30	26	123
			5	—	425A	18.0	17.3	43	45	42	136	47	50	46	140
			5	—	427A	36.0	34.6	65	70	62	154	69	70	66	158
			5	—	428A	50.0	48.1	70	80	77	167	73	80	82	171
		HIGH	5	—	—	—	—	23	25	24	120	27	30	28	124
			5	—	425A	18.0	17.3	45	45	44	137	48	50	48	141
			5	—	427A	36.0	34.6	66	70	64	155	70	70	68	159
			5	—	428A	50.0	48.1	71	80	79	168	75	80	84	172

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF150 MCA MOCP Electrical Data (cont)

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH PWRD C.O.							
				CRHEATER ****00	Nom. (kW)	FLA	NO P.E.				WITH P.E. (pwrd fr/unit)			
							MCA	FUSE or HACR BRKR	DISCONNECT SIZE		MCA	FUSE or HACR BRKR	DISCONNECT SIZE	
									FLA	LRA			FLA	LRA
150	208/ 230-3-60	MED	5	—	—	—	67	80	71	360	71	80	75	364
			5	411A	7.8/10.4	21.7/25.0	95/99	100/100	96/99	382/385	98/102	100/110	100/104	386/389
			5	412A	12.0/16.0	33.4/38.5	109/116	110/125	109/115	393/399	113/119	125/125	113/119	397/403
			5	415A	24.0/32.0	66.7/77.0	151/164	175/175	147/159	427/437	155/167	175/175	152/164	431/441
			5	416A	31.8/42.4	88.4/102.0	178/195	200/200	172/188	448/462	182/199	200/200	177/192	452/466
			5	417A	37.6/50.0	104.2/120.3	198/188	200/200	190/209	464/480	201/192	225/200	195/213	468/484
		HIGH	5	—	—	—	73	80	76	367	76	90	81	371
			5	411A	7.8/10.4	21.7/25.0	100/104	100/110	101/105	389/392	103/108	110/110	106/110	393/396
			5	412A	12.0/16.0	33.4/38.5	114/121	125/125	115/121	400/406	118/124	125/125	119/125	404/410
			5	415A	24.0/32.0	66.7/77.0	156/169	175/175	153/165	434/444	160/173	175/175	158/169	438/448
			5	416A	31.8/42.4	88.4/102.0	183/200	200/200	178/194	455/469	187/204	200/225	183/198	459/473
			5	417A	37.6/50.0	104.2/120.3	203/193	225/200	196/215	471/487	207/197	225/225	201/219	475/491
	460-3-60	MED	5	—	—	—	28	35	30	165	30	35	32	167
			5	420A	15.0	18.0	51	60	50	183	53	60	52	185
			5	422A	33.0	39.7	78	80	75	205	80	80	77	207
			5	423A	41.7	50.2	91	100	87	215	93	100	89	217
			5	424A	50.0	60.1	88	100	99	225	90	100	101	227
		HIGH	5	—	—	—	30	35	32	166	32	40	34	168
			5	420A	15.0	18.0	53	60	53	184	55	60	55	186
			5	422A	33.0	39.7	80	80	78	206	82	90	80	208
			5	423A	41.7	50.2	93	100	90	216	95	100	92	218
			5	424A	50.0	60.1	91	100	101	226	92	100	103	228
	575-3-60	MED	5	—	—	—	23	25	24	121	27	30	28	125
			5	425A	18.0	17.3	45	45	44	138	49	50	48	142
			5	427A	36.0	34.6	66	70	64	156	70	70	68	160
			5	428A	50.0	48.1	71	80	79	169	75	80	84	173
		HIGH	5	—	—	—	25	30	26	122	29	30	30	126
			5	425A	18.0	17.3	46	50	46	139	50	50	50	143
			5	427A	36.0	34.6	68	70	66	157	72	80	70	161
			5	428A	50.0	48.1	73	80	81	170	77	80	86	174

Electrical data (cont)

RHF090 Electric Heat Data — Without Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
090	208/ 230-3-60	MED	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
		HIGH	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
	460-3-60	MED	CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
			CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
		HIGH	CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
	575-3-60	MED	CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
		HIGH	CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052
			CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	HIGH SCCR kA ^a	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HSCCR SINGLE POINT OR JUNCTION KIT P/N ^a	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwrd fr/unit)
090	208/ 230-3-60	MED	CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER414A00	25.0	10	18.8/23.0	64.1/78.3	068	068
			CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
		HIGH	CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
			CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER414A00	25.0	10	18.8/23.0	64.1/78.3	068	068
	460-3-60	MED	CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
			CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
		HIGH	CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER421A00	25.0	10	23.0	78.3	068	068
			CRHEATER422A00	33.0	10	30.3	103.4	068	068
			CRHEATER423A00	41.7	10	38.3	130.7	068	068
	575-3-60	MED	CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER421A00	25.0	10	23.0	78.3	068	068
		HIGH	CRHEATER422A00	33.0	10	30.3	103.4	068	068
			CRHEATER423A00	41.7	10	38.3	130.7	068	068
	575-3-60	MED	CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068
		HIGH	CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF090 Electric Heat Data — With Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
090	208/ 230-3-60	MED	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
		HIGH	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
	460-3-60	MED	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
		HIGH	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
	575-3-60	MED	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052
		HIGH	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052

Electrical data (cont)

RHF102 Electric Heat Data — Without Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
102	208/ 230-3-60	MED	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
		HIGH	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
	460-3-60	MED	CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
			CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
		HIGH	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
	575-3-60	MED	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052
		HIGH	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	HIGH SCCR kA ^a	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HSCCR SINGLE POINT OR JUNCTION KIT P/N ^a	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwrd fr/unit)
102	208/ 230-3-60	MED	CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER414A00	25.0	10	18.8/23.0	64.1/78.3	068	068
			CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
			CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
		HIGH	CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER414A00	25.0	10	18.8/23.0	64.1/78.3	068	068
			CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
	460-3-60	MED	CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
			CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER421A00	25.0	10	23.0	78.3	068	068
			CRHEATER422A00	33.0	10	30.3	103.4	068	068
			CRHEATER423A00	41.7	10	38.3	130.7	068	068
		HIGH	CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER421A00	25.0	10	23.0	78.3	068	068
			CRHEATER422A00	33.0	10	30.3	103.4	068	068
			CRHEATER423A00	41.7	10	38.3	130.7	068	068
	575-3-60	MED	CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068
		HIGH	CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068

NOTE(S):

a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF102 Electric Heat Data — With Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
102	208/ 230-3-60	MED	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
		HIGH	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	049	049	049	049
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	049	049	049	049
			CRHEATER414A00	25.0	5	18.8/23.0	64.1/78.3	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	051	051	051	051
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	053	053	053	053
	460-3-60	MED	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
		HIGH	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER421A00	25.0	5	23.0	78.3	047	047	047	052
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
	575-3-60	MED	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052
		HIGH	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	047	052	052	052

Electrical data (cont)

RHF120 Electric Heat Data — Without Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwr fr/unit)	No P.E.	With P.E. (pwr fr/unit)
120	208/ 230-3-60	MED	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	053	053	053	053
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	054	054	054	054
		HIGH	CRHEATER417A00	50.0	5	37.6/45.9	128.1/156.7	054	054	054	054
			CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	053	053	053	053
	460-3-60	MED	CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	054	054	054	054
			CRHEATER417A00	50.0	5	37.6/45.9	128.1/156.7	054	054	054	054
			CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
		HIGH	CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5	45.9	156.7	052	052	052	052
			CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
	575-3-60	MED	CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5	45.9	156.7	052	052	052	052
			CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	052	052	052	052
		HIGH	CRHEATER428A00	50.0	5	45.9	156.7	052	052	052	052
			CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	052	052	052	052
			CRHEATER428A00	50.0	5	45.9	156.7	052	052	052	052

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	HIGH SCCR kA ^a	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HSCCR SINGLE POINT OR JUNCTION KIT P/N ^a	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwr fr/unit)
120	208/ 230-3-60	MED	CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
			CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
		HIGH	CRHEATER417A00	50.0	10	37.6/45.9	128.1/156.7	069	069
			CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
	460-3-60	MED	CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
			CRHEATER417A00	50.0	10	37.6/45.9	128.1/156.7	069	069
			CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER422A00	33.0	10	30.3	103.4	068	068
		HIGH	CRHEATER423A00	41.7	10	38.3	130.7	068	068
			CRHEATER424A00	50.0	10	45.9	156.7	068	068
			CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER422A00	33.0	10	30.3	103.4	068	068
	575-3-60	MED	CRHEATER423A00	41.7	10	38.3	130.7	068	068
			CRHEATER424A00	50.0	10	45.9	156.7	068	068
			CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068
		HIGH	CRHEATER428A00	50.0	10	45.9	156.7	068	068
			CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068
			CRHEATER428A00	50.0	10	45.9	156.7	068	068

NOTE(S):

a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF120 Electric Heat Data — With Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
120	208/ 230-3-60	MED	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	053	053	053	053
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	054	054	054	054
			CRHEATER417A00	50.0	5	37.6/45.9	128.1/156.7	054	054	054	054
		HIGH	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	053	053	053	053
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	054	054	054	054
			CRHEATER417A00	50.0	5	37.6/45.9	128.1/156.7	054	054	054	054
	460-3-60	MED	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5	45.9	156.7	052	052	052	052
		HIGH	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5	45.9	156.7	052	052	052	052
	575-3-60	MED	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	052	052	052	052
			CRHEATER428A00	50.0	5	45.9	156.7	052	052	052	052
		HIGH	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	052	052	052	052
			CRHEATER428A00	50.0	5	45.9	156.7	052	052	052	052

Electrical data (cont)

RHF150 Electric Heat Data — Without Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
150	208/ 230-3-60	MED	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	053	053	053	053
			CRHEATER416A00	42.4	5	31.8/38.9	108.7/132.9	054	054	054	054
		CRHEATER417A00	50.0	5	37.6/45.9	128.1/156.7	054	054	054	054	
		HIGH	CRHEATER411A00	10.4	5	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5	24.0/29.4	82.0/100.3	053	053	053	053
	CRHEATER416A00		42.4	5	31.8/38.9	108.7/132.9	054	054	054	054	
	CRHEATER417A00	50.0	5	37.6/45.9	128.1/156.7	054	054	054	054		
	460-3-60	MED	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5	45.9	156.7	052	052	052	052
		HIGH	CRHEATER420A00	15.0	5	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5	45.9	156.7	052	052	052	052
	575-3-60	MED	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	052	052	052	052
			CRHEATER428A00	50.0	5	45.9	156.7	052	052	052	052
		HIGH	CRHEATER425A00	18.0	5	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5	33.1	112.8	052	052	052	052
			CRHEATER428A00	50.0	5	45.9	156.7	052	052	052	052

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	HIGH SCCR kA ^a	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HSCCR SINGLE POINT OR JUNCTION KIT P/N ^a	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwrd fr/unit)
150	208/ 230-3-60	MED	CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
			CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
			CRHEATER417A00	50.0	10	37.6/45.9	128.1/156.7	069	069
		HIGH	CRHEATER411A00	10.4	10	7.8/9.6	26.7/32.6	067	067
			CRHEATER412A00	16.0	10	12.0/14.7	41.0/50.1	067	067
			CRHEATER415A00	32.0	10	24.0/29.4	82.0/100.3	068	068
			CRHEATER416A00	42.4	10	31.8/38.9	108.7/132.9	069	069
			CRHEATER417A00	50.0	10	37.6/45.9	128.1/156.7	069	069
	460-3-60	MED	CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER422A00	33.0	10	30.3	103.4	068	068
			CRHEATER423A00	41.7	10	38.3	130.7	068	068
			CRHEATER424A00	50.0	10	45.9	156.7	068	068
		HIGH	CRHEATER420A00	15.0	10	13.8	47.0	067	067
			CRHEATER422A00	33.0	10	30.3	103.4	068	068
			CRHEATER423A00	41.7	10	38.3	130.7	068	068
			CRHEATER424A00	50.0	10	45.9	156.7	068	068
	575-3-60	MED	CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068
			CRHEATER428A00	50.0	10	45.9	156.7	068	068
		HIGH	CRHEATER425A00	18.0	10	16.5	56.4	067	067
			CRHEATER427A00	36.0	10	33.1	112.8	068	068
			CRHEATER428A00	50.0	10	45.9	156.7	068	068

NOTE(S):


a. High SCCR (Short Circuit Current Rating) is not available on RHF120 units, 575-v units, or units with factory-installed powered convenience outlet or non-fused disconnect.

Electrical data (cont)

RHF150Electric Heat Data — With Non-Fused Disconnect

RHF UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER P/N	NOM. (kW)	STD SCCR kA	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT P/N			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
150	208/ 230-3-60	MED	CRHEATER411A00	10.4	5.0	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5.0	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5.0	24.0/29.4	82.0/100.3	053	053	053	053
			CRHEATER416A00	42.4	5.0	31.8/38.9	108.7/132.9	054	054	054	054
			CRHEATER417A00	50.0	5.0	37.6/45.9	128.1/156.7	054	054	054	054
		HIGH	CRHEATER411A00	10.4	5.0	7.8/9.6	26.7/32.6	051	051	051	051
			CRHEATER412A00	16.0	5.0	12.0/14.7	41.0/50.1	051	051	051	051
			CRHEATER415A00	32.0	5.0	24.0/29.4	82.0/100.3	053	053	053	053
			CRHEATER416A00	42.4	5.0	31.8/38.9	108.7/132.9	054	054	054	054
			CRHEATER417A00	50.0	5.0	37.6/45.9	128.1/156.7	054	054	054	054
	460-3-60	MED	CRHEATER420A00	15.0	5.0	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5.0	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5.0	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5.0	45.9	156.7	052	052	052	052
		HIGH	CRHEATER420A00	15.0	5.0	13.8	47.0	047	047	047	047
			CRHEATER422A00	33.0	5.0	30.3	103.4	052	052	052	052
			CRHEATER423A00	41.7	5.0	38.3	130.7	052	052	052	052
			CRHEATER424A00	50.0	5.0	45.9	156.7	052	052	052	052
	575-3-60	MED	CRHEATER425A00	18.0	5.0	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5.0	33.1	112.8	052	052	052	052
			CRHEATER428A00	50.0	5.0	45.9	156.7	052	052	052	052
		HIGH	CRHEATER425A00	18.0	5.0	16.5	56.4	047	047	047	047
			CRHEATER427A00	36.0	5.0	33.1	112.8	052	052	052	052
			CRHEATER428A00	50.0	5.0	45.9	156.7	052	052	052	052

RHF090-102 Control Wiring Diagram, Electromechanical with POL224 Controller

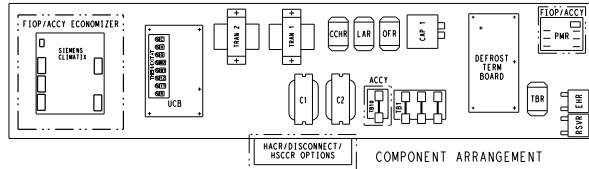

- NOTES:
1. UCB LAYOUT DOES NOT MATCH ACTUAL TERMINAL BOARD LAYOUT.
 2. TERMINAL BOARD JUMPER 1, 2 AND 3 ARE CUT FROM THE FACTORY.
 3. REMOVE DESIGNATED JUMPER ON TERMINAL BOARD WHEN ADDING SMOKE DETECTORS, OCCUPANCY AND REMOTE SHUTDOWN.
 4. USE ABC AS COARSE AND POT AS FINE ADJUSTMENTS FOR SETTING HIGH FAN SPEED. LOW SPEED IS AN OFFSET BASED ON DIP SWITCHES.
 5. 2-PIN LOW SPEED DIP SWITCH POSITIONS ARE FACTORY SET AS SHOWN FOR T1 UNITS.
 6. HARDSTART AND CUTOFF SET TO "MIN". JUMPER PIN ON TOP 2-PINS AS SHOWN.
 7. THE * WIRE COLOR IS FOR DIFFERENTIATION WITHIN THIS SCHEMATIC.
 8. TRANSFORMER IS INDICATED BASED ON UNIT VOLTAGE. TAPS ONLY SHOWN TO SIMPLIFY SCHEMATIC. 208/230V UNIT TRANS IS WIRED FOR 230V UNIT. IF UNIT IS TO BE RUN WITH 208V POWER SUPPLY DISCONNECT BLK WIRE FROM 230V TAP AND CONNECT TO 208V TAP.
 9. T84 LOCATED IN HEAT SECTION.
 10. TO CONVERT TO A SINGLE STAGE HEATER MOVE VIOLET WIRE AT T84 TO CONNECT WITH WHITE WIRE.

HP DIP SWITCH SETTINGS

(DEFAULT)

30 MINUTES 60 MINUTES 90 MINUTES 120 MINUTES

FIELD SELECTABLE OPTIONS FOR TIME PERIOD BETWEEN DEFROST CYCLES (MINUTES).

SPEED UP METAL OBJECT FIELD SPEED-UP CYCLE







1. MOMENTARILY SHORT PINS AND RELEASE TO BYPASS COMPRESSOR OFF DELAY.

2. SHORT FOR 1-10 SEC. AND RELEASE FOR FORCED DEFROST.


3. PERMANENT SHORT WILL BE IGNORED.

DEFROST WILL TERMINATE IN 30 SEC. IF DFT IS OPEN.


DEFROST WILL TERMINATE NORMALLY IF DFT IS CLOSED.

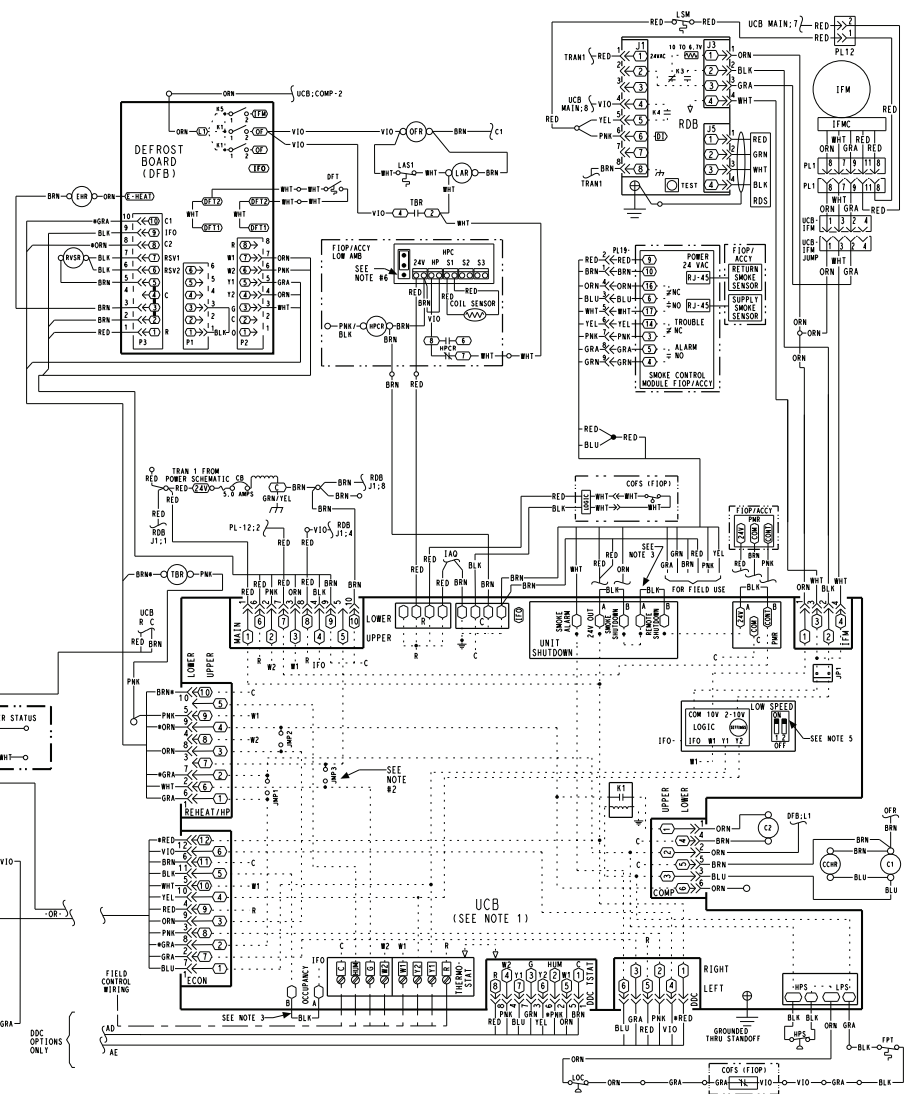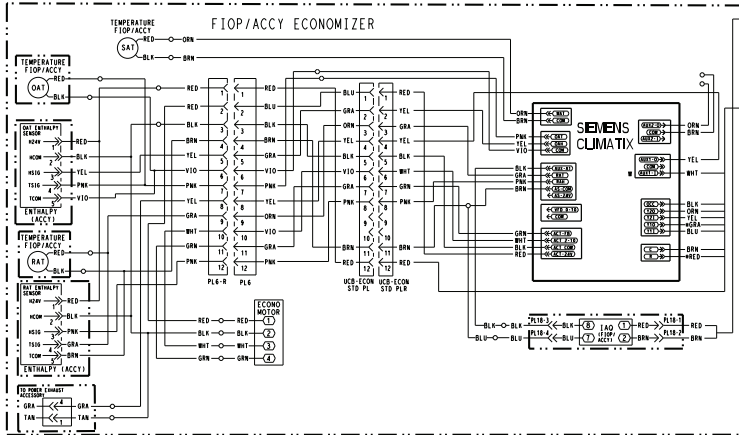

RHF120 Control Wiring Diagram, Electromechanical with POL224 Controller

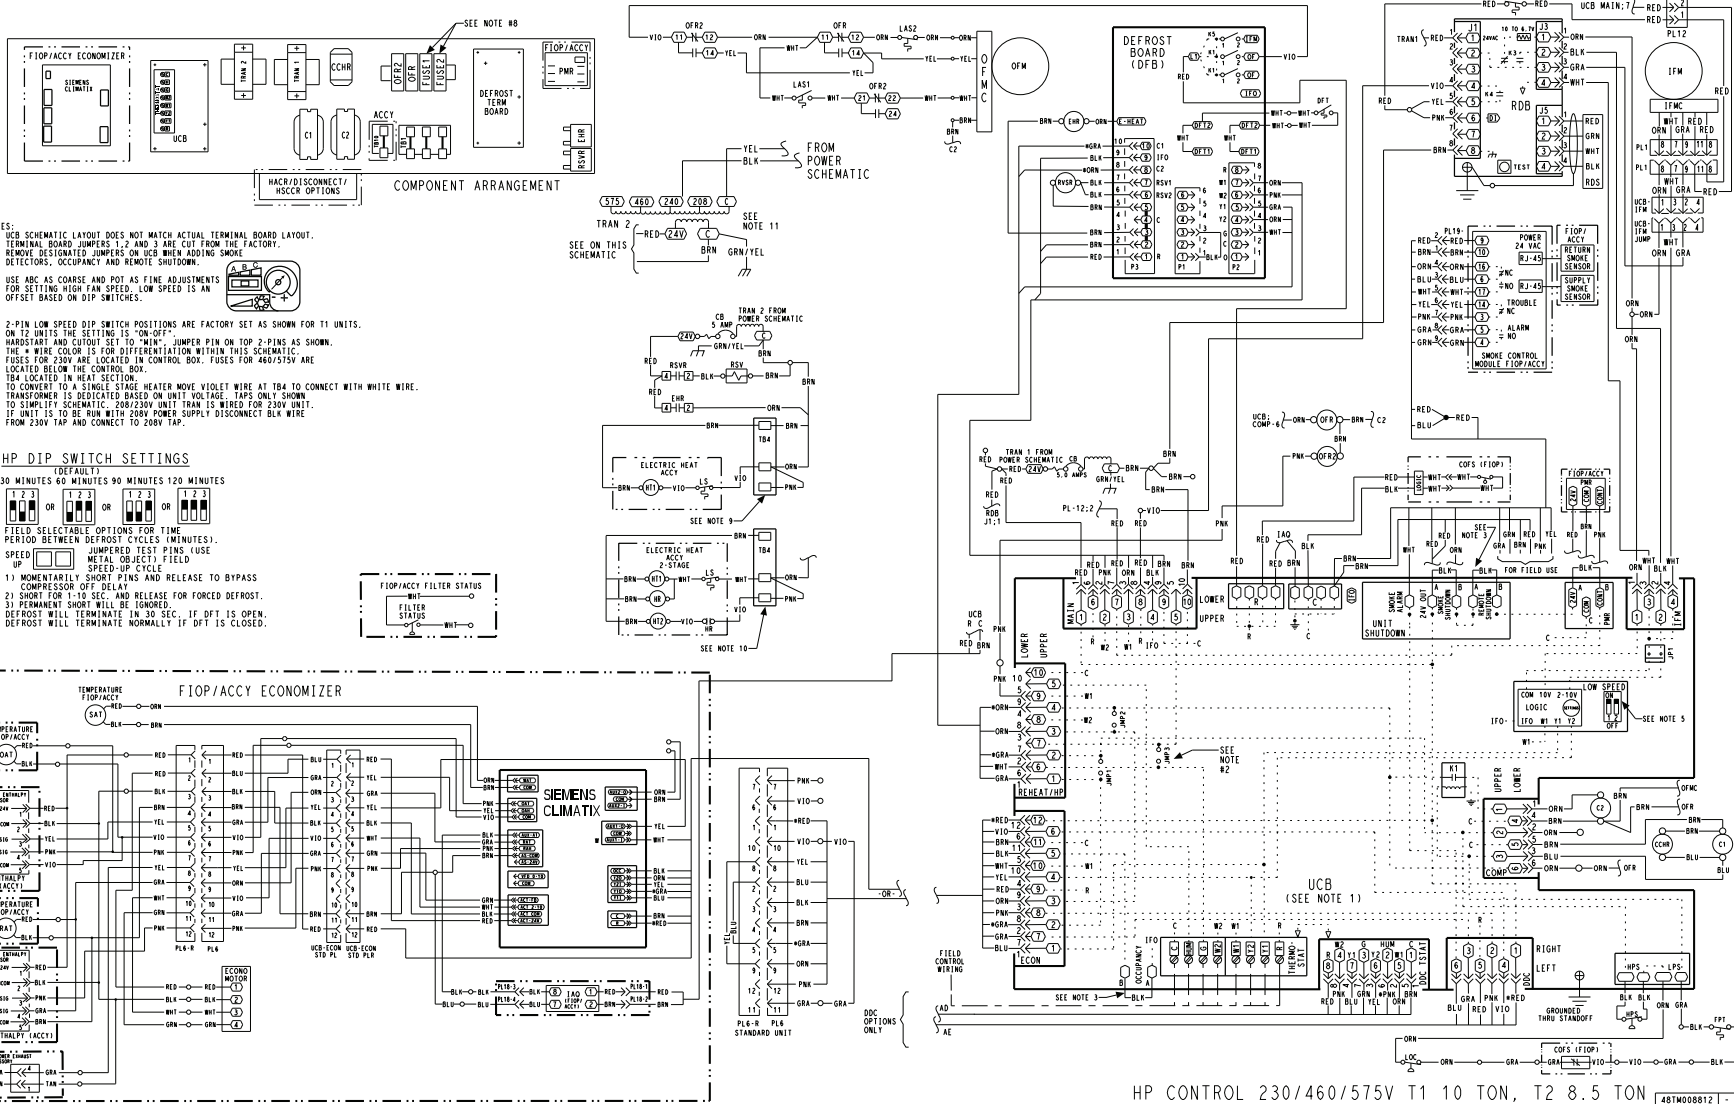


Typical wiring diagrams (cont)



Typical wiring diagrams (cont)


RHF090-102 Power Wiring Diagram, 230/460-3-60 Shown

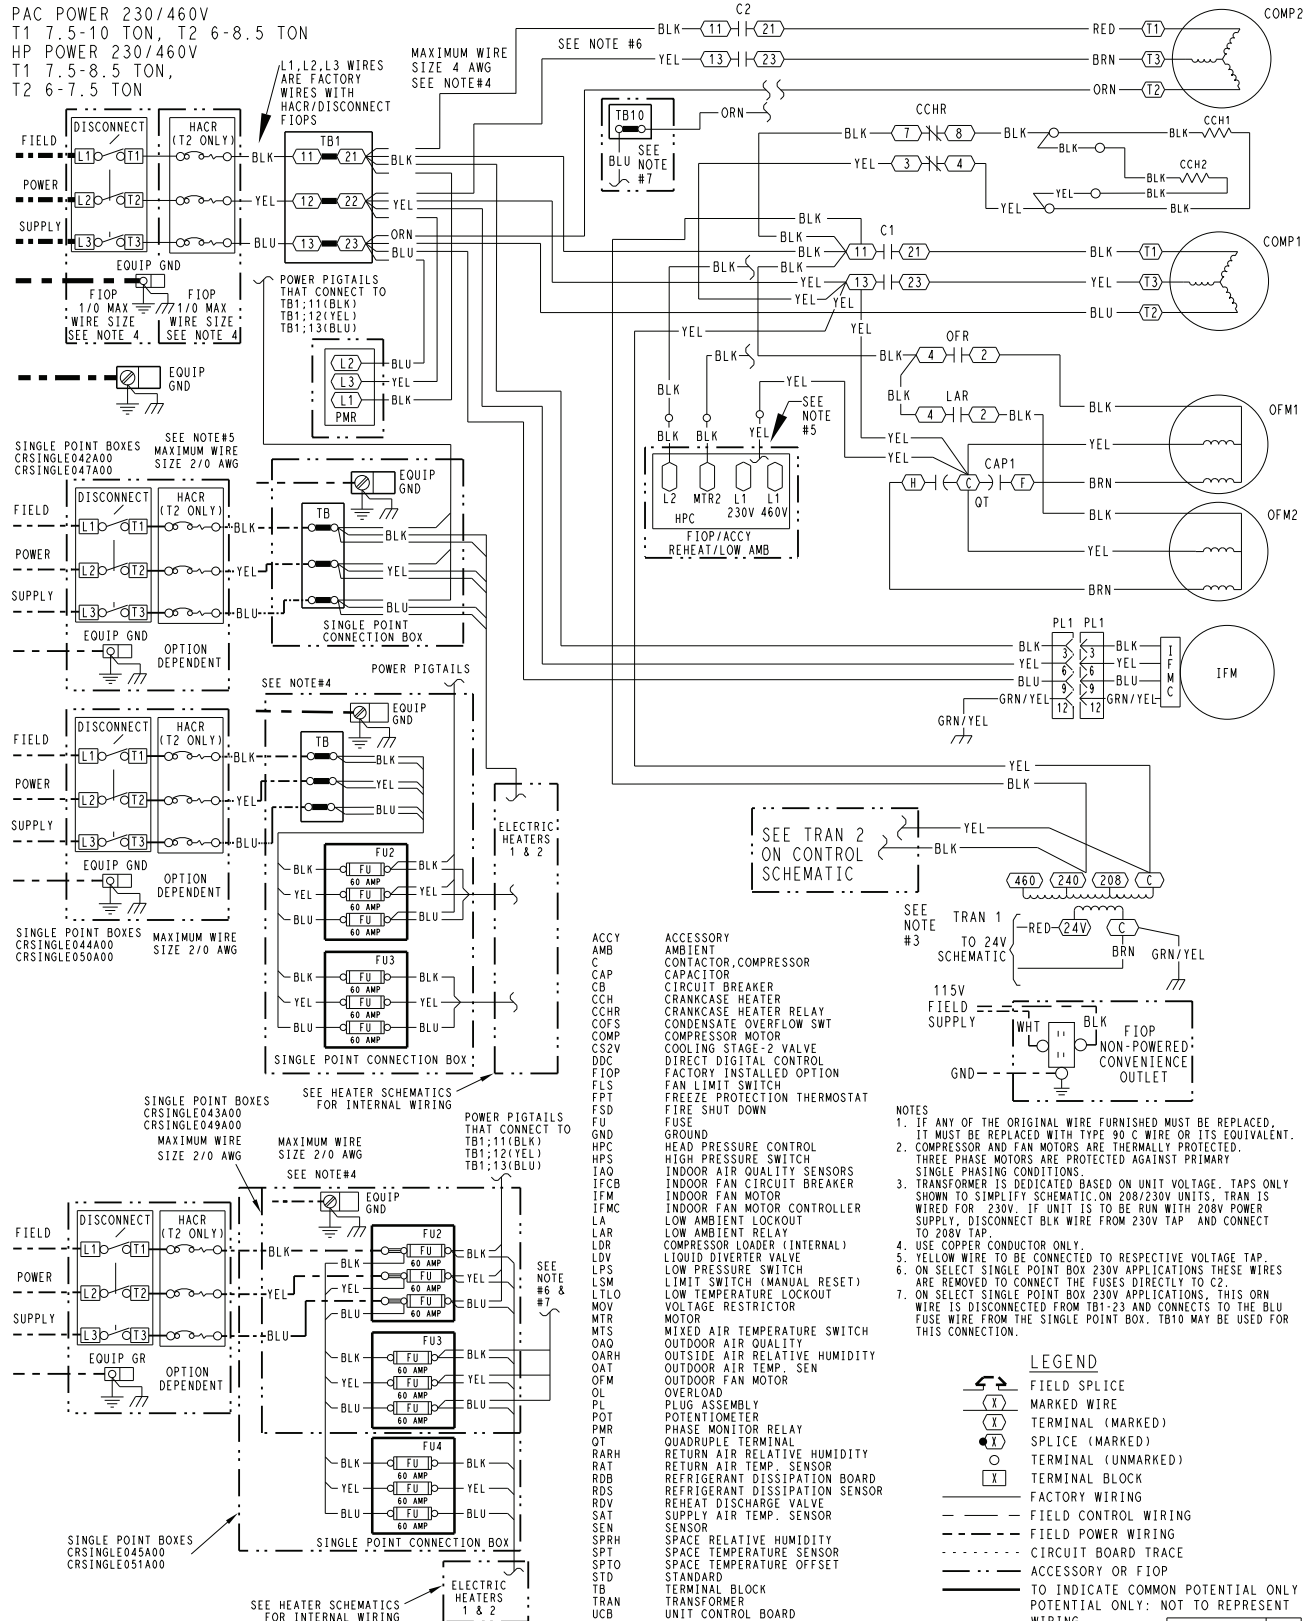

Typical wiring diagrams (cont)


RHF120 Power Wiring Diagram, 230-3-60 Shown

PAC POWER 460/575V
T1 12.5 TON, T2 10 TON
HP POWER 460/575V
T1 10 TON, T2 8.5 TON

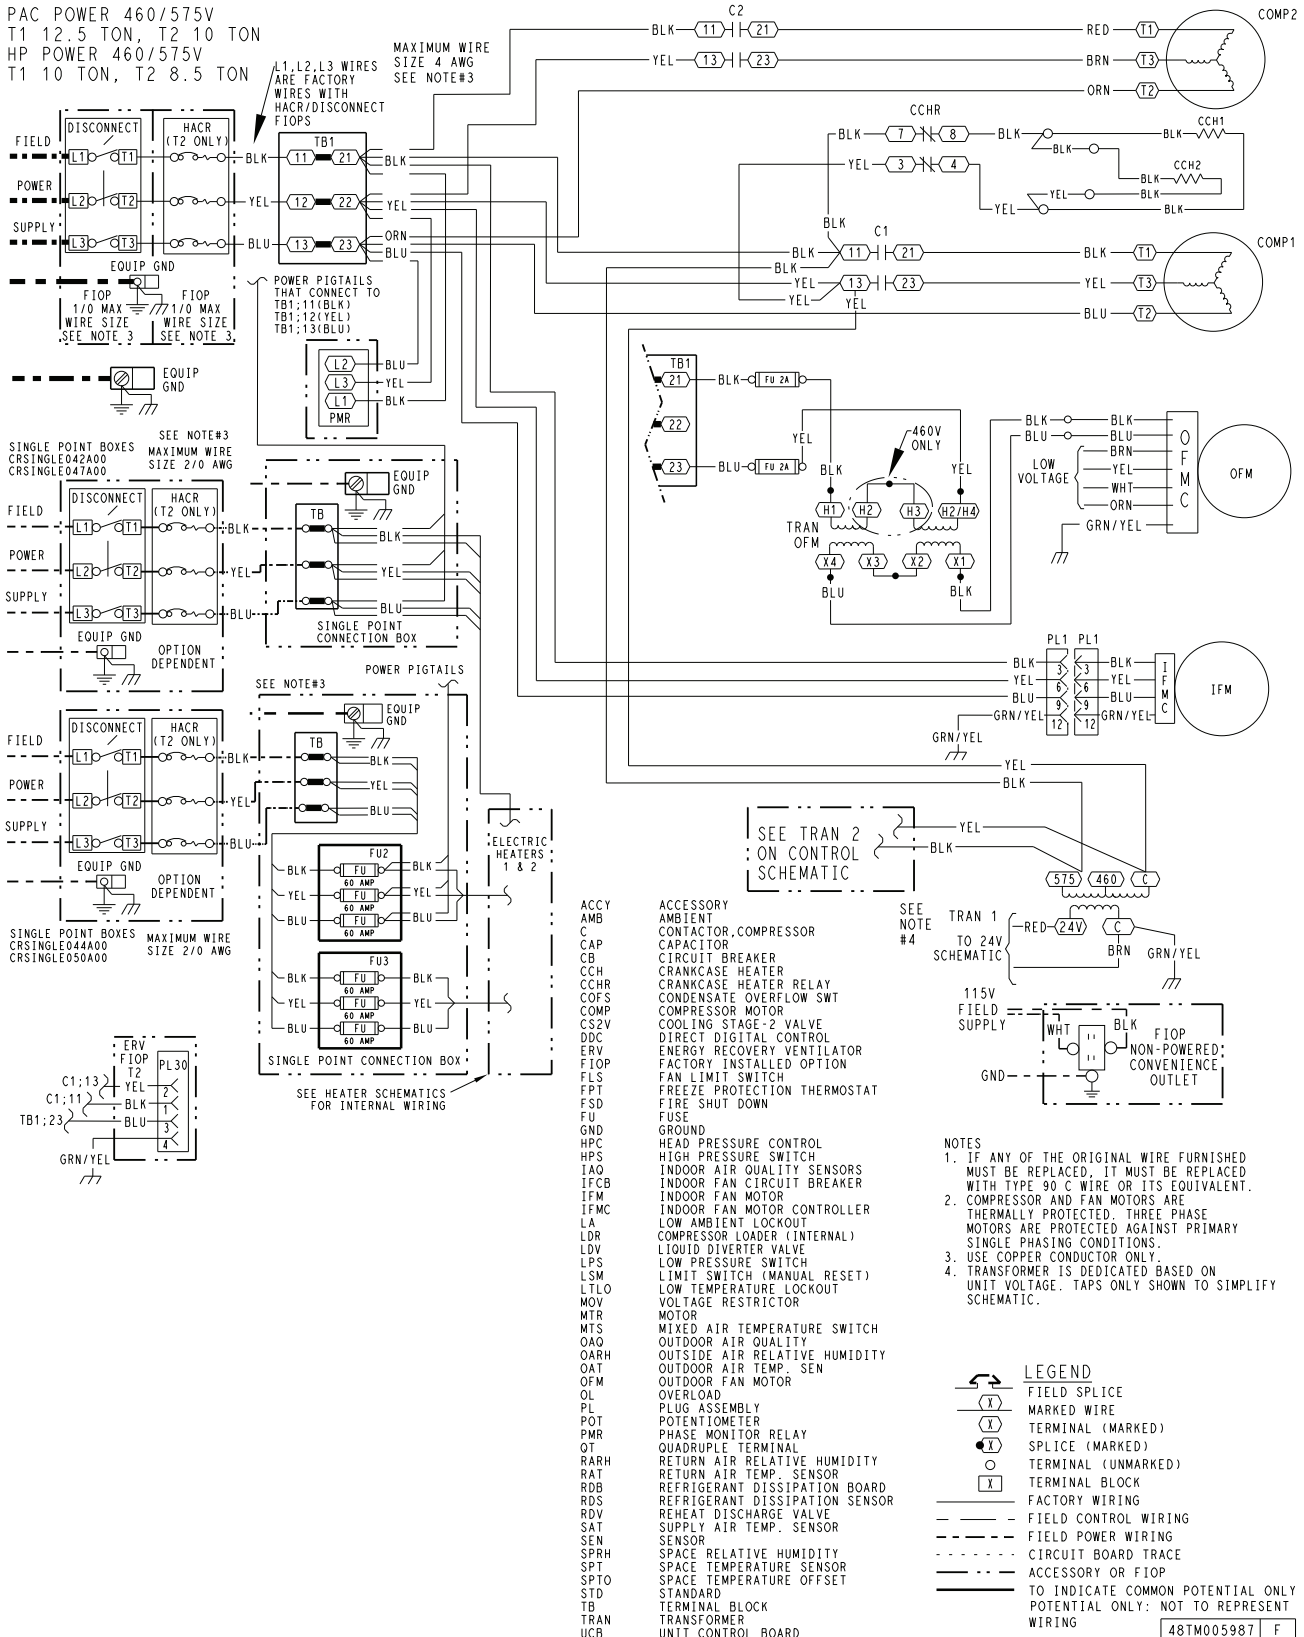

Typical wiring diagrams (cont)

RHF150 Power Wiring Diagram, 208/230, 460-3-60 Shown

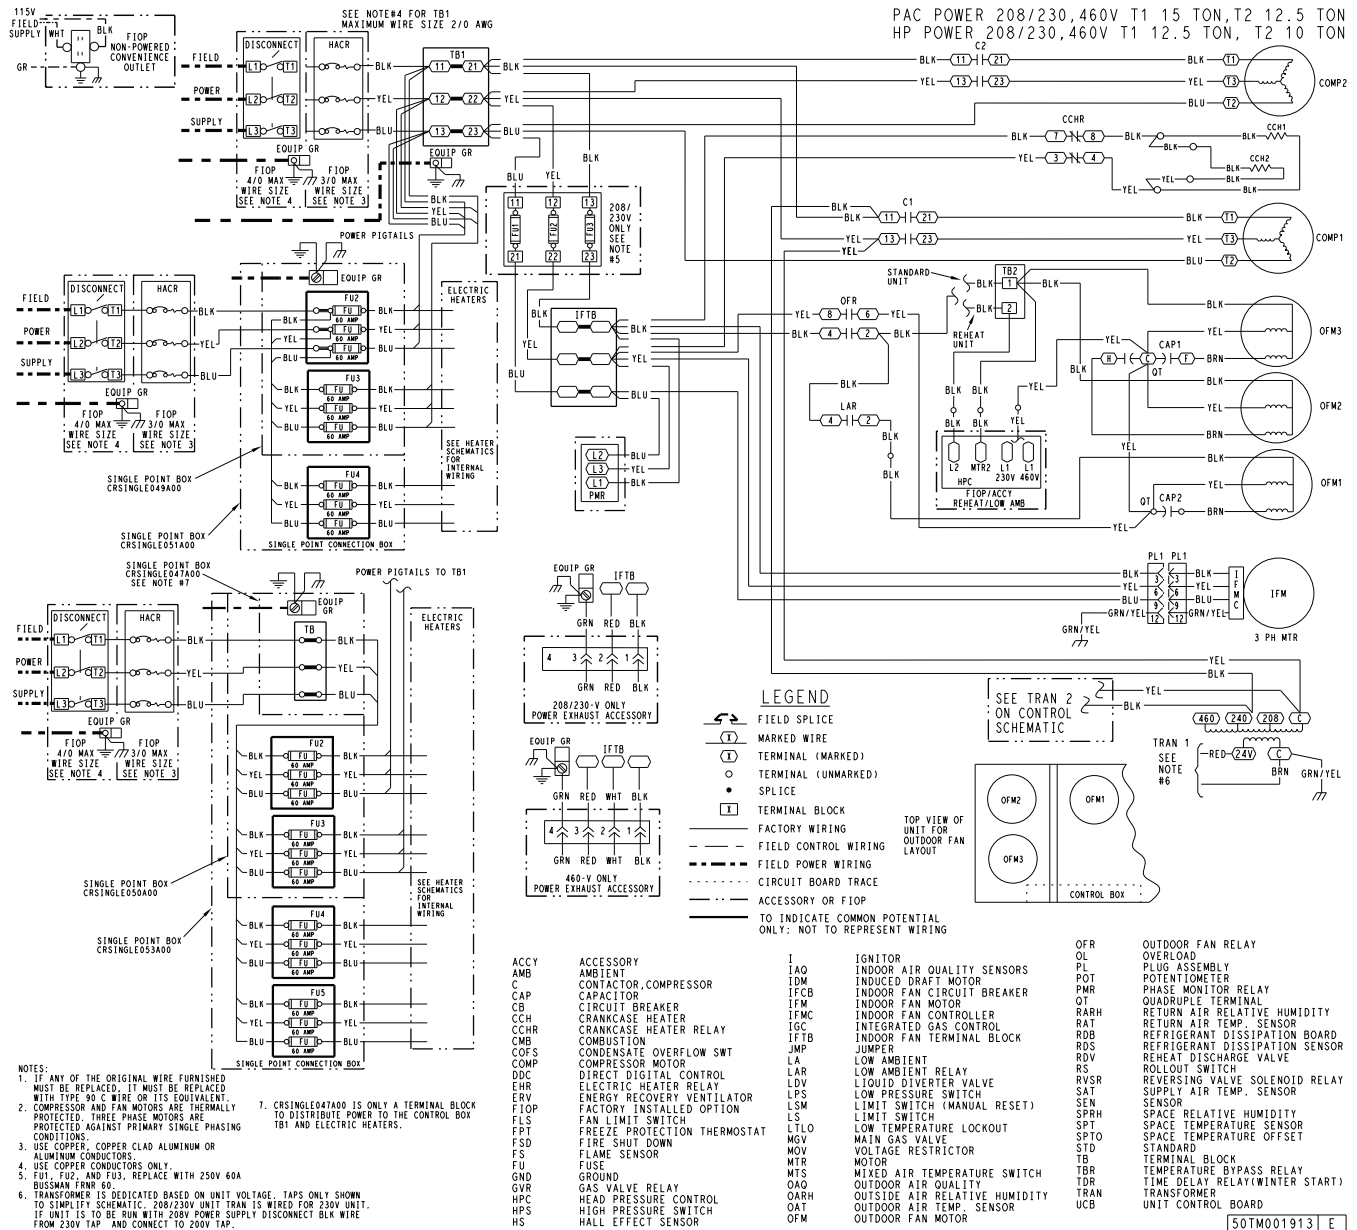

Sequence of operation

General

The sequence below describes the sequence of operation for an electromechanical unit with and without a factory-installed EconomizerONE (POL224 controller; called “economizer” in this sequence). For information regarding a direct digital controller, see the start-up, operations, and troubleshooting manual for the applicable controller.

Dissipation

When the factory-installed dissipation system detects a level of refrigerant leak in the unit, a safety dissipation mode will be activated. During this dissipation mode, the thermostat will be disabled and the indoor fan will run at 66% of the maximum speed of the motor. When the refrigerant leak levels are normal for 5 minutes, the unit will return to normal operation.

Electromechanical Units without Economizer

Cooling

When the thermostat calls for cooling, terminals G and Y1 are energized. The indoor fan will run at the low fan speed and the compressor contactor (CC) is energized causing the compressor and outdoor fan to run. The low indoor fan speed is 66% of the user set fan speed and the compressor will run at partial capacity.

If additional cooling is needed, the thermostat will add the call for Y2. This will increase the indoor fan speed to the user set fan speed and energize the compressor loader for full compressor capacity. The outdoor fan is the same speed for Y1 and Y2.

When the thermostat removes the call for Y2 but leaves the Y1, the indoor fan will reduce speed to 66% of the user set fan speed, the compressor loader will turn off, and the outdoor fan will remain on. When the thermostat removes the call for Y1 the compressor contactor will de-energize shutting down the compressor and the outdoor fan. When the thermostat removes the call for G, the indoor fan will turn off after the specific unit fan off delay.

NOTE: Per ASHRAE 90.1-2019 and IECC-2018 standards, during the first stage of cooling operation the Unit Control Board (UCB) will adjust the fan motor speed to provide 66% of the total cfm established for the unit.

Defrost

When the temperature of the outdoor coil drops below 28°F (–2°C) as sensed by the defrost thermostat (DFT2) and the defrost timer is at the end of a timed period (adjustable at 30, 60, 90 or 120 minutes), reversing valve solenoids (RVS1 and RVS2) are energized and the OFC is de-energized. This switches the position of the reversing valves and shuts off the outdoor fan. The electric heaters (if installed) will be energized.

Heating, unit with economizer

When the room temperature calls for heat through terminal W1, the indoor (evaporator) fan contactor (IFC) and heater contactor no. 1 (HC1) are energized and the reversing valve(s) de-energize and switches position. On

units equipped for 2 stages of heat, when additional heat is needed, heater contactor no. 2 is energized through W2. The economizer damper moves to the minimum position. When the thermostat is satisfied, the damper moves to the fully closed position.

Heating, unit without economizer

Upon a request for heating from the space thermostat, terminal W1 will be energized with 24-v. The IFC, outdoor fan contactor (OFC), C1, and C2 will be energized. The indoor fan, outdoor fans, and compressor no. 1, and compressor no. 2 are energized and reversing valves are de-energized and switch position.

If the space temperature continues to fall while W1 is energized, W2 will be energized with 24-v, and the heater contactor(s) (HC) will be energized, which will energize the electric heater(s).

When the space thermostat is satisfied, W2 will be de-energized first, and the electric heater(s) will be de-energized. Upon a further rise in space temperature, W1 will be de-energized.

IMPORTANT: The thermostat must be configured for Electric Heat so it will energize G with the W1 call.

Electromechanical Units with Factory-Installed EconomizerONE

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor-air damper is modulated by the EconomizerONE control to provide a 50°F (10°C) to 55°F (13°C) mixed-air temperature into the zone. As the mixed-air temperature fluctuates above 55°F (13°C) or below 50°F (10°C) dampers will be modulated (open or close) to bring the mixed-air temperature back within control. If mechanical cooling is utilized with free cooling, the outdoor-air damper will maintain its current position at the time the compressor is started. If the increase in cooling capacity causes the mixed-air temperature to drop below 45°F (7°C), then the outdoor-air damper position will be decreased to the minimum position. If the mixed-air temperature continues to fall, the outdoor-air damper will close. Control returns to normal once the mixed-air temperature rises above 48°F (9°C). The power exhaust fans will be energized and de-energized, if installed, as the outdoor-air damper opens and closes.

If field-installed accessory CO₂ sensors are connected to the EconomizerONE control, a demand controlled ventilation strategy will begin to operate. As the CO₂ level in the zone increases above the CO₂ set-point (on the EconomizerONE controller), the minimum position of the damper will be increased proportionally until the Maximum Ventilation setting is reached. As the CO₂ level decreases because of the increase in fresh air, the outdoor-air damper will follow the higher demand condition from either the DCV mode or from the free cooling mode. For EconomizerONE operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

Sequence of operation (cont)

When the EconomizerONE control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the EconomizerONE damper to the minimum position.

On the initial power to the EconomizerONE control, it will take the damper up to 2 1/2 minutes before it begins to position itself. After the initial power-up, further changes in damper position can take up to 90 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1 1/2 and 2 1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (dry bulb, outdoor enthalpy, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed-air temperature set-point at 50°F (10°C) to 55°F (13°C). If

there is a further demand for cooling (cooling second stage — Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed-air temperature set-point. The EconomizerONE damper will be open at maximum position.

Two-Speed Note: The EconomizerONE controller will adjust the damper position as the Indoor Fan Speed changes, per its configured values.

Heating

The sequence of operation for the heating is the same as an electromechanical unit with no economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor-air damper is closed when the indoor fan is not operating. Refer to Service and Maintenance Manual for further details.

Application data

Minimum operating ambient temperature (cooling)

In mechanical cooling mode, your RHF rooftop unit can safely operate down to an outdoor ambient temperature of 40°F (4°C) [0°F (–18°C) for size 120 models]. It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

Maximum operating ambient temperature (cooling)

The maximum operating ambient temperature for cooling mode is 125°F (52°C). While cooling operation above 125°F (52°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

Multiple motor and drive packages

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, we have a factory installed combination to meet your application. A wide selection of motors are available, factory installed, to handle nearly any application.

Minimum and maximum airflow (heating and cooling)

To maintain safe and reliable operation of your rooftop, operate within the heating airflow limits during heating mode and cooling airflow limits during cooling mode. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up and unsafe heating operation. Heating and cooling limitations differ when evaluating operating cfm, minimum value is the HIGHER of the cooling and heating minimum cfm values published on page 5 and the maximum value is the LOWER of the cooling and heating maximum values published on page 5.

Heating-to-cooling changeover

Your unit will automatically change from heating to cooling mode when using a thermostat with an auto-change-over feature.

Airflow

All units are draw-through in cooling mode and blow-through in heating mode.

Outdoor air application strategies

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most

applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local company representative for assistance.

Motor limits, brake horsepower (bhp)

Due to internal design of RHF units, the air path, and specially designed motors, the full horsepower (maximum continuous bhp) band, as listed in the Fan Performance tables, can be used with the utmost confidence. There is no need for extra safety factors, as our motors are designed and rigorously tested to use the entire, listed bhp range without either nuisance tripping or premature motor failure.

Sizing a rooftop

Bigger is not necessarily better. While an air conditioner needs to have enough capacity to meet the design loads, it does not need excess capacity. In fact, excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding “safety factors” to the calculated load, are all signs of oversizing air conditioners. Oversizing the air conditioner leads to poor humidity control, reduced efficiency, higher utility bills, larger indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, engineers should “right-size” or even slightly “under-size” air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures. Please contact your local company representative for assistance.

Low ambient applications

The optional economizer can adequately cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low-ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based “free cooling” is the preferred less costly and energy conscious method. In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your RHF rooftop can operate to ambient temperatures down to 0°F (–18°C) using the recommended accessory low ambient controller.

NOTE: 0°F (–18°C) is standard on size 120 models.

Guide specifications

This specification is in the "Masterformat" as published by the Construction Specification Institute. Please feel free to copy this specification directly into your building spec.

Heat Pump Packaged Rooftop

HVAC Guide Specifications

Size Range: **7.5 to 12.5 Nominal Tons**

Model Number: **RHF090-150**

Part 1 — (23 06 80) Schedules for Decentralized HVAC Equipment

1.01 (23 06 80.13) Decentralized Unitary HVAC Equipment Schedule:

A. (23 06 80.13.A.) Rooftop Unit (RTU) Schedule:

1. Schedule is per the project specification requirements.

Part 2 — (23 07 16) HVAC Equipment Insulation

2.01 (23 07 16.13) Decentralized, Rooftop Units:

A. (23 07 16.13.A.) Evaporator Fan Compartment:

1. Interior cabinet surfaces shall be insulated with a minimum 1/2 in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

B. (23 07 16.13.B.) Electric Heat Compartment:

1. Aluminum foil-faced fiberglass insulation shall be used.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

Part 3 — (23 09 13) Instrumentation and Control Devices for HVAC

3.01 (23 09 13.13) Sensors and Transmitters:

A. (23 09 13.13.A.) Thermostats:

1. Thermostat must:
 - a. energize both "W" and "G" when calling for heat.
 - b. have capability to energize 1 or 2 different stages of cooling, and 2 different stages of heating.
 - c. be heat pump design and include capability for occupancy scheduling.

Part 4 — (23 09 23) (23 09 33) Electric and Electronic Control System for HVAC

4.01 (23 09 33.13) Decentralized, Rooftop Units:

A. (23 09 33.13.A.) General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color-coded wiring.
3. Shall include a Unit Control Board to conveniently and safely provide connection points

for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, and low and high pressure switches. Controller shall also provide an intuitive means to adjust the indoor fan speed through a simple switch and pot adjustment design.

4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.
 5. Shall include integrated defrost system to prevent excessive frost accumulation during heating duty, and shall be controlled as follows:
 - a. Defrost shall be initiated on the basis of time and coil temperature.
 - b. A 30, 60, 90, 120 minute timer shall activate the defrost cycle only if the coil temperature is low enough to indicate a heavy frost condition.
 - c. Defrost cycle shall terminate when defrost thermostat is satisfied and shall have a positive termination time of 10 minutes.
 6. Defrost system shall also include:
 - a. Defrost Cycle Indicator LED.
 - b. DIP switch selectable defrost time between 30, 60, 90 and 120 minutes. Factory set at 30 minutes.
 - c. Molded plug connection to ensure proper connection.
- B. (23 09 33.13.B.) Safeties:
1. Compressor Over-Temperature, Over-Current. High Internal Pressure Differential.
 2. Low Pressure Switch.
 - a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
 3. High Pressure Switch.
 - a. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
 4. Heating section shall be provided with the following minimum protections:
 - a. High temperature limit switches.
 5. A2L Refrigerant Leak Dissipation System (Electromechanical):
 - a. Leak dissipation system shall consist of control board and A2L sensor certified to UL 60335-2-40.
 - b. System shall be designed for the life of the unit.
 - c. Dissipation system shall be automatic, ship pre-wired, and require no additional field connections to thermostat to function.

Guide specifications (cont)

- d. Refrigerant leak sensor shall be installed in UL-certified location and orientation. Sensor shall be self-correcting and resettable. Single use refrigerant leak sensor shall not be permitted.
- e. Factory-installed dissipation controller shall use onboard microprocessor and include:
 - 1) Automatic reset after a dissipation event has occurred.
 - 2) Onboard LED with flash code to indicate current unit status and hardware failures.
 - 3) Depressible "Test" button to allow for a system test and recall/reset of leak detection history.
 - 4) 24-v dry contact alarm terminal to allow for external notification of leak detection.
- f. Dissipation control board shall be accessible via normal maintenance locations and LED shall be visible.
- g. Dissipation system shall "Fail Safe" per UL requirements.
- h. Dissipation shall allow smoke and building fire systems to override in case of event.

Part 5 — (23 09 93) Sequence of Operations for HVAC Controls

5.01 (23 09 93.13) Decentralized, Rooftop Units:

- A. (23 09 93.13.A.) INSERT SEQUENCE OF OPERATION

Part 6 — (23 40 13) Panel Air Filters

6.01 (23 40 13.13) Decentralized, Rooftop Units:

- A. (23 40 13.13.A.) Standard Filter Section:
 - 1. Shall consist of factory installed, low velocity, disposable 2 in. thick fiberglass filters of commercially available sizes.
 - 2. Unit shall use only one filter size. Multiple sizes are not acceptable.
 - 3. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of this specification (23 81 19.13.G).

Part 7 — (23 81 19) Self-Contained Air Conditioners

7.01 (23 81 19.13) Small-Capacity Self-Contained Air Conditioners (RHF090-150):

- A. (23 81 19.13.A.) General:
 - 1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a fully hermetic scroll compressor(s) for cooling duty and heat pump heating duty.
 - 2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
 - 3. Unit shall use R-454B refrigerant.

- 4. Unit shall be installed in accordance with the manufacturer's instructions.
- 5. Unit must be selected and installed in compliance with local, state, and federal codes.

B. 23 81 19.13.B.) Quality Assurance:

- 1. Unit meets ASHRAE®¹ 90.1 minimum efficiency requirements.
- 2. Unit shall be rated in accordance with AHRI Standards 340/360.
- 3. Unit shall be designed to conform to ASHRAE 15.
- 4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
- 5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- 6. Unit casing shall be capable of withstanding 500 hour salt spray exposure per ASTM B117 (scribed specimen).
- 7. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001:2015.
- 8. Roof curb shall be designed to conform to NRCA Standards.
- 9. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
- 10. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
- 11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
- 12. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.

C. (23 81 19.13.C.) Delivery, Storage, and Handling:

- 1. Unit shall be stored and handled per manufacturer's recommendations.
- 2. Lifted by crane requires either shipping top panel or spreader bars.
- 3. Unit shall only be stored or positioned in the upright position.

D. (23 81 19.13.D.) Project Conditions:

- 1. As specified in the contract.

E. (23 81 19.13.E.) Operating Characteristics:

- 1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature

1. Third-party trademarks and logos are the property of their respective owners.

Guide specifications (cont)

meeting maximum load criteria of AHRI Standard 340/360 at $\pm 10\%$ voltage.

2. Compressor with standard controls shall be capable of operation down to 40°F (4°C) [0°F (–18°C) for size 120 models], ambient outdoor temperatures in cooling mode.
3. Compressor with standard controls shall be capable of operation down to –10°F (–4°C) ambient outdoor temperatures or lower in heat pump heating mode.
4. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
5. Unit shall be factory configured for vertical - supply and return configurations.
6. Unit shall be field convertible from vertical to horizontal airflow on all models. No special kit required except on 150 size models that require a Supply Duct Kit field installed for horizontal air flow.
7. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

F. (23 81 19.13.F.) Electrical Requirements:

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

G. (23 81 19.13.G.) Unit Cabinet:

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a prepainted baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 in. minimum, gloss (per ASTM D523, 60°F/16°C): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2 in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
4. Base of unit shall have a minimum of 4 locations for thru-the-base gas and electrical gauge connections (factory-installed or field-installed), standard.
5. Base Rail:
 - a. Unit shall have base rails on a minimum of 2 sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - d. Base rail shall be a minimum of 16 gauge thickness.

6. Condensate Pan and Connections:

- a. Shall be a sloped condensate drain pan made of a corrosion resistant material.
- b. Shall comply with ASHRAE Standard 62.
- c. Shall use a 3/4 in. 14 NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.

7. Top Panel:

- a. Shall be a single piece top panel on 090-120 models and 2 piece on 150 size models.

8. Electrical Connections:

- a. All unit power wiring shall enter unit cabinet at a single, factory prepared, knockout location.
- b. Thru-the-base capability.
 - 1) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - 2) Optional, factory approved, water-tight connection method must be used for thru-the-base electrical connections.
 - 3) No basepan penetration, other than those authorized by the manufacturer, is permitted.

9. Component Access Panels (standard):

- a. Cabinet panels shall be easily removable for servicing.
- b. Unit shall have one factory installed, tool-less, removable, filter access panel.
- c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have molded composite handles.
- d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
- e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
- f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

H. (23 81 19.13.H.) Coils:

1. Standard Industry Proven Aluminum Fin-Copper Tube Coils:
 - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 60335-2-40 burst test at 1775 psig.

Guide specifications (cont)

- c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 60335-2-40 burst test at 1980 psig.
- 2. Optional Pre-coated Aluminum-Fin Condenser Coils:
 - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
 - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
 - c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
 - d. Corrosion durability of fin stock shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117.
 - e. Corrosion durability of fin stock shall be confirmed through testing to have no visible corrosion after 48 hour immersion in a room temperature solution of 5% salt, 1% acetic acid.
 - f. Fin stock coating shall pass 2000 hours of the following: one week exposure in the prohesion chamber followed by one week of accelerated ultraviolet light testing. Prohesion chamber: the solution shall contain 3.5% sodium chloride and 0.35% ammonium sulfate. The exposure cycle is one hour of salt fog application at ambient followed by one hour drying at 95°F (35°C).
- 3. Optional Copper-Fin Evaporator and Condenser Coils:
 - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
 - b. Galvanized steel tube sheets shall not be acceptable.
 - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
- 4. Optional E-coated Aluminum-Fin Evaporator and Condenser Coils:
 - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
 - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
 - c. Color shall be high gloss black with gloss per ASTM D523.
 - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
 - e. Superior hardness characteristics of 2H per ASTM D3363 and cross-hatch adhesion of 4B-5B per ASTM D3359.
 - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794).
 - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247 and ASTM D870).
 - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117.
- I. (23 81 19.13.I.) Refrigerant Components:
 - 1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
 - b. Refrigerant filter drier — Solid core design with pre and post filter service gauge connections for filter diagnostics and maintenance.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through a specially designed access port in the top panel of the unit.
 - e. Suction line accumulator to provide protection in all operating modes from cooling, heating and reverse cycle switching.
 - 2. There shall be gauge line access port in the skin of the rooftop.
 - a. The gauge access port shall enable maintenance personnel to route their pressure gauge lines.
 - b. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
 - 3. Compressors:
 - a. Unit shall use tandem scroll compressor assembly on a single refrigeration circuit with two stages of cooling for efficient comfort cooling operation.
 - b. Evaporator coils shall be a full active design to help better control latent removal and minimize unconditioned bypass air.
 - c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - d. Compressors shall be internally protected from high discharge temperature conditions.
 - e. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.

Guide specifications (cont)

- f. Compressor shall be factory-mounted on rubber grommets.
 - g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
 - h. Crankcase heaters shall not be required for normal operating range, unless required by the manufacturer due to refrigerant charge limits.
- J. (23 81 19.13.J.) Filter Section:
- 1. Filters access is specified in the unit cabinet section of this specification.
 - 2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
 - 3. Shall consist of factory installed, low velocity, throw-away 2 in. thick fiberglass filters.
 - 4. Filters shall be standard, commercially available sizes.
 - 5. Only one size filter per unit is allowed.
- K. (23 81 19.13.K.) Evaporator Fan and Motor with X-Vane™ Fan Technology:
- 1. Direct Drive Evaporator Fan Motor:
 - a. Shall be a ECM motor design.
 - b. Shall be direct drive design for all static options.
 - c. Shall have permanently lubricated bearings.
 - d. Shall have inherent automatic-reset thermal overload protection.
 - e. Shall have slow ramp up to speed capabilities.
 - f. Shall require no fan/motor belts for operation, adjustments and or initial fan speed set up.
 - g. Fan DC voltage set up on Unit Control Board can eliminate the need of removal of blower access door, required on conventional belt drive systems.
 - h. Shall be internally protected from electrical phase reversal and loss.
 - 2. Evaporator Fan:
 - a. a.Speed shall be easily set with dedicated selection switch and adjustment pot on unit control.
 - b. Shall provide 2 stage cooling capacity control, the indoor fan speed is automatically controlled to meet the code-compliant <66% low fan speed and 100% at full fan speed operation.
 - c. Blower fan shall be a Vane Axial fan design with fan assembly secured directly to ECM motor. Additional shafts, belts, pulleys/ sheaves, and bearing blocks to drive fan shall not be permitted or necessary.
 - d. Additional variable frequency drive to control fan motor speed shall not be permitted or necessary. All speed control electronics must be onboard fan motor assembly.
- L. (23 81 19.13.L.) Condenser Fans and Motors:
- 1. Condenser Fan Motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design on all sizes.
 - 2. Condenser Fans:
 - a. Shall be a direct-driven propeller type fan.
 - b. Shall have galvalum blades riveted to steel spider that have corrosion-resistant properties and shall be dynamically balanced.
- M. (23 81 19.13.M.) Special Features Options and Accessories:
- 1. Integrated EconomizerONE Low Leak Rate Models.
 - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when
- e. Shall be constructed of a cast aluminum stator and high impact composite material on rotor and air inlet casing.
- f. Shall be a patented / pending design with a corrosion resistant material.
- g. Fan assembly design shall be integrated to fan deck, dynamically balanced, and require no additional vibration isolation for normal operation.
- h. Shall have slow ramp up to speed capabilities to help reduce sound and comfort issues typically associated with single speed belt drive systems.
- i. Shall be a slide out design with removal of a few support brackets.
3. Shall include an easily accessible Unit Control Board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, and low and high pressure switches. Controller shall also provide an intuitive means to adjust the indoor fan speed through a simple switch and pot adjustment design.

Guide specifications (cont)

temperature and/or humidity are below setpoints.

- e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
- f. Low leak rate shall be equipped with dampers not to exceed 2% leakage at 1 in. wg pressure differential.
- g. Economizer controller on EconomizerONE models shall be Siemens POL224 that provides:
 - 1) Combined minimum and DCV maximum damper position potentiometers with compressor staging relay.
 - 2) Optional configuration via WLAN stick and Siemens Climatix™¹ smartphone app for easy setup.
 - 3) Functions with solid-state analog enthalpy or dry bulb changeover control sensing.
 - 4) LED indication for free cooling, sensor, and damper operation.
 - 5) One-line LCD interface screen for setup, configuration and troubleshooting.
 - 6) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24, ASHRAE 90.1 and IECC®¹.
 - 7) Sensor failure loss of communication identification.
 - 8) Capabilities for use with multiple-speed or single speed indoor fan systems.
 - 9) Digital sensors: Dry bulb and Enthalpy.
- h. Shall be capable of introducing up to 100% outdoor air.
- i. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
- j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
- k. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
- l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.

- m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
 - n. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - o. Economizer controller shall accept a 0 to 10 vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
 - p. Compressor lockout temperature on POL224 control is adjustable from -45°F to 80°F (-43°C to 27°C), set at a factory default of 32°F (0°C).
 - q. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - r. Contains LED indication for free cooling, sensor, and damper operation.
2. Integrated EconomizerONE Ultra Low Leak Rate Models.
- a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory-installed option.
 - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - f. Ultra Low Leak design meets California Title 24 section 140.4 and ASHRAE 90.1 requirements for 4 cfm per sq ft on the outside air dampers and 10 cfm per sq ft on the return dampers.
 - g. Economizer controller on EconomizerONE models shall be the Siemens POL224 that provides:
 - 1) One-line LCD interface screen for setup, configuration and troubleshooting.
 - 2) Optional configuration via WLAN stick and Siemens Climatix™ smartphone app for easy setup.
 - 3) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24, ASHRAE 90.1 and IECC.

1. Third-party trademarks and logos are the property of their respective owners.

Guide specifications (cont)

- 4) Sensor failure loss of communication identification.
- 5) Capabilities for use with multiple-speed indoor fan systems.
- 6) Digital sensors: Dry bulb and Enthalpy.
- h. Shall be capable of introducing up to 100% outdoor air.
- i. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
- j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
- k. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
- l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
- m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
- n. Dampers shall be completely closed when the unit is in the unoccupied mode.
- o. Economizer controller shall accept a 0 to 10 vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
- p. Compressor lockout temperature on POL224 control is adjustable from -45°F to 80°F (-43°C to 27°C), set at a factory default of 32°F (0°C).
- q. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- r. Contains LED indication for free cooling, sensor, and damper operation.
3. Wi-Fi/WLAN Stick for EconomizerONE POL224 (field-installed):
This item allows use of the Siemens Climatix™ mobile application.
4. Two-Position Damper (field-installed only):
 - a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
 - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
 - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
 - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
 - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
 - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
 - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
 - h. Outside air hood shall include aluminum water entrainment filter.
5. Manual Damper (field-installed only):
Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25% or 50% outdoor air for year round ventilation.
6. Low Ambient Control Package:
 - a. Controller shall control coil head pressure by condenser fan speed modulation or condenser fan cycling and wind baffles.
 - b. Shall consist of solid-state control and condenser coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C). For full low ambient control range, winter start kit is required.
7. Condenser Coil Hail Guard Assembly:
 - a. Shall protect against damage from hail.
 - b. Shall be louvered type.
8. Unit-Mounted, Non-Fused Disconnect Switch
 - a. Available on 7.5 to 10 ton units with FLA of 80 amps or less, or 12.5 ton units with FLA of 100 amps or less (460/575V) or 200 amps or less (208/230V).
 - b. Switch shall be factory installed, internally mounted.
 - c. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
 - d. Shall be accessible from outside the unit.
 - e. Shall provide local shutdown and lockout capability.
 - f. Sized only for the unit as ordered from the factory. Does not accommodate field-installed devices.
9. Convenience Outlet:
 - a. Factory Installed Powered Convenience Outlet.
 - 1) Outlet shall be powered from main line power to the rooftop unit.

Guide specifications (cont)

- 2) Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
- 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
- 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
- 5) Voltage required to operate convenience outlet shall be provided by a factory installed step-down transformer.
- 6) Outlet shall be accessible from outside the unit.
- 7) Outlet shall include a field installed "Wet in Use" cover.
- b. Factory-Installed Non-Powered Convenience Outlet.
 - 1) Outlet shall be powered from a separate 115/120v power source.
 - 2) A transformer shall not be included.
 - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - 5) Outlet shall be accessible from outside the unit.
 - 6) Outlet shall include a field installed "Wet in Use" cover.
- c. Field-Installed Non-Powered Convenience Outlet.
 - 1) Outlet shall be powered from a separate 115/120v power source.
 - 2) A transformer shall not be included.
 - 3) Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.
 - 4) Outlet shall include 20 amp GFI receptacles. This kit provides a flexible installation method which allows code compliance for height requirements of the GFCI outlet from the finished roof surface as well as the capability to relocate the outlet to a more convenient location.
 - 5) Outlet shall be accessible from outside the unit.
 - 6) Outlet shall include a field installed "Wet in Use" cover.
10. Thru-the-Base Connectors:
 - a. Kits shall provide connectors to permit gas and electrical connections to be brought to the unit through the unit basepan.
 - b. Minimum of 4 connection locations per unit.
11. Supply Duct Cover (size 150 only):
 - a. Required when converting the factory standard vertical duct supply to horizontal duct supply configuration. One required per unit.
12. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust is shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0 to 100% adjustable setpoint on the economizer control.
13. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
14. Outdoor Air Enthalpy Sensor:

The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
15. Return Air Enthalpy Sensor:

The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
16. Indoor Air Quality (CO₂) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
17. Smoke Detectors:
 - a. Shall be a 4-wire controller and detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.

Guide specifications (cont)

- e. Shall have a recessed momentary switch for testing and resetting the detector.
- f. Controller shall include:
 - 1) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
 - 2) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - 3) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - 4) Capable of direct connection to 2 individual detector modules.
 - 5) Can be wired to up to 14 other duct smoke detectors for multiple fan shut-down applications.
- 18. Winter Start Kit:
 - a. Shall contain a bypass device around the low pressure switch.
 - b. Shall be required when mechanical cooling is required down to 40°F (4°C).
 - c. Shall not be required to operate on an economizer when below an outdoor ambient of 40°F (4°C).
- 19. Time Guard Control Circuit:
 - a. Shall prevent compressor short-cycling by providing a 5 minute delay (±2 minutes) before restarting a compressor after shut-down for any reason.
 - b. One device shall be required per compressor.
- 20. Hinged Access Panels:
 - a. Shall provide easy access through integrated quarter turn latches.
 - b. Shall be on major panels of: filter, control box, fan motor, and compressor.
- 21. Condensate overflow switch:

This sensor and related controller monitors the condensate level in the drain pan and shuts down compression operation when overflow conditions occur. It includes:

 - a. Indicator light — solid red (more than 10 seconds on water contact — compressors disabled), blinking red (sensor disconnected).
 - b. 10 second delay to break — eliminates nuisance trips from splashing or waves in pan (sensor needs 10 seconds of constant water contact before tripping).
 - c. Disables the compressors operation when condensate plug is detected, but still allows fans to run for Economizer.
- 22. 4 in. Filter Rack Kit:
 - a. The 4 in. filter rack accessory kit is designed to hold 4 in. MERV-8 or MERV-13 filters. Filters not included in kit.
 - b. Shall not be compatible with horizontal units with field installed economizers.
- 23. Phase Monitor Control:
 - a. Shall monitor the sequence of 3 phase electrical system to provide a phase reversal protection.
 - b. Shall monitor the 3 phase voltage inputs to provide a phase loss protection for the 3 phase device.
 - c. Will work on either a Delta or Wye power connection.
- 24. Horn/Strobe Annunciator:
 - a. Provides an audible/visual signaling device for use with factory-installed option or field installed accessory smoke detectors.
 - 1) Requires installation of a field-supplied 24-v transformer suitable for 4.2 VA (AC) or 3.0 VA (DC) per horn/strobe accessory.
 - 2) Requires field-supplied electrical box, North American 1-gang box, 2 in. x 4 in. (51 mm x 102 mm).
 - 3) Shall have a clear colored lens.
- 25. Electric Heat:
 - a. Heating Section:
 - 1) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
 - 2) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.
- 26. 29.High Short Circuit Current Rating (SCCR) Protection:
 - a. a.Factory-installed option shall provide high short circuit current protection to compressor and all indoor and outdoor fan motors rated at 10 kA against high potential fault current situations. (Standard unit comes with 5 kA rating.)
 - b. This option is not available with factory installed powered convenience outlet, non-fused disconnect, low ambient controls, phase loss monitor/protection, and 575-v models.

© 2024 Carrier
Lewisburg, Tennessee 37091 USA
www.GoICPCommercial.com